

Sample Name : Crustacean Cardioactive Peptide (CCAP)
 Cat. No. : RP10572
 Lot. No. : PE3201606

Pump A : 0.065% trifluoroacetic in 100% water (v/v)
 Pump B : 0.05% trifluoroacetic in 100% acetonitrile (v/v)
 Total Flow:1 ml/min
 Wavelength:220 nm


Time	Unit	Command	Value	Comment
0.01	Pumps	Pump A B.Conc	5	
25.00	Pumps	Pump A B.Conc	65	
25.01	Pumps	Pump A B.Conc	95	
31.00	Pumps	Pump A B.Conc	95	
31.01	Pumps	Pump A B.Conc	5	
40.00	Pumps	Pump A B.Conc	5	
40.01	Controller	Stop		

<<Column Performance>>

<Detector A>

Column : Alltima™ C18 4.6 x 250 mm

Chromatogram

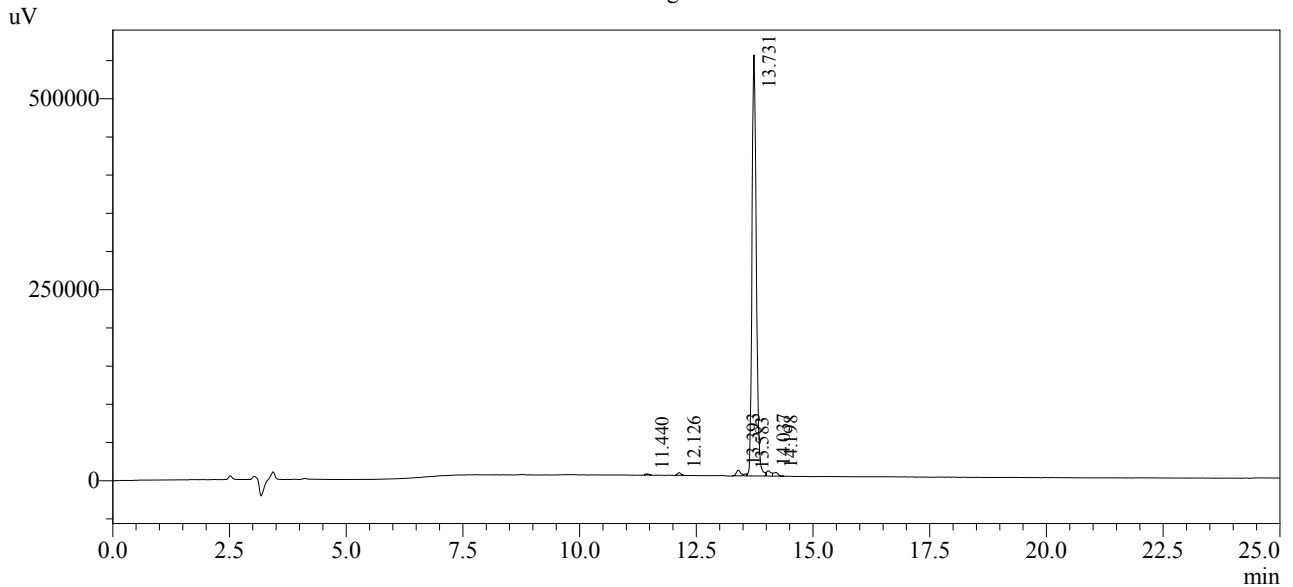

1 Det.A Ch1 / 220nm

Peak Table

Detector A Ch1 220nm

Peak#	Ret. Time	Area	Height	Area %
1	11.440	6928	1596	0.187
2	12.126	16827	3409	0.454
3	13.393	48263	7386	1.301
4	13.583	11728	2600	0.316
5	13.731	3548479	551261	95.660
6	14.037	45346	6838	1.222
7	14.198	31910	4737	0.860
Total		3709481	577827	100.000