

Sample Name : DYKDDDDK Peptide
 Cat. No. : RP10586
 Lot. No. : PE8761608

Pump A : 0.065% trifluoroacetic in 100% water (v/v)
 Pump B : 0.05% trifluoroacetic in 100% acetonitrile (v/v)
 Total Flow:1 ml/min
 Wavelength:220 nm


Time	Unit	Command	Value	Comment
0.01	Pumps	Pump A B.Conc	5	
25.00	Pumps	Pump A B.Conc	65	
25.01	Pumps	Pump A B.Conc	95	
31.00	Pumps	Pump A B.Conc	95	
31.01	Pumps	Pump A B.Conc	5	
40.00	Pumps	Pump A B.Conc	5	
40.01	Controller	Stop		

<<Column Performance>>

<Detector A>

Column : Alltima™ C18 4.6 x 250 mm

Chromatogram

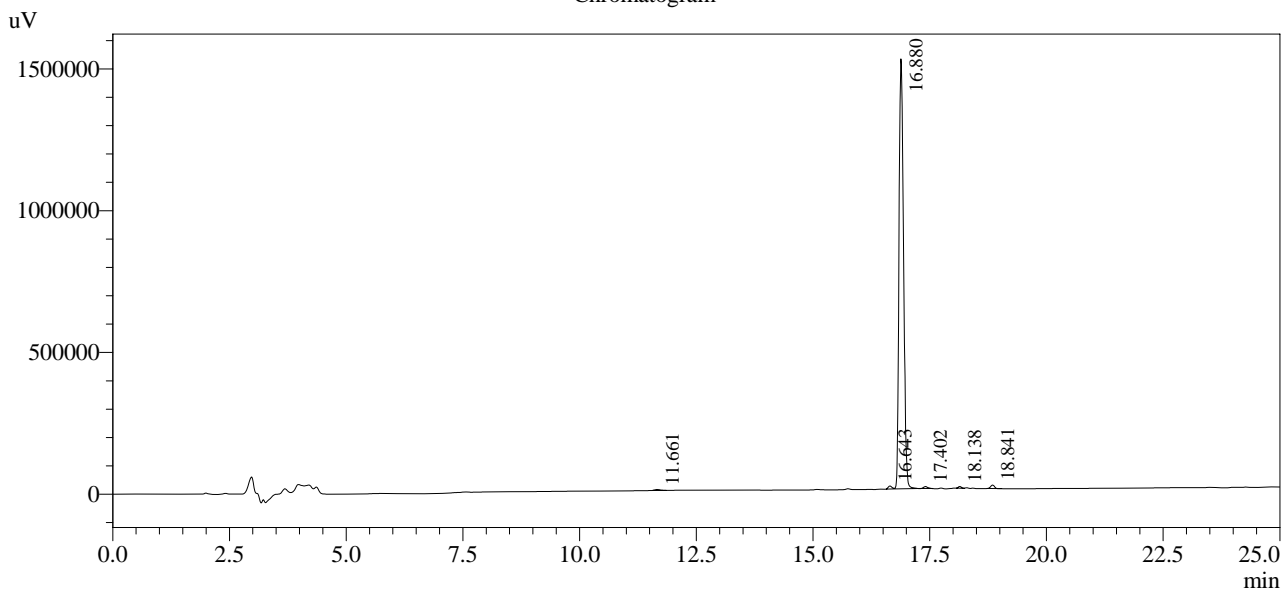

1 Det.A Ch1 / 220nm

Peak Table

Detector A Ch1 220nm

Peak#	Ret. Time	Area	Height	Area %
1	11.661	20109	2858	0.193
2	16.643	59216	10555	0.567
3	16.880	10219733	1516391	97.914
4	17.402	42127	6980	0.404
5	18.138	27122	6073	0.260
6	18.841	69135	12291	0.662
Total		10437443	1555149	100.000