


Mass Spectrum

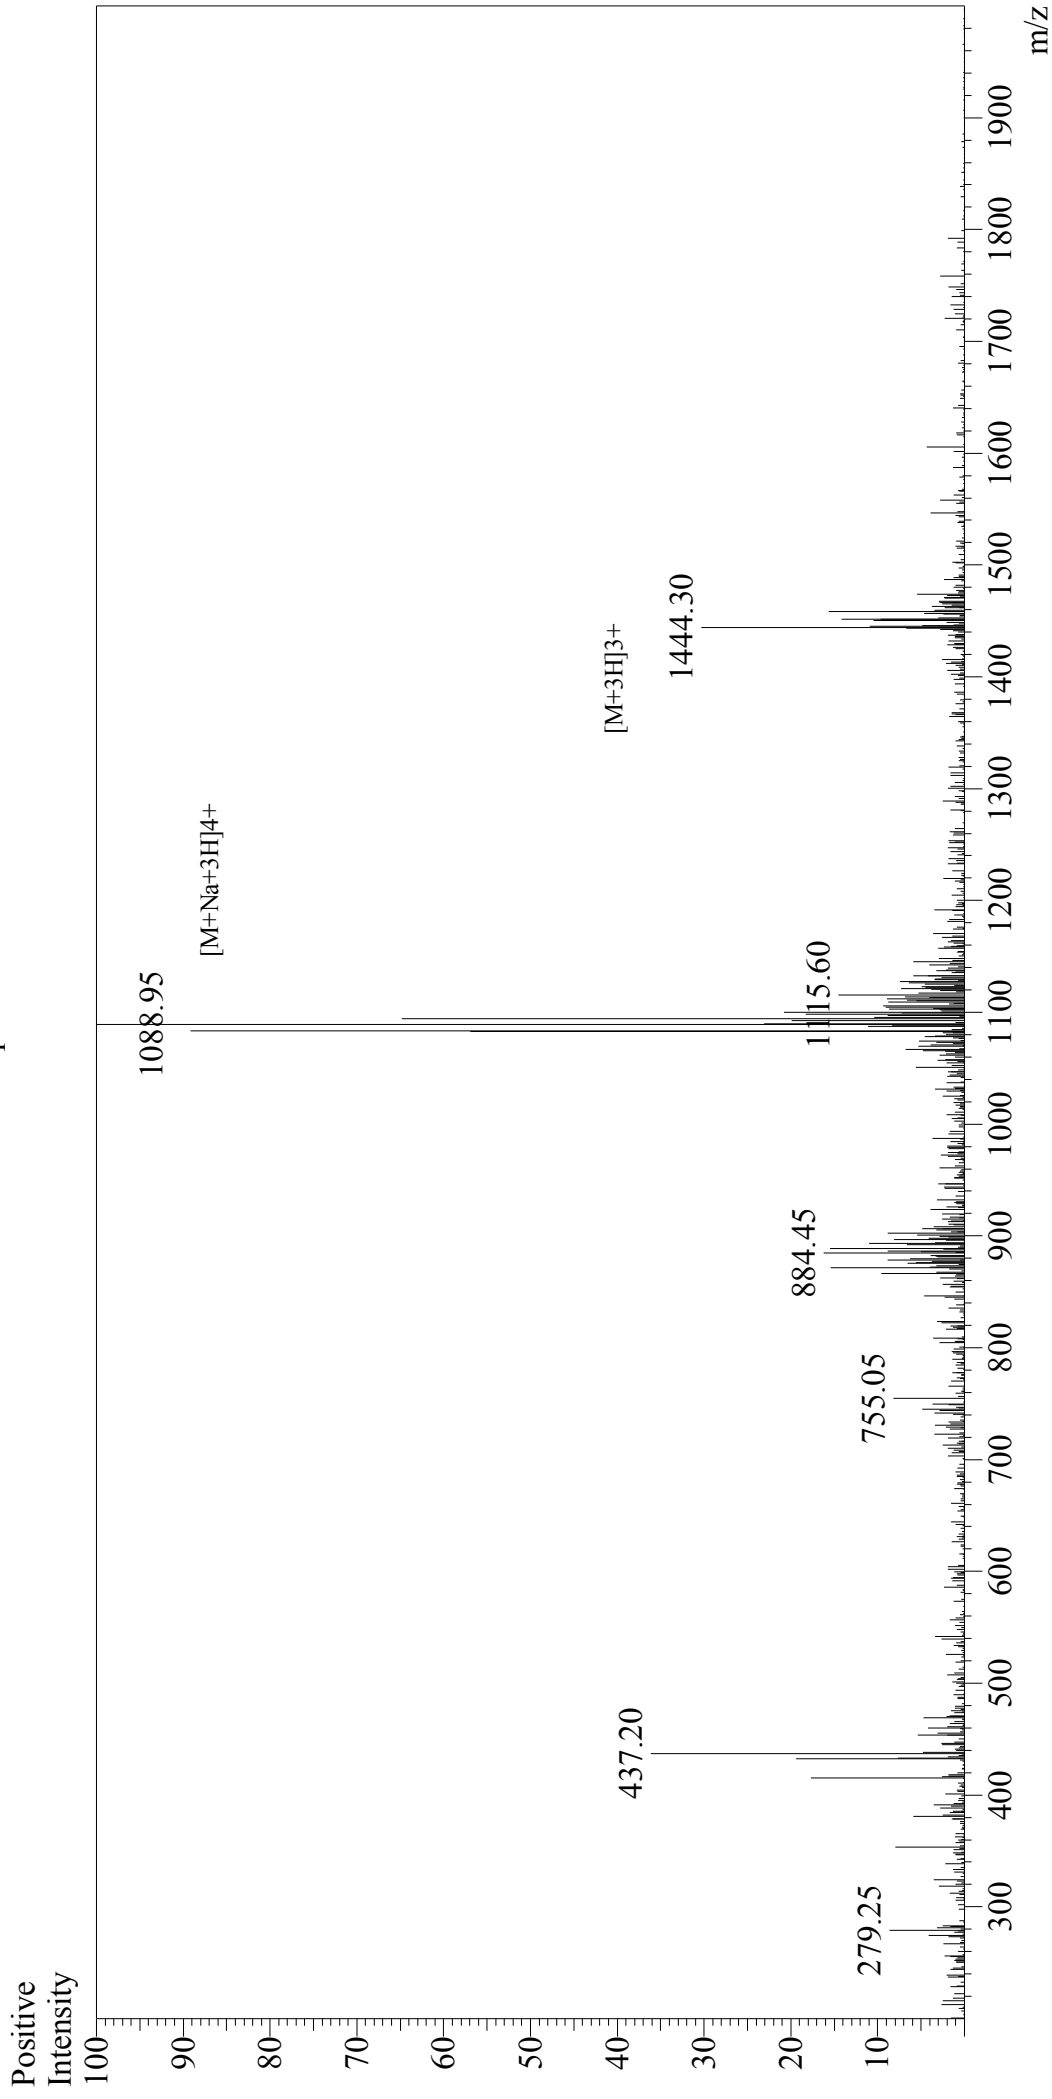

Sample Information

User : Gary
Month-Day Processed : 09/28/16
Time Processed : 17:17:03
Injection Volume : 0.2
Sample Name : β -Amyloid (1-40)
Cat No. : RPI0004
Lot No. : PE2001609
Theoretical MW : 4329.82
Observed MW : 4330.80

Interface

Interface : ESI
Nebulizing Gas Flow : 1.5L/min
CDL Temp : 250°C
Block Temp : 200°C

Interface Bias

Interface Bias : +4.5kV
Drying Gas Flow : 5 L/min
T.Flow : 0.2ml/min
B.conc : 50%H2O/50%MeOH