


Mass Spectrum

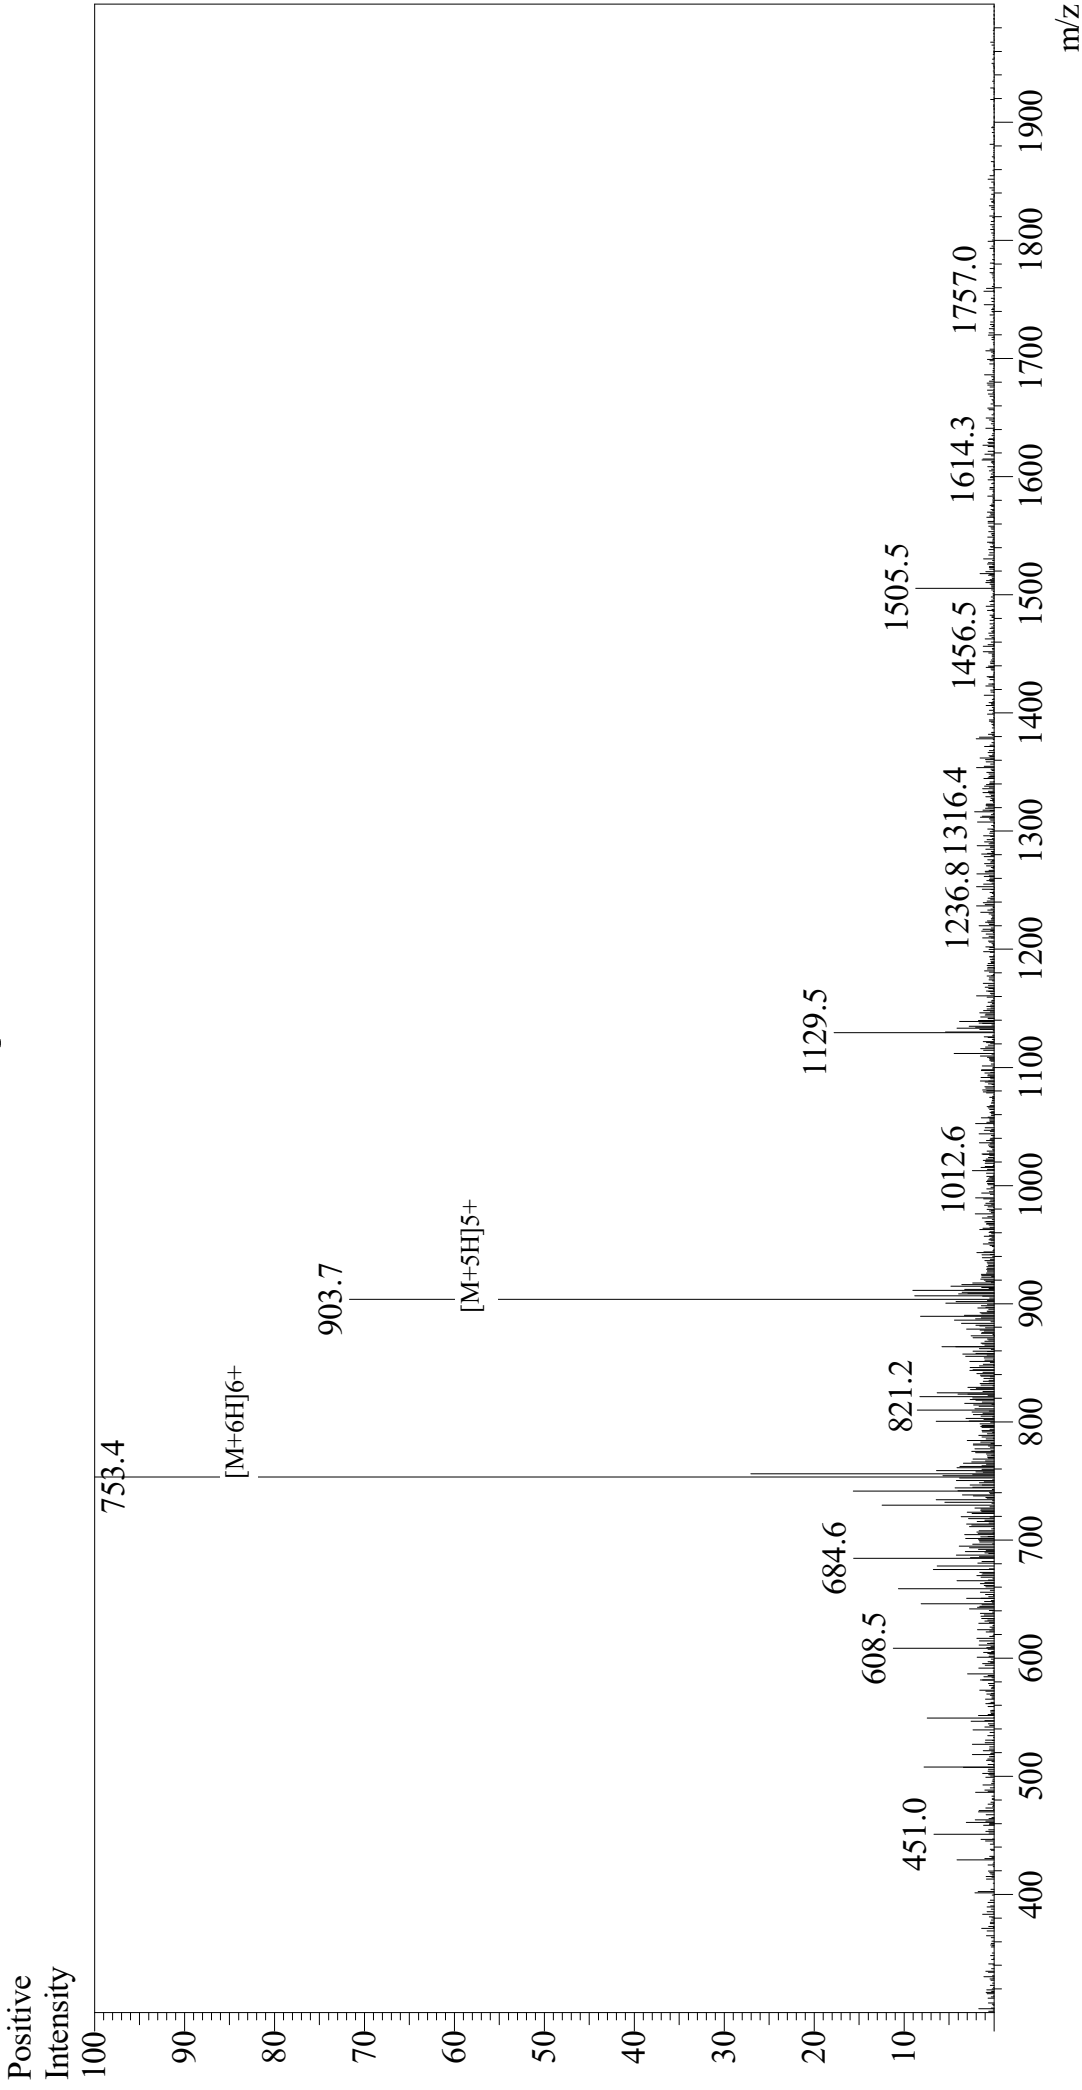

Sample Information

Acquired by : Gary
 Month-Day Processed : 05/30/19
 Time Processed : 01:20:03 PM
 Injection Volume : 0.3
 Sample Name : β -Amyloid (1-42), human
 Cat No.: RP10017
 Lot No.: PE4341905
 Theoretical MW : 4514.10
 Observed MW : 4514.4

Interface

Interface : ESI
 Nebulizing Gas Flow : 1.5L/min
 CDL Temp : 250
 Block Temp : 200

Equipment

Equipment : GK11010007
 Interface Bias : +4.5 kV
 Drying Gas Flow : 5 L/min
 T.Flow : 0.2 ml/min
 B.conc : 50% H₂O/50% MeOH