


Mass Spectrum

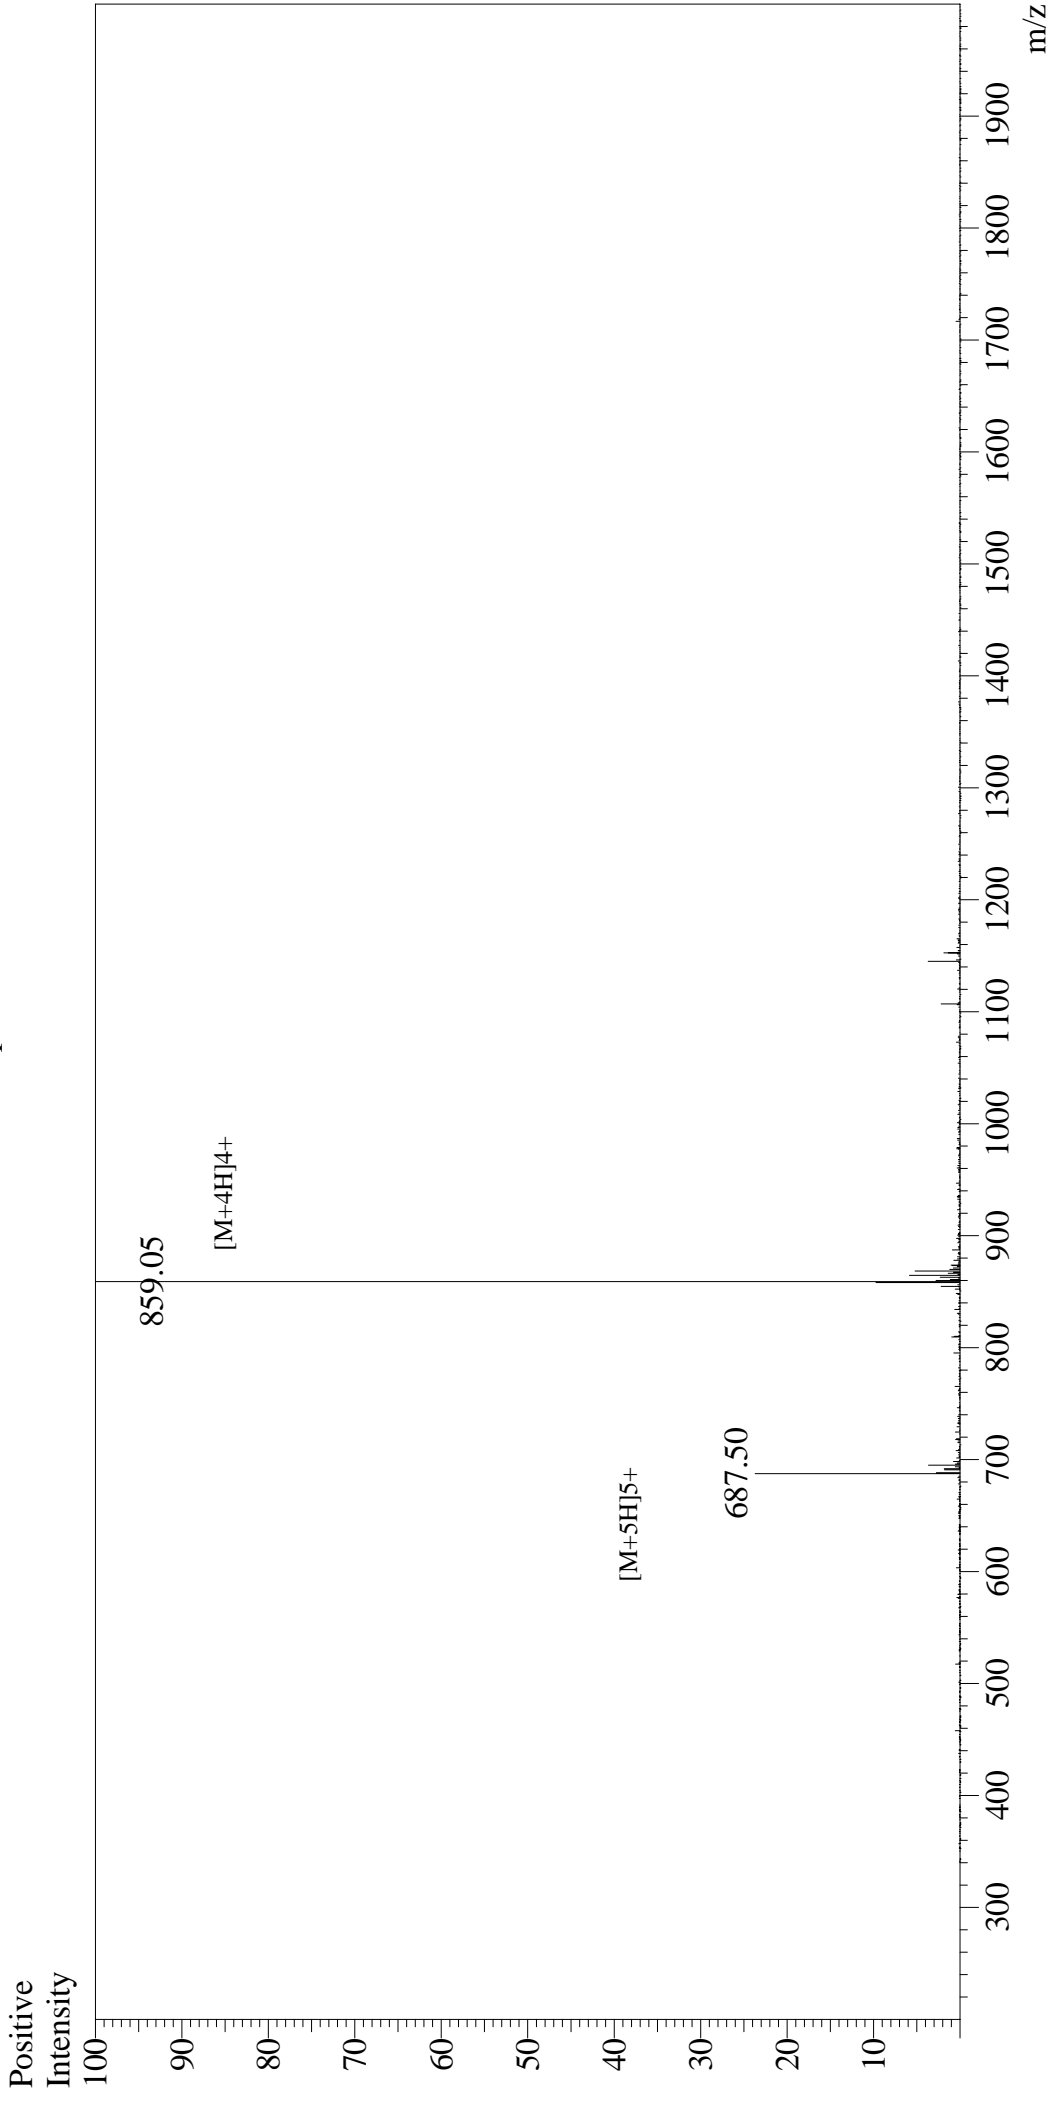

Sample Information

User : Gary
Month-Day Processed : 06/21/18
Time Processed : 17:14:13
Injection Volume : 0.2
Sample Name : Calcitonin, salmon
Cat No. : RP11099
Lot No. : PE9871806
Theoretical MW : 3431.90
Observed MW : 3432.20

Interface : ESI
Nebulizing Gas Flow : 1.5L/min
CDL Temp : 250 °C
Block Temp : 200 °C

Interface Bias : +4.5kV
Drying Gas Flow : 5 L/min
T.Flow : 0.2ml/min
B.conc : 50%H2O/50%MeOH