

Sample Name : Arg-Gly-Asp-Cys  
 Cat No : RP10860  
 Lot No : E8171720L  
 Time Processed : 14:13:04  
 Month-Day-Year Processed : 12/23/2020

Pump A : 0.065% trifluoroacetic in 100% water (v/v)  
 Pump B : 0.05% trifluoroacetic in 100% acetonitrile (v/v)  
 Total Flow: 1 ml/min  
 Wavelength: 220 nm


Time	Module	Command	Value
0.01	Pumps	B.Conc	5
25.00	Pumps	B.Conc	65
25.01	Pumps	B.Conc	95
31.00	Pumps	B.Conc	95
31.01	Pumps	B.Conc	5
40.00	Pumps	B.Conc	5
40.01	Controller	Stop	

<<Column Performance>>

<Detector A>

Column : Inertsil ODS-3 4.6 x 250 mm

Chromatogram

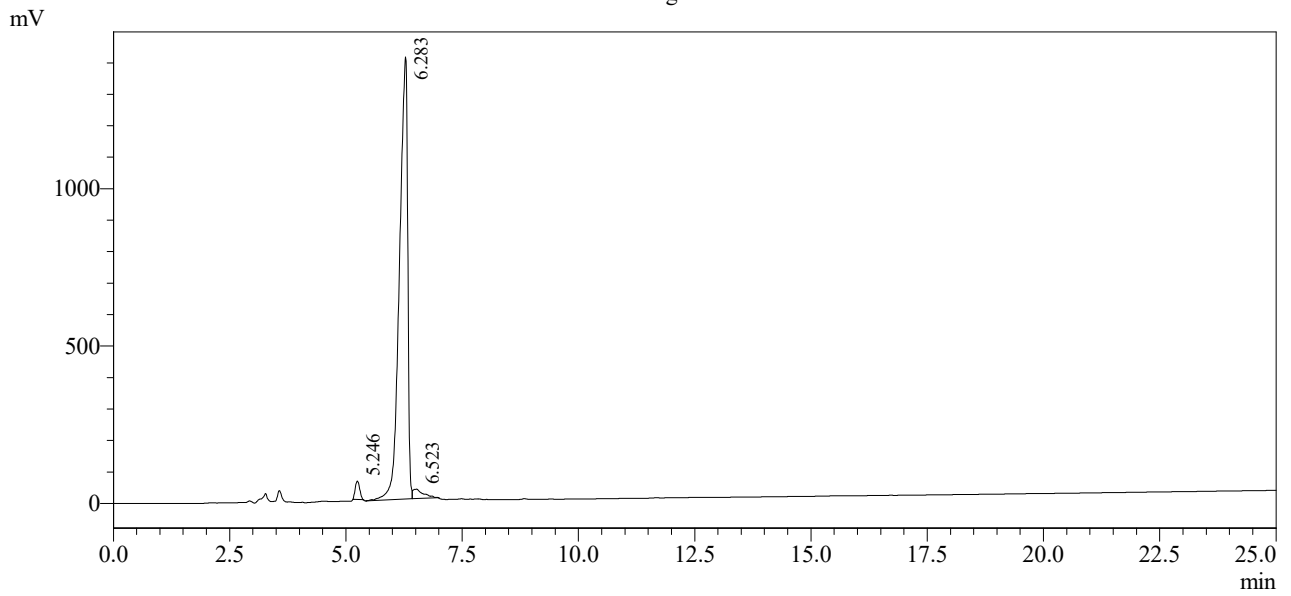

1 Detector A Channel 1 / 220nm

Peak Table

Detector A Channel 1 220nm

Peak#	Ret. Time	Area	Height	Area %
1	5.246	393446	58150	2.176
2	6.283	17217539	1405059	95.222
3	6.523	470514	29984	2.602
Total		18081499	1493192	100.000