


Mass Spectrum

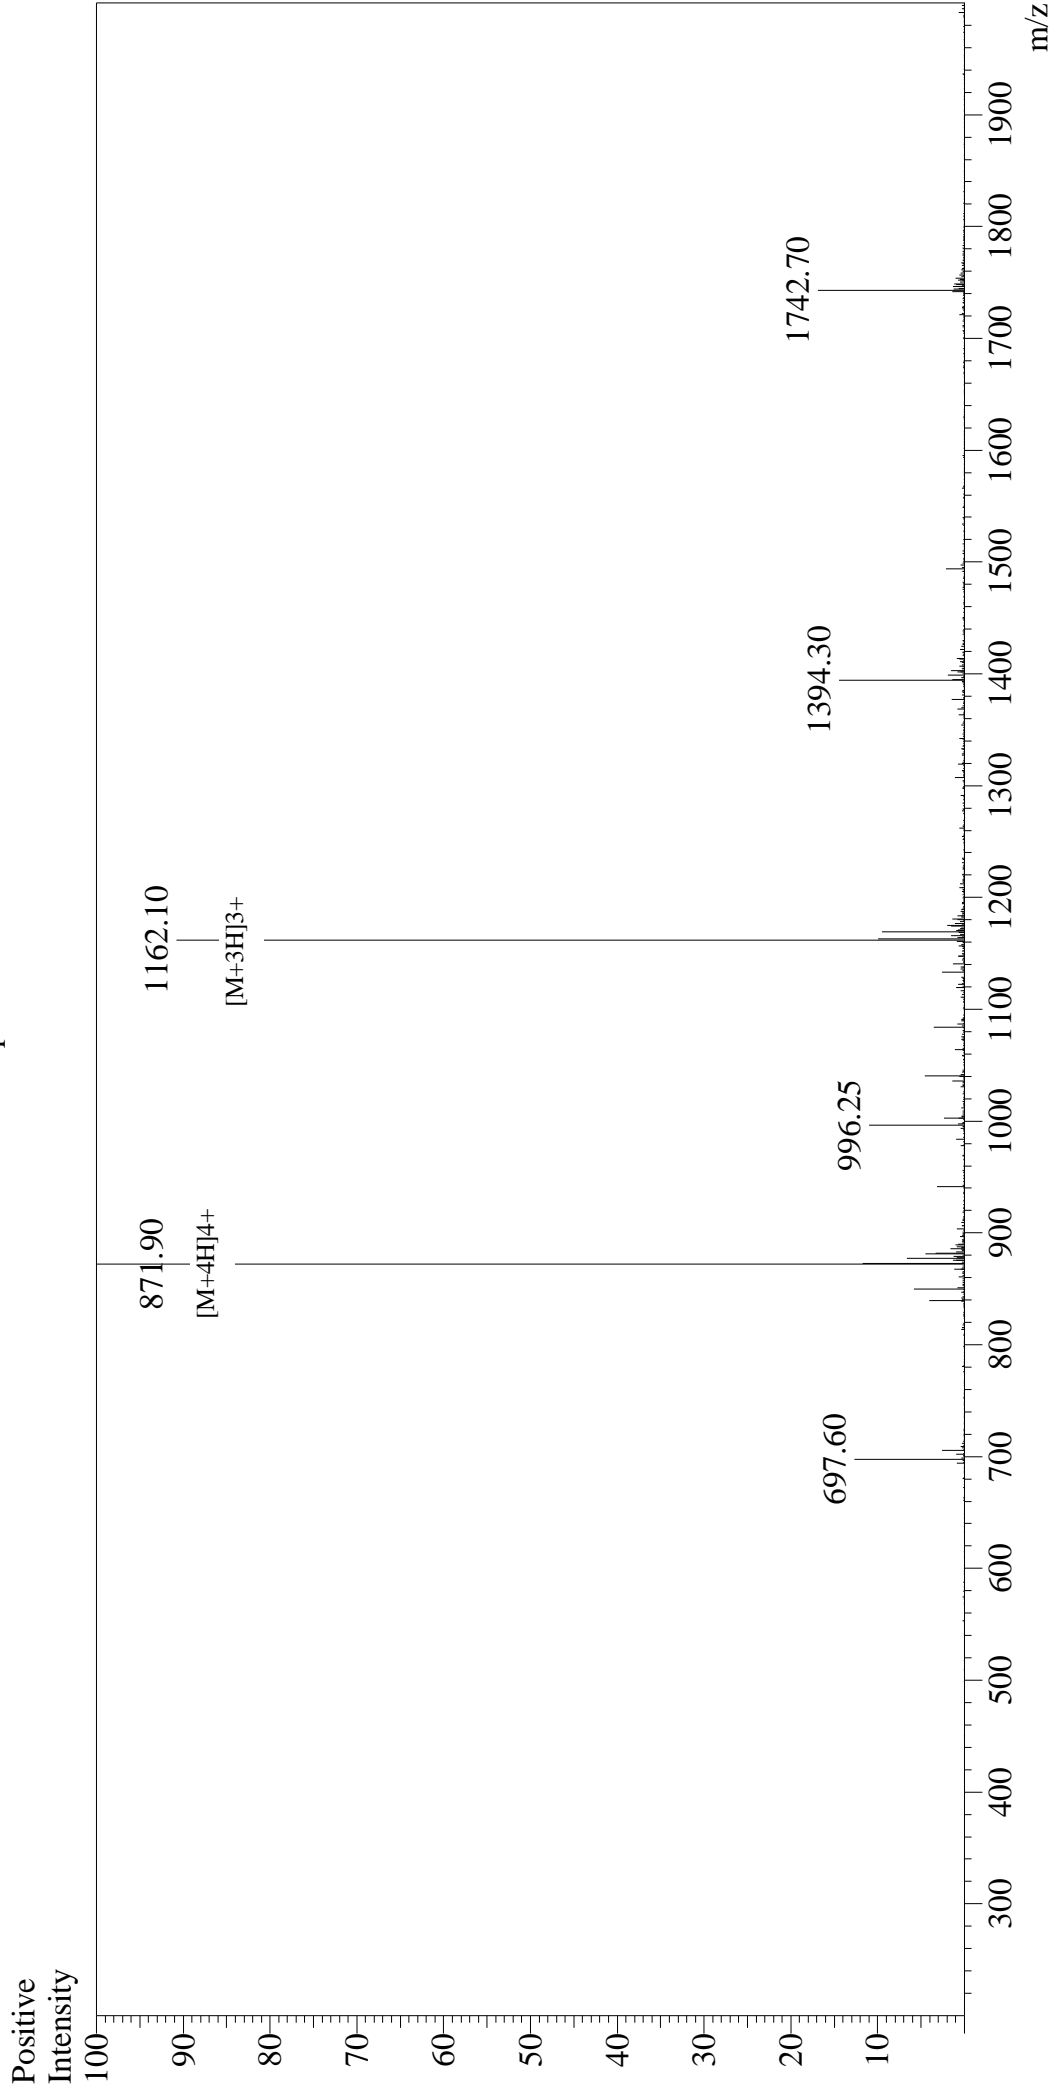

Sample Information

User : Gary
Month-Day Processed : 12/13/17
Time Processed : 9:39:23
Injection Volume : 0.2
Sample Name : Glucagon (1-29), Human, Hydrochloride Salt
Cat No. : RPI10772
Lot No. : PE2461712
Theoretical MW : 3482.80
Observed MW : 3483.60

Interface

Interface : ESI
Nebulizing Gas Flow : 1.5L/min
CDL Temp : 250°C
Block Temp : 200°C

Interface Bias

Interface Bias : +4.5kV
Drying Gas Flow : 5 L/min
T.Flow : 0.2ml/min
B.conc : 50%H2O/50%MeOH