


# Mass Spectrum

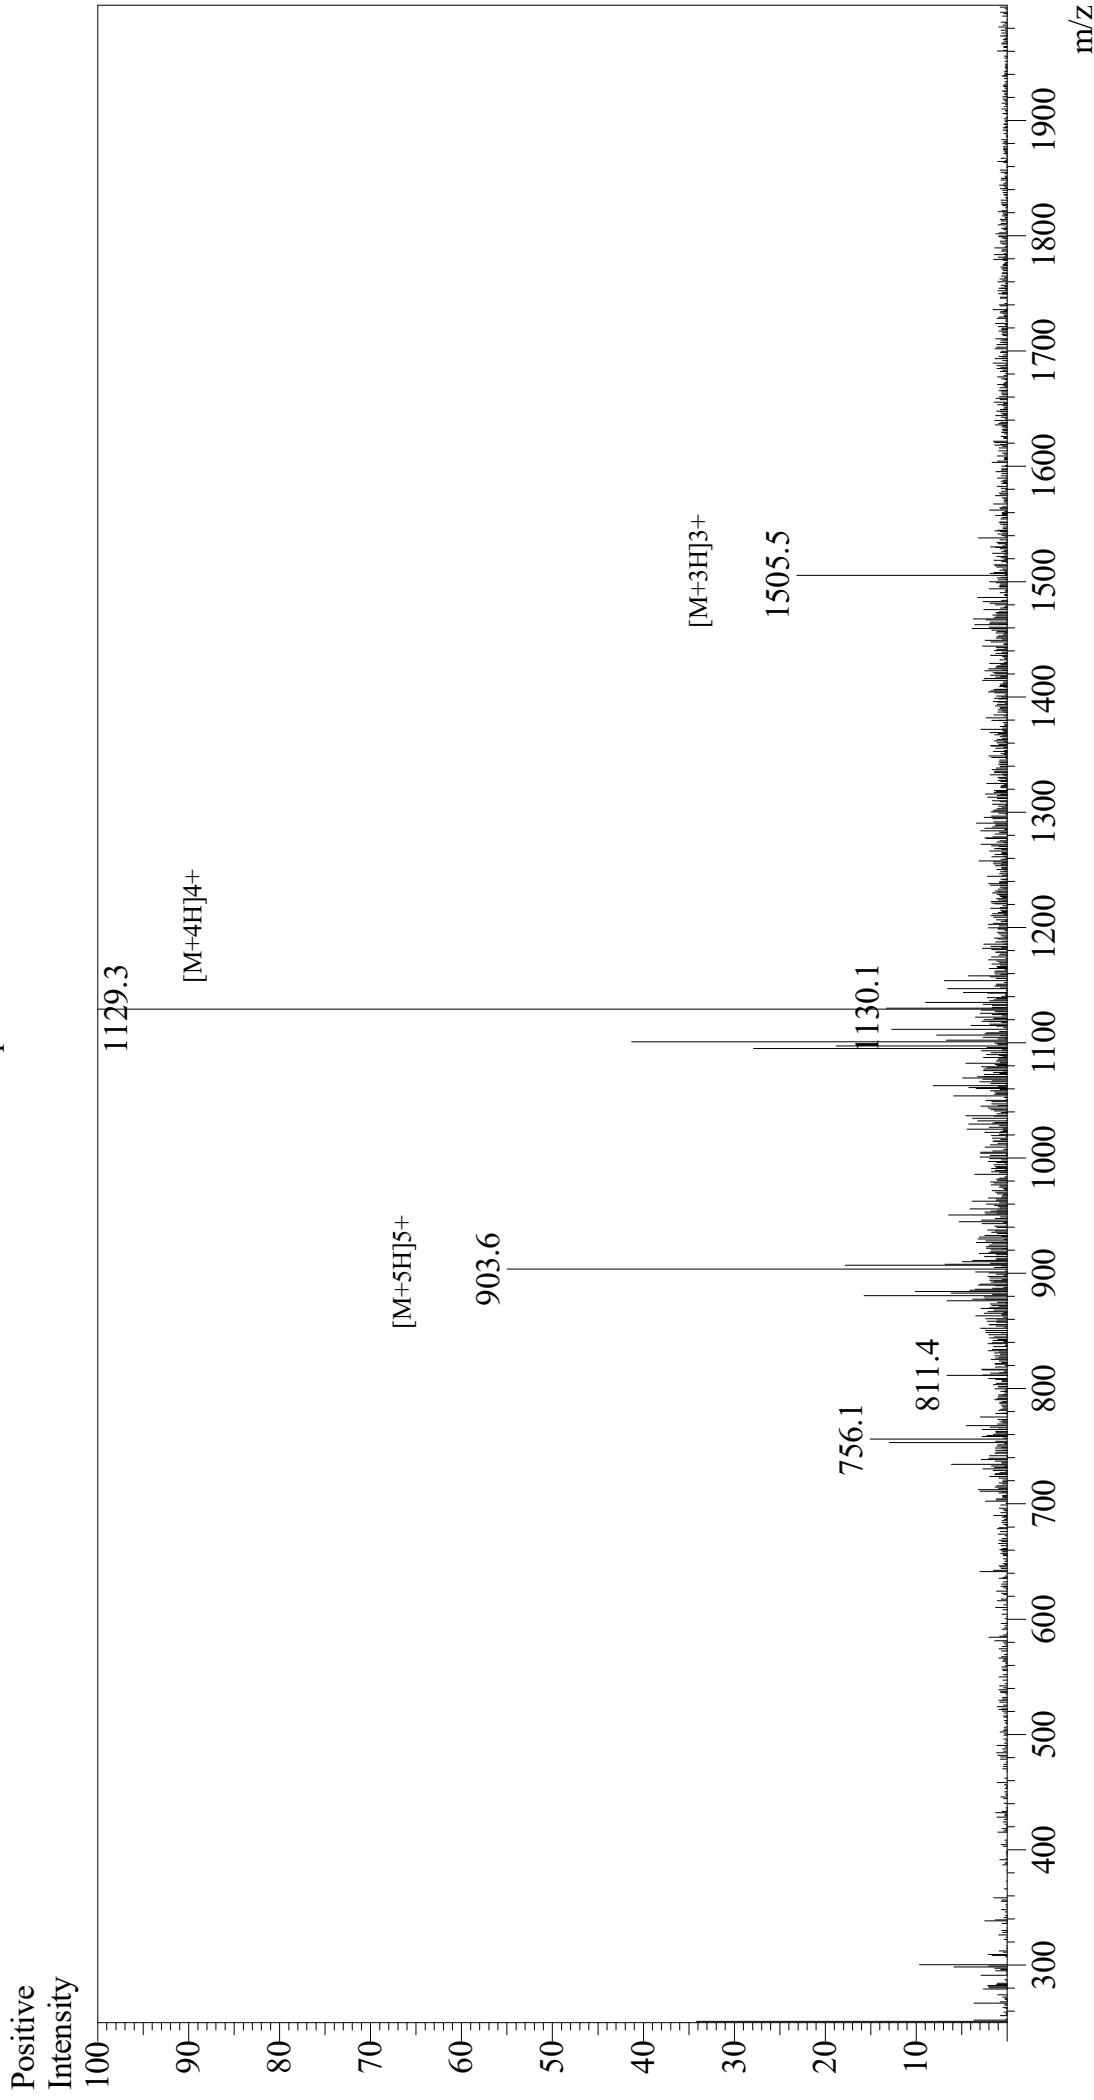

Sample Information  
Month-Day Processed : 12/24/20  
Time Processed : 5:18:35 PM  
Injection Volume : 0.4  
Sample Name :  $\beta$ -Amyloid (1-42), human  
Cat No. : RP20527  
Lot No. : E7992720L  
Theoretical MW : 4514.10  
Observed MW : 4513.2

Interface : ESI  
Nebulizing Gas Flow : 1.5L/min  
CDL Temp : 250  
Block Temp : 200

Equipment : GK11010007  
Interface Bias : +3.5 kV  
Drying Gas Flow : 5 L/min  
T.Flow : 0.2 ml/min  
B.conc : 50%H2O/50%MeOH