

Sample Name : Transdermal Peptide
 Cat. No. : RP20404
 Lot. No. : PE6751710

Pump A : 0.065% trifluoroacetic in 100% water (v/v)
 Pump B : 0.05% trifluoroacetic in 100% acetonitrile (v/v)
 Total Flow:1 ml/min
 Wavelength:220 nm


Time	Unit	Command	Value	Comment
0.01	Pumps	Pump A B.Conc	5	
25.00	Pumps	Pump A B.Conc	65	
25.01	Pumps	Pump A B.Conc	95	
31.00	Pumps	Pump A B.Conc	95	
31.01	Pumps	Pump A B.Conc	5	
40.00	Pumps	Pump A B.Conc	5	
40.01	Controller	Stop		

<<Column Performance>>

<Detector A>

Column : Inertsil ODS-3 4.6 x 250 mm

Chromatogram

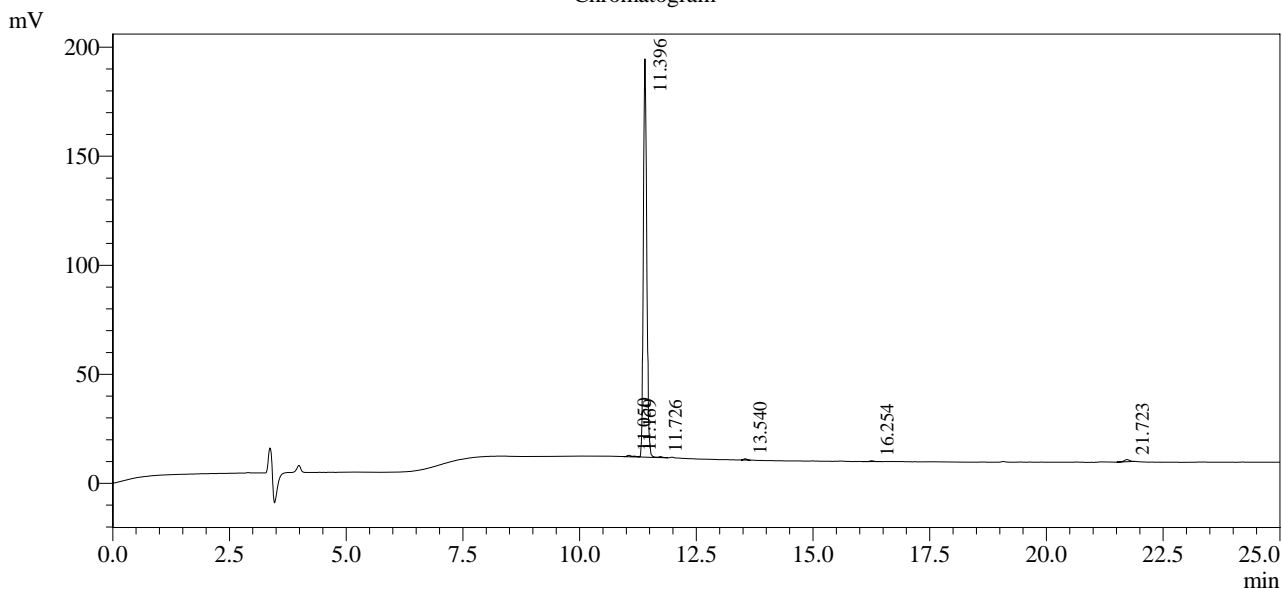

1 Det.A Ch1 / 220nm

Peak Table

Detector A Ch1 220nm

Peak#	Ret. Time	Area	Height	Area %
1	11.050	3779	638	0.401
2	11.169	1681	344	0.178
3	11.396	921935	182691	97.812
4	11.726	2680	501	0.284
5	13.540	2683	582	0.285
6	16.254	1978	362	0.210
7	21.723	7819	980	0.830
Total		942555	186098	100.000