


Mass Spectrum

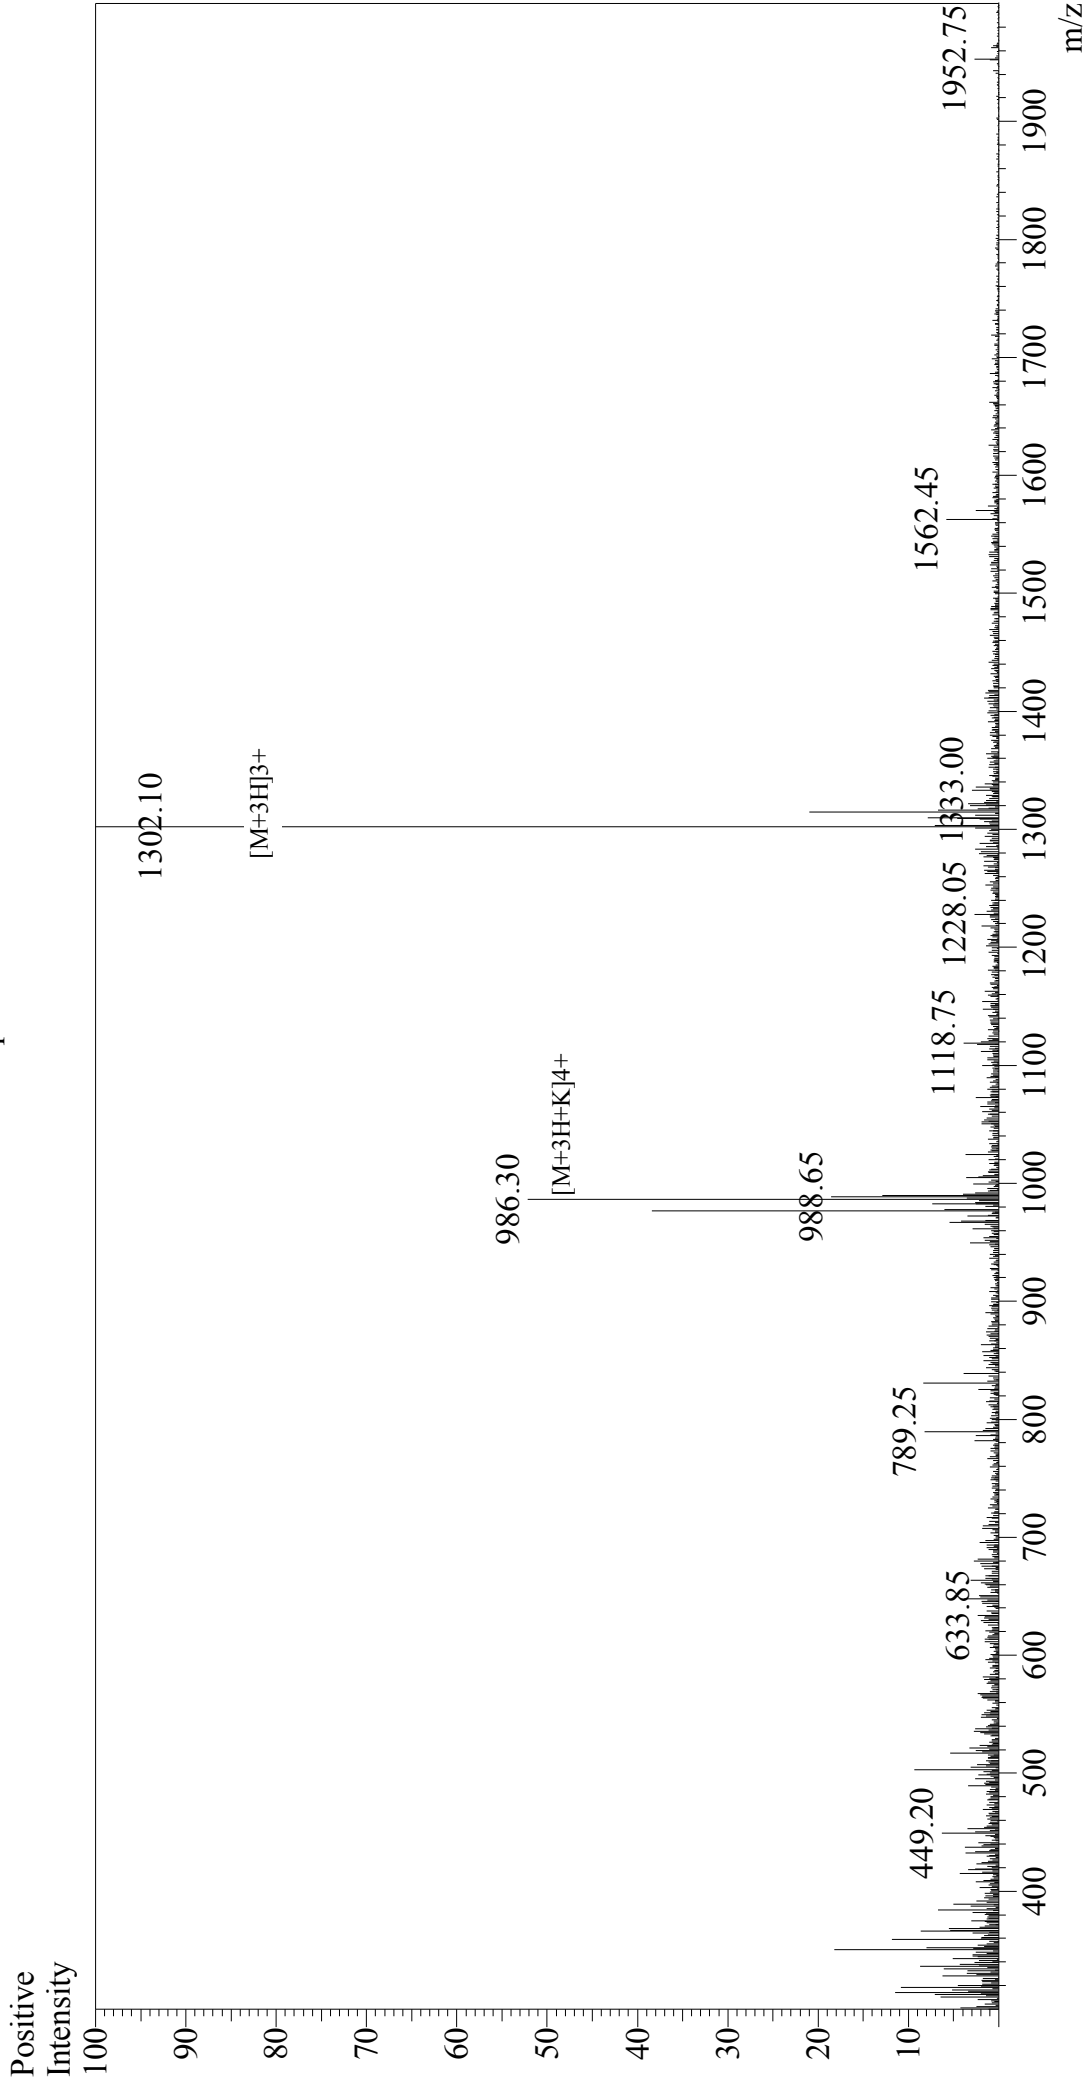

Sample Information

Acquired by: Gary
 Month-Day Processed: 01/13/17
 Time Processed: 14:01:02
 Injection Volume: 1
 Sample Name: Amylin, human, amide
 Cat. No.: RP11278
 Lot. No.: PE4801611
 Theoretical MW: 3903.40
 Observed MW: 3903.30

Interface: ESI
 Nebulizing Gas Flow: 1.5L/min
 CDL Temp: 250°C
 Block Temp: 200°C

Interface Bias: +4.5 kV
 Drying Gas Flow: 5 L/min
 T.Flow: 0.2 ml/min
 B.conc: 50%H2O/50%MeOH