

Sample Name : Syntide 2
 Cat. No. : RP10322
 Lot. No. :PE1651611

Pump A : 0.065% trifluoroacetic in 100% water (v/v)
 Pump B : 0.05% trifluoroacetic in 100% acetonitrile (v/v)
 Total Flow:1 ml/min
 Wavelength:220 nm


Time	Unit	Command	Value	Comment
0.01	Pumps	Pump B Conc.	5	
25.00	Pumps	Pump B Conc.	65	
25.01	Pumps	Pump B Conc.	95	
31.00	Pumps	Pump B Conc.	95	
31.01	Pumps	Pump B Conc.	5	
40.00	Pumps	Pump B Conc.	5	
40.01	Controller	Stop		

<<Column Performance>>

<Detector A>

Column : Alltima™ C18 4.6 x 250 mm

Chromatogram

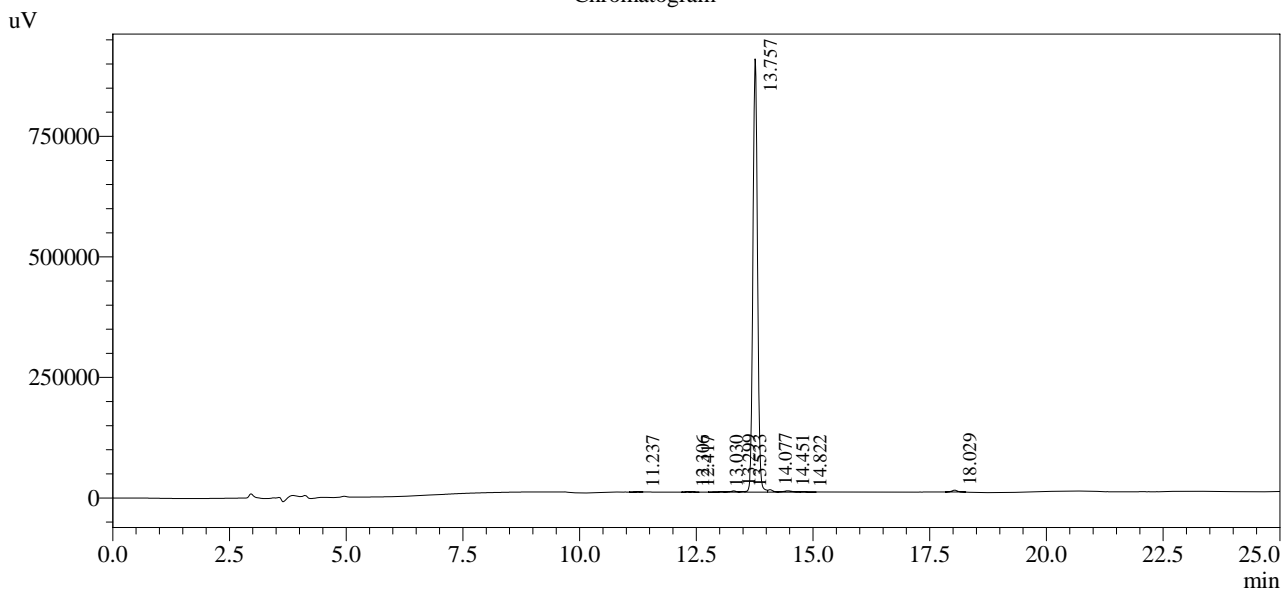

1 Det.A Ch1 / 220nm

Peak Table

Detector A Ch1 220nm

Peak#	Ret. Time	Area	Height	Area %
1	11.237	1543	354	0.024
2	12.306	5536	1039	0.087
3	12.417	4700	886	0.074
4	13.030	11626	1215	0.182
5	13.299	26744	2702	0.420
6	13.533	8761	1411	0.137
7	13.757	6188762	898677	97.098
8	14.077	39418	5257	0.618
9	14.451	44397	2919	0.697
10	14.822	10770	1222	0.169
11	18.029	31488	3693	0.494
Total		6373744	919375	100.000