


Mass Spectrum

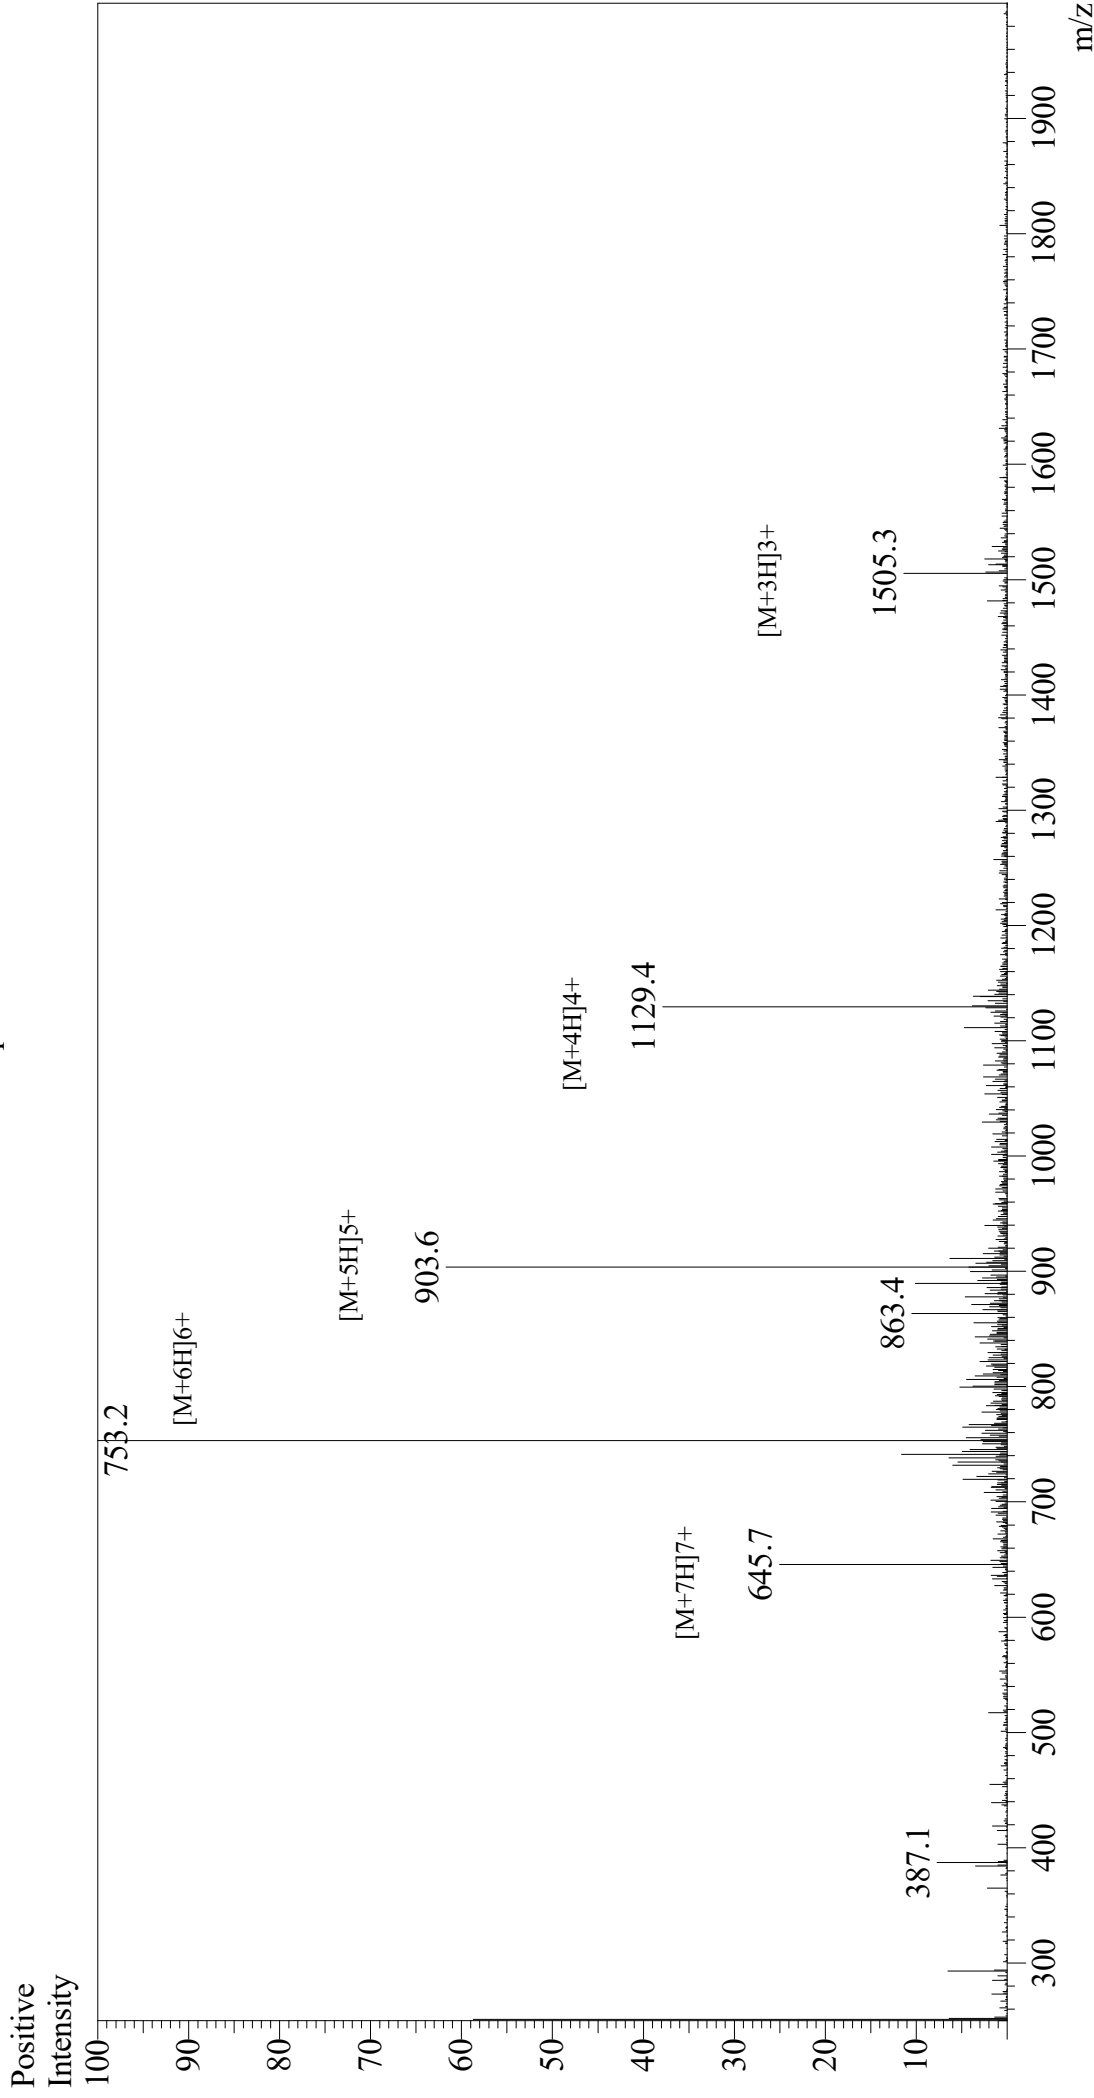

Sample Information
Month-Day Processed : 01/11/21
Time Processed : 1:23:58 PM
Injection Volume : 0.4
Sample Name : β -Amyloid (1-42), human
Cat No. : RP10017
Lot No. : E1999921A
Theoretical MW : 4514.10
Observed MW : 4513.2

Interface : ESI
Nebulizing Gas Flow : 1.5L/min
CDL Temp : 250
Block Temp : 200

Equipment : GK11010007
Interface Bias : +3.5 kV
Drying Gas Flow : 5 L/min
T.Flow : 0.2 ml/min
B.conc : 50%H₂O/50%MeOH