


Mass Spectrum

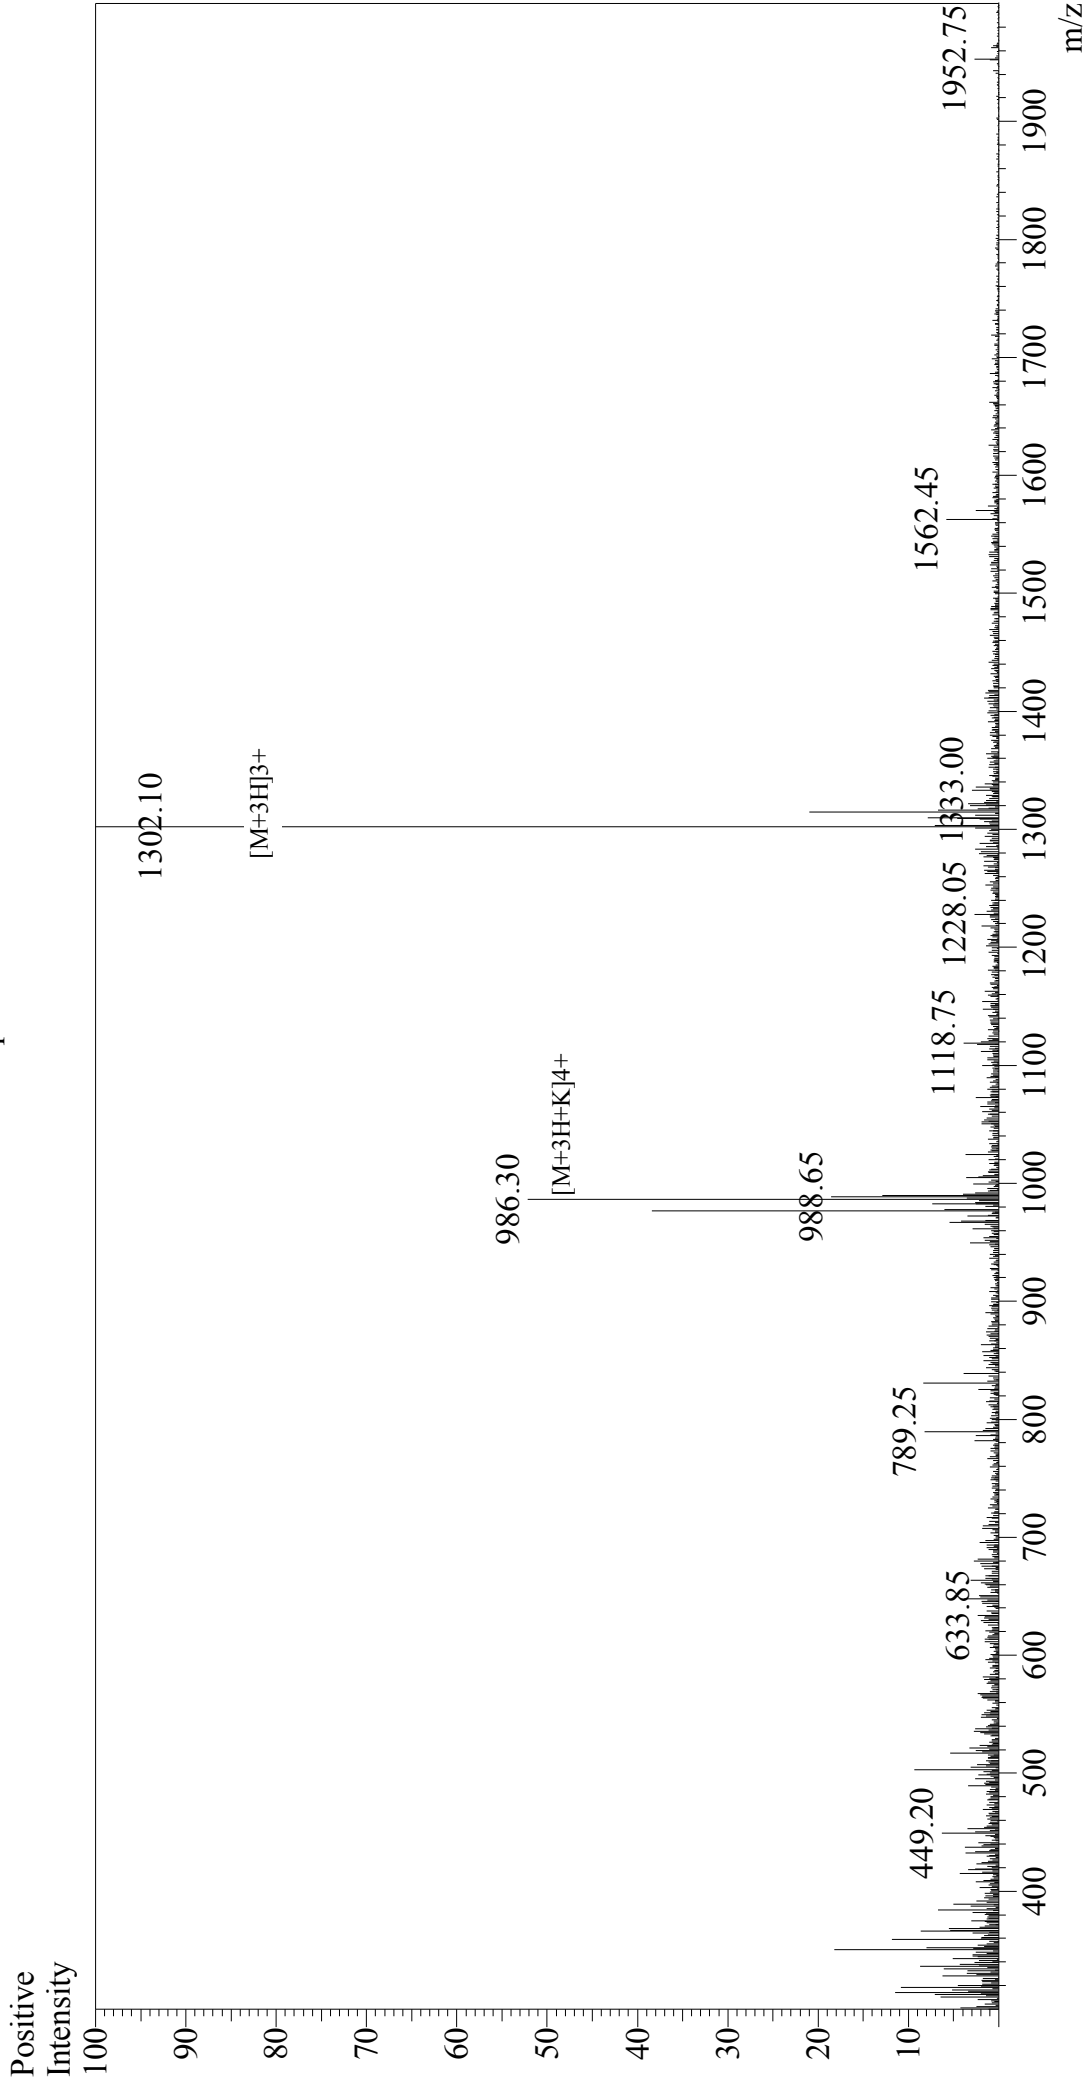

Sample Information

Acquired by : Gary
 Month-Day Processed : 01/13/17
 Time Processed : 14:01:02
 Injection Volume : 1
 Sample Name : Amylin, human, amide
 Cat. No. : RP11278
 Lot. No. : PE7341608
 Theoretical MW : 3903.40
 Observed MW : 3903.30

Interface : ESI
 Nebulizing Gas Flow : 1.5L/min
 CDL Temp : 250°C
 Block Temp : 200°C

Interface Bias : +4.5 kV
 Drying Gas Flow : 5 L/min
 T.Flow : 0.2 ml/min
 B.conc : 50%H2O/50%MeOH