


Mass Spectrum

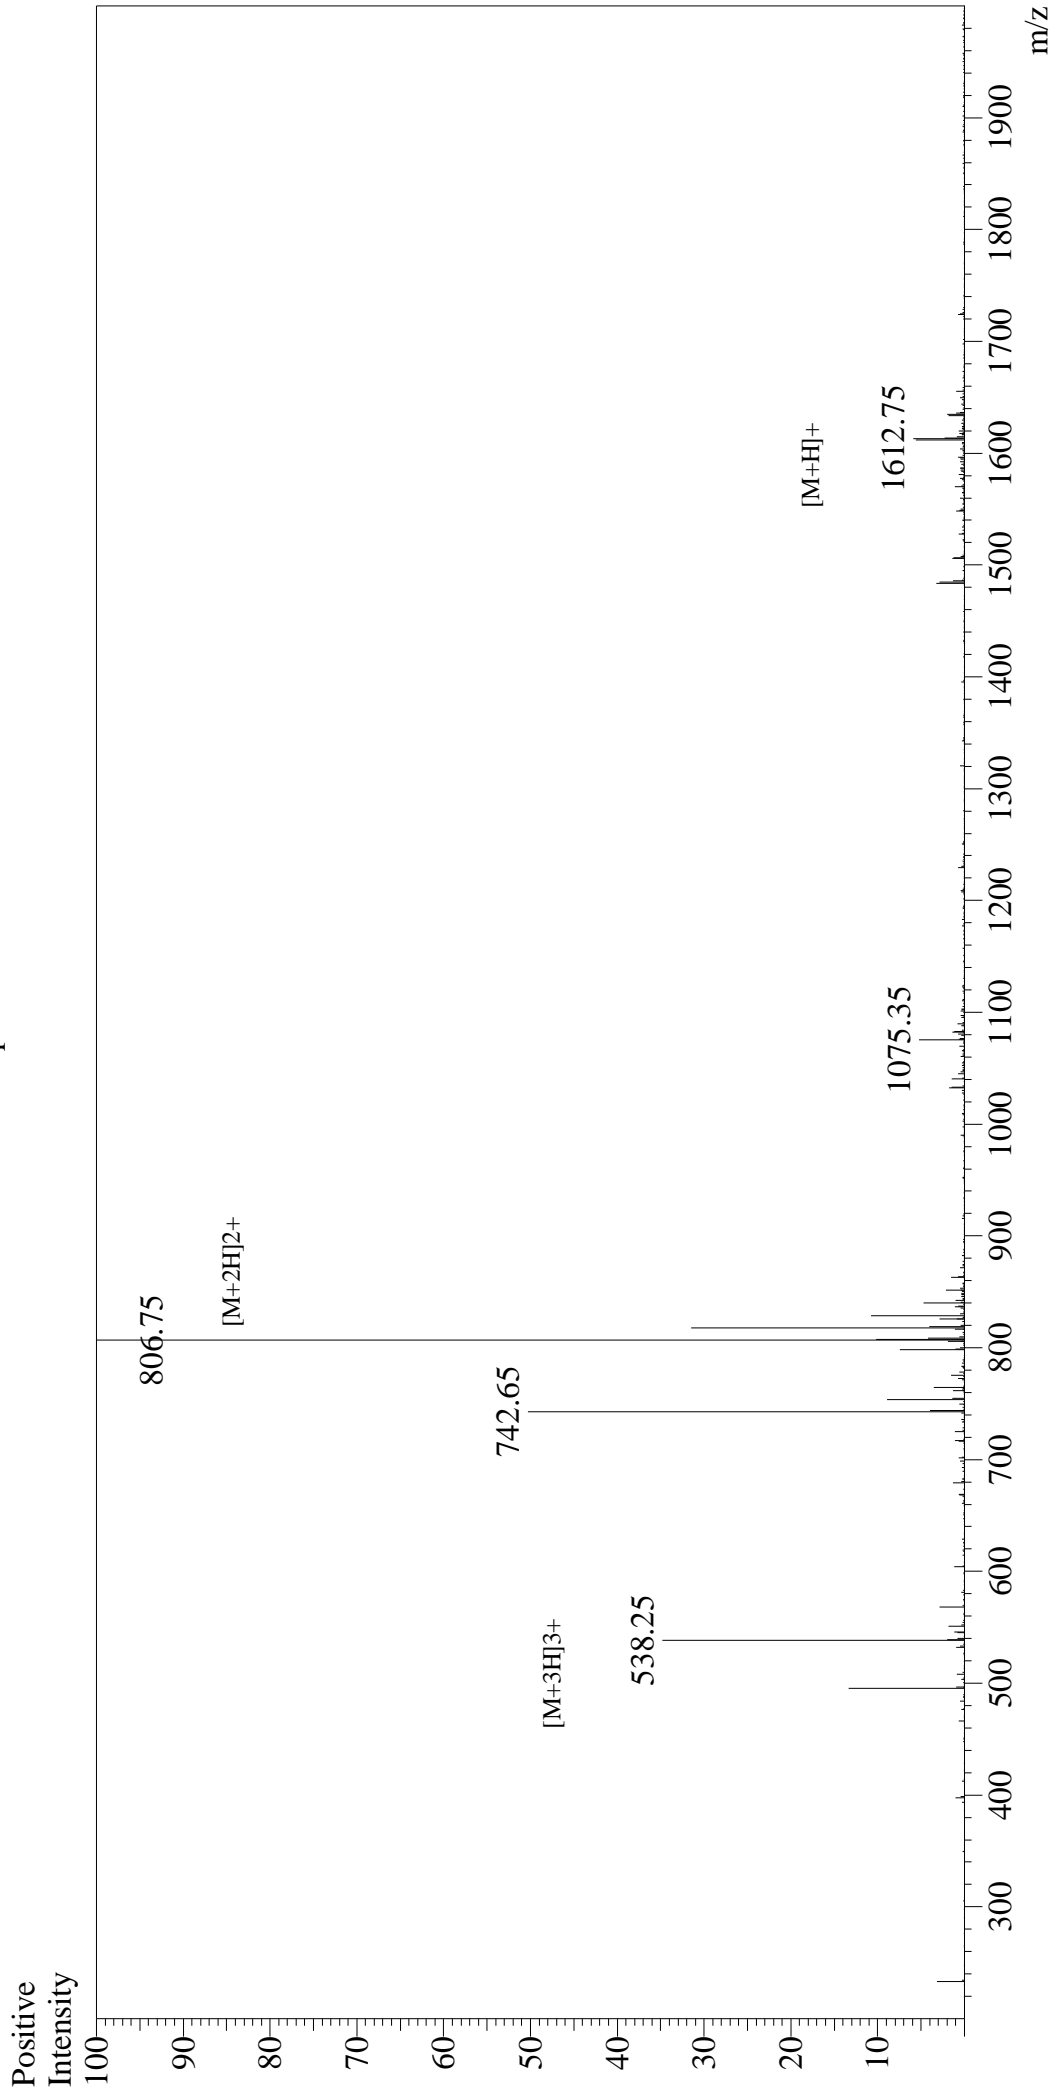

Sample Information

User : Gary
Month-Day Processed : 07/07/16
Time Processed : 7:48:26
Injection Volume : 0.2
Sample Name : Tetanus toxin (830-843)
Cat No. : RPI9980
Lot No. : PE1441606
Theoretical MW : 1611.84
Observed MW : 1611.50

Interface : ESI
Nebulizing Gas Flow : 1.5L/min
CDL Temp : 250°C
Block Temp : 200°C

Interface Bias : +4.5kV
Drying Gas Flow : 5 L/min
T.Flow : 0.2ml/min
B.conc : 50%H2O/50%MeOH