


Mass Spectrum

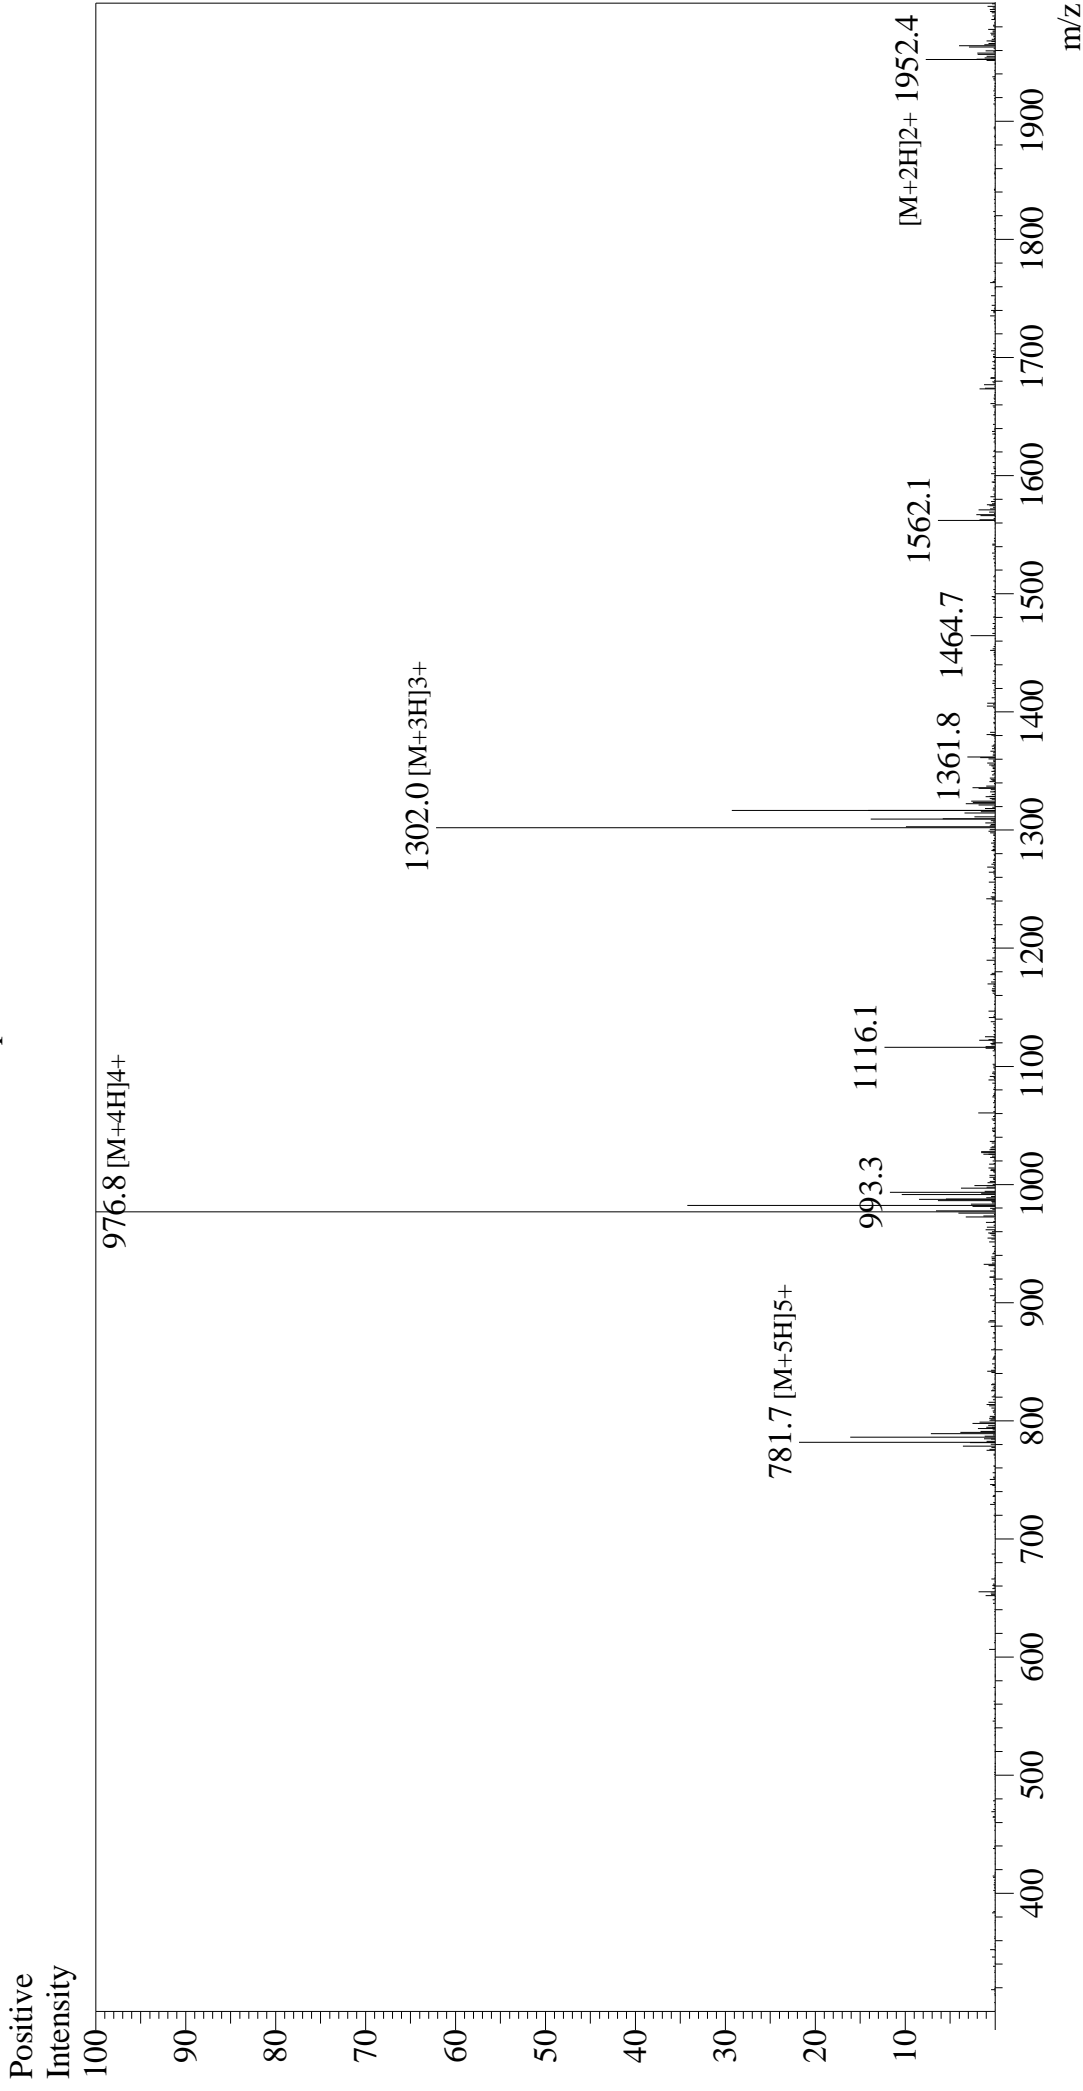

Sample Information

Month-Day Processed : 12/06/23
 Time Processed : 15:46:05
 Injection Volume : 0.2
 Sample Name : Amylin, human, amide
 Cat No. : RP11278
 Lot No. : E0043523L
 Theoretical MW : 3903.28
 Observed MW : 3903.2

Interface : ESI
 Nebulizing Gas Flow : 1.5L/min
 CDL Temp : 250
 Block Temp : 200

Equipment : Z117010408
 Interface Bias : +4.5 kV
 Drying Gas Flow : 5 L/min
 T.Flow : 0.2 ml/min
 B.conc : 50% H₂O/50% MeOH