
Mass Spectrum

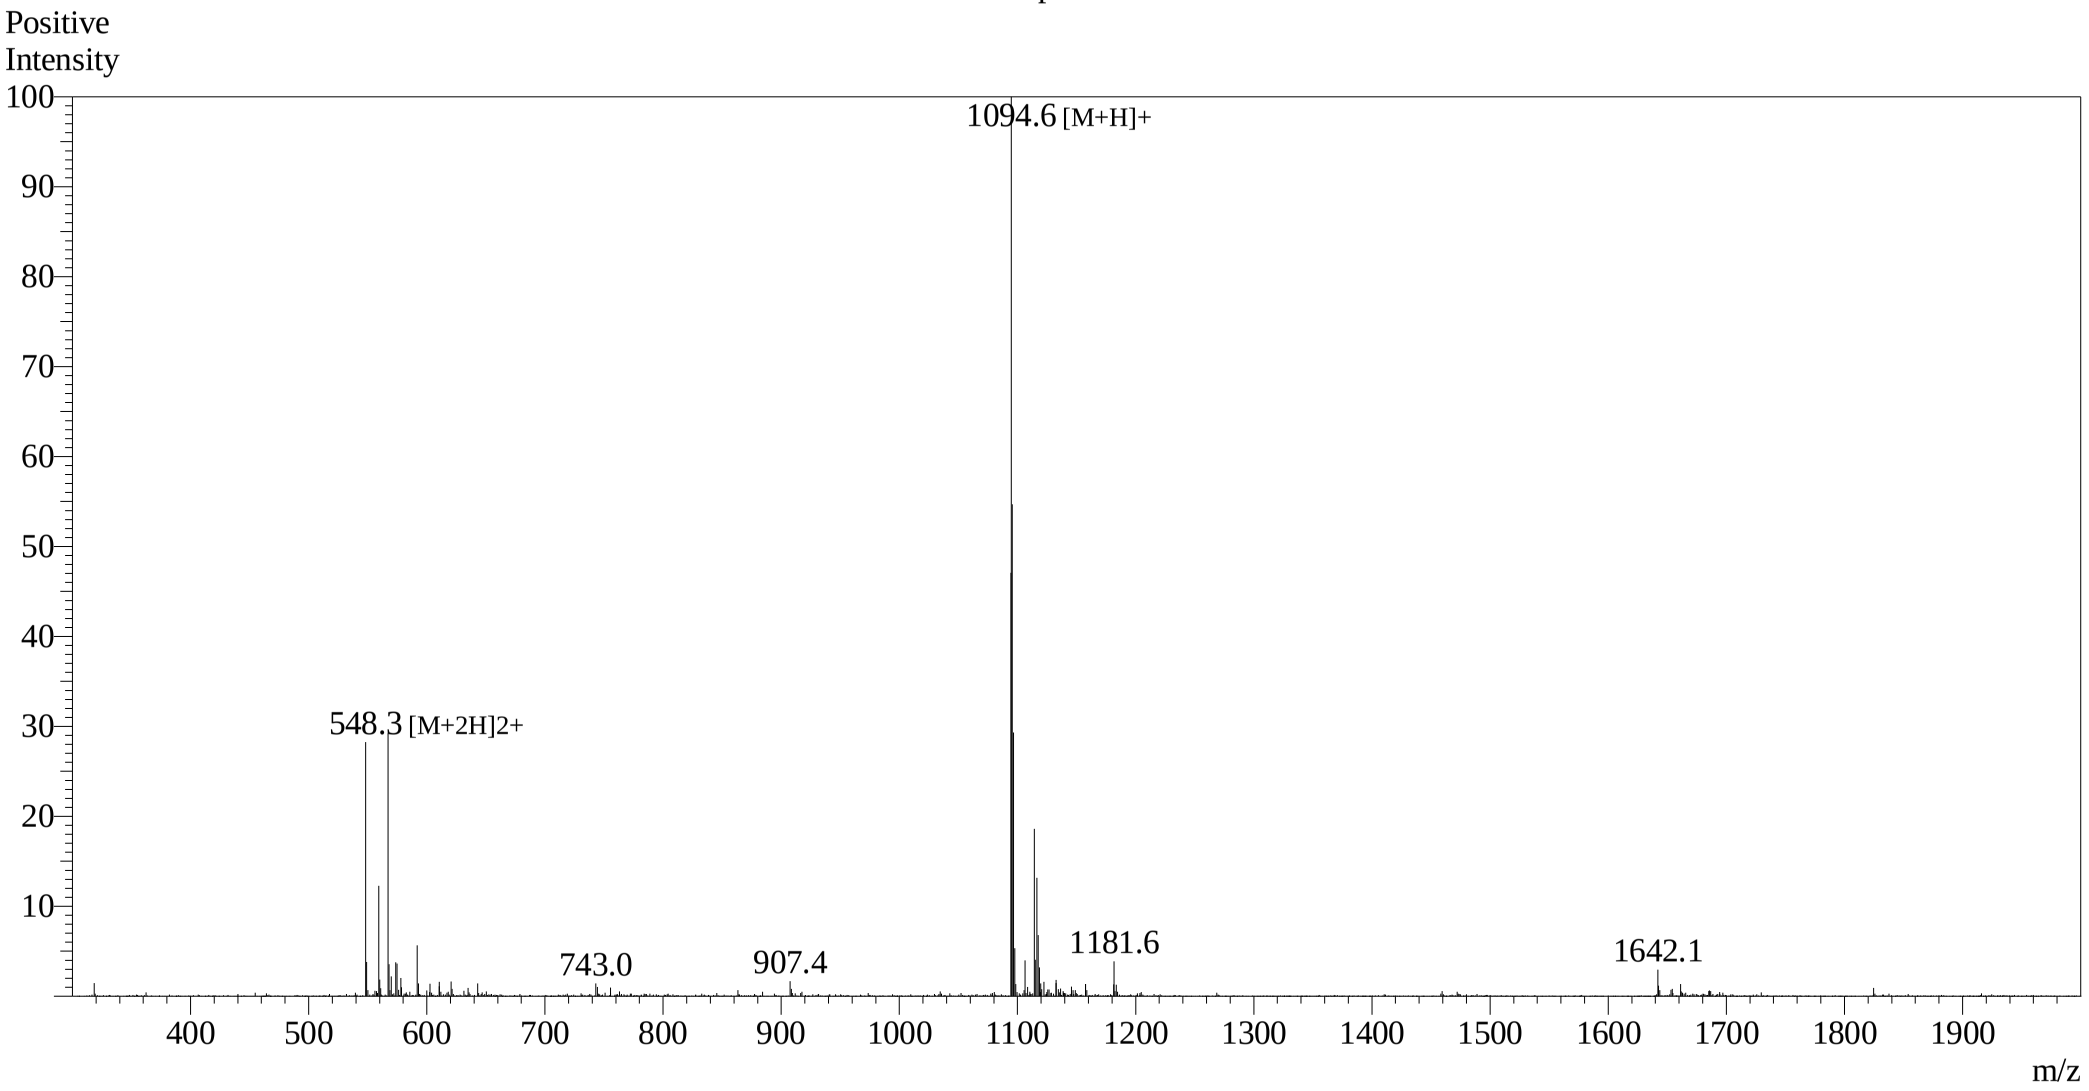

Sample Information
Month-Day Processed : 02/23/26
Time Processed : 11:35:37 AM
Injection Volume : 0.3
Sample Name : NY-ESO-1 Peptide (SLLMWITQC)
Cat No. :RP30225
Lot No. :E1275626B
Theoretical MW : 1094.35
Observed MW : 1093.6

Interface :ESI
Nebulizing Gas Flow :1.5L/min
CDL Temp :250
Block Temp :200

Equipment :ZJ22010150
Interface Bias : +4.5 kV
Drying Gas Flow :5 L/min
T.Flow :0.2 ml/min
B.conc :50%H2O/50%MeOH