


Mass Spectrum

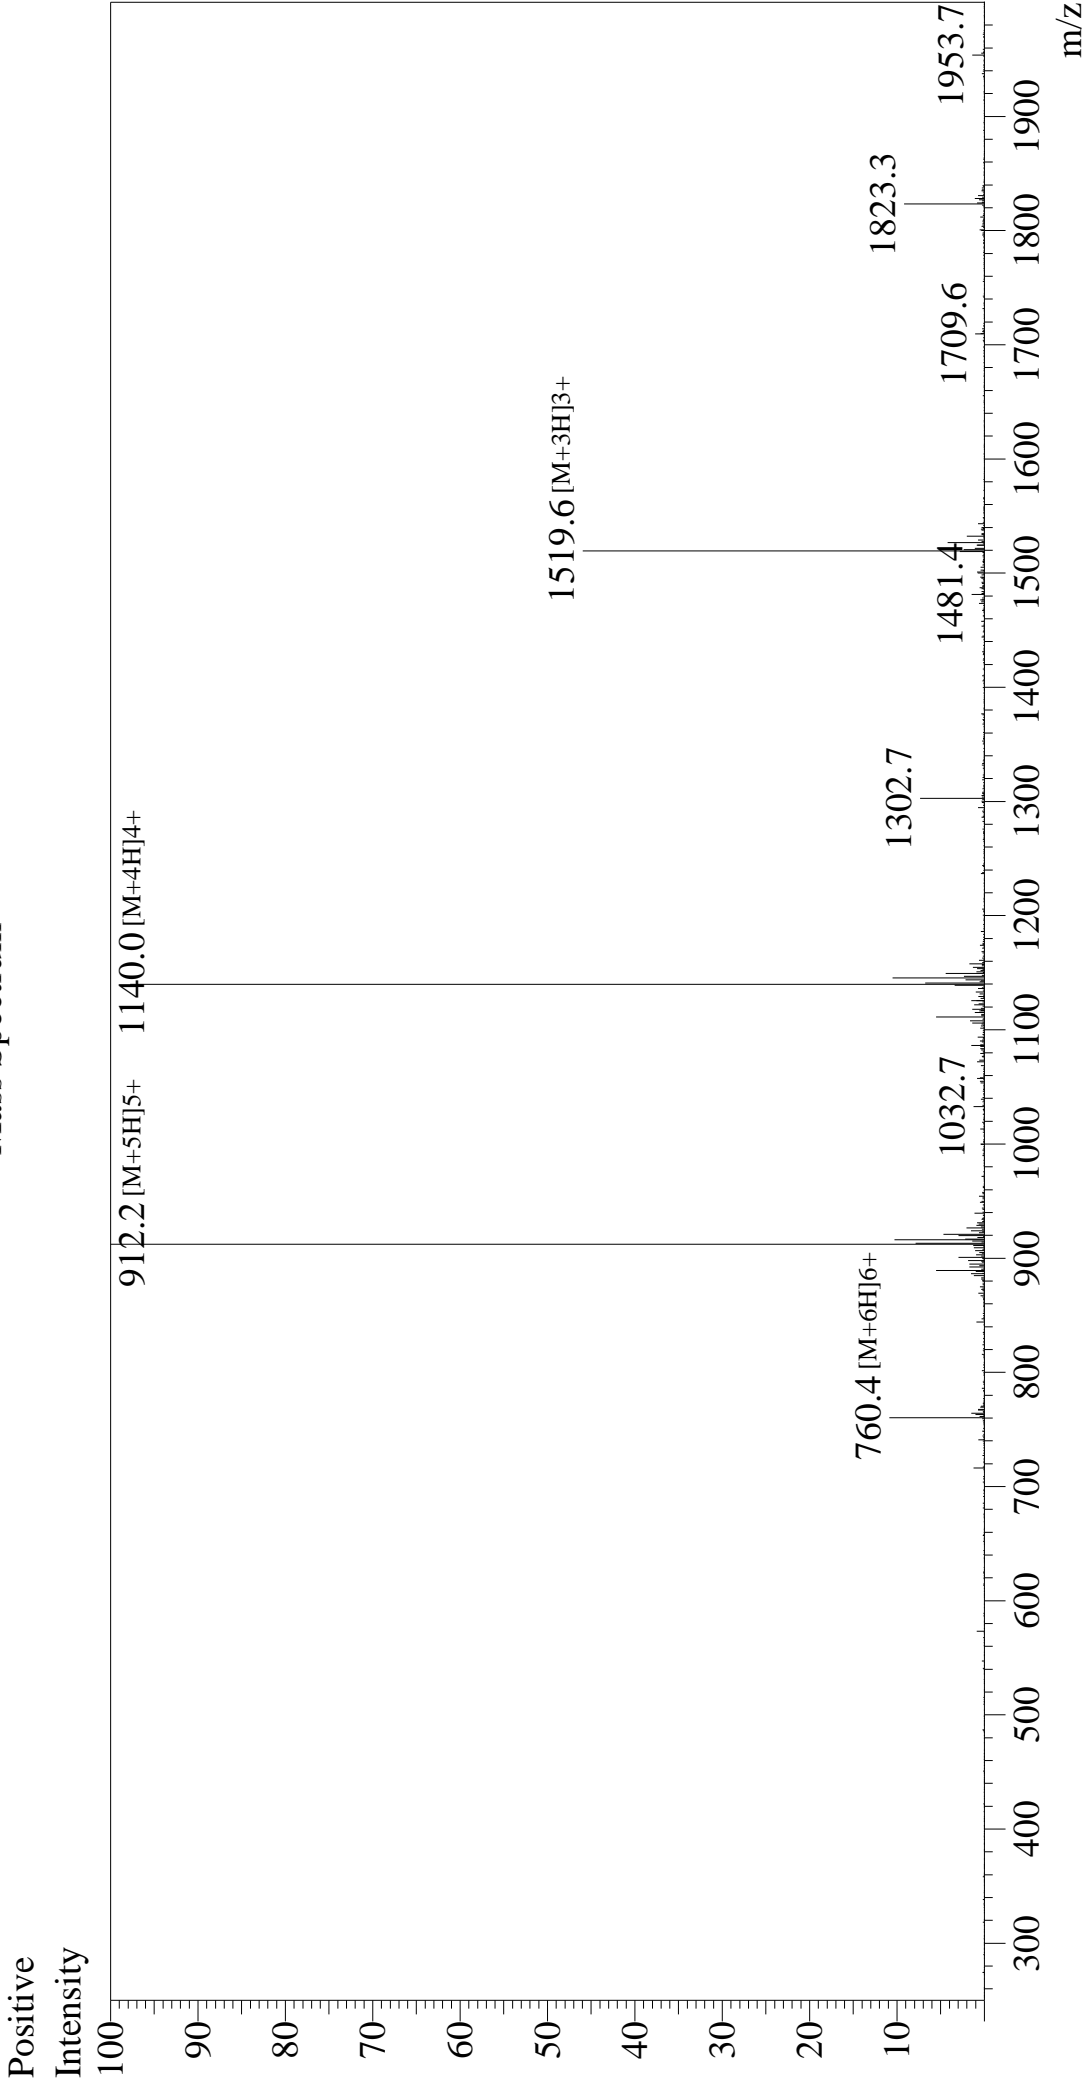

Sample Information
Month-Day Processed : 03/04/26
Time Processed : 8:33:01
Injection Volume : 0.5
Sample Name : Biotin- β -Amyloid (1-40)
Cat No. : RP30249
Lot No. : E1280426B
Theoretical MW: 4556.12
Observed MW : 4556.0

Interface : ESI
Nebulizing Gas Flow : 1.5 L/min
CDL Temp : 250
Block Temp : 200

Equipment : ZJ22010150
Interface Bias : +4.5 kV
Drying Gas Flow : 5 L/min
T.Flow : 0.2 ml/min
B.conc : 50% H₂O/50% MeOH