


Mass Spectrum

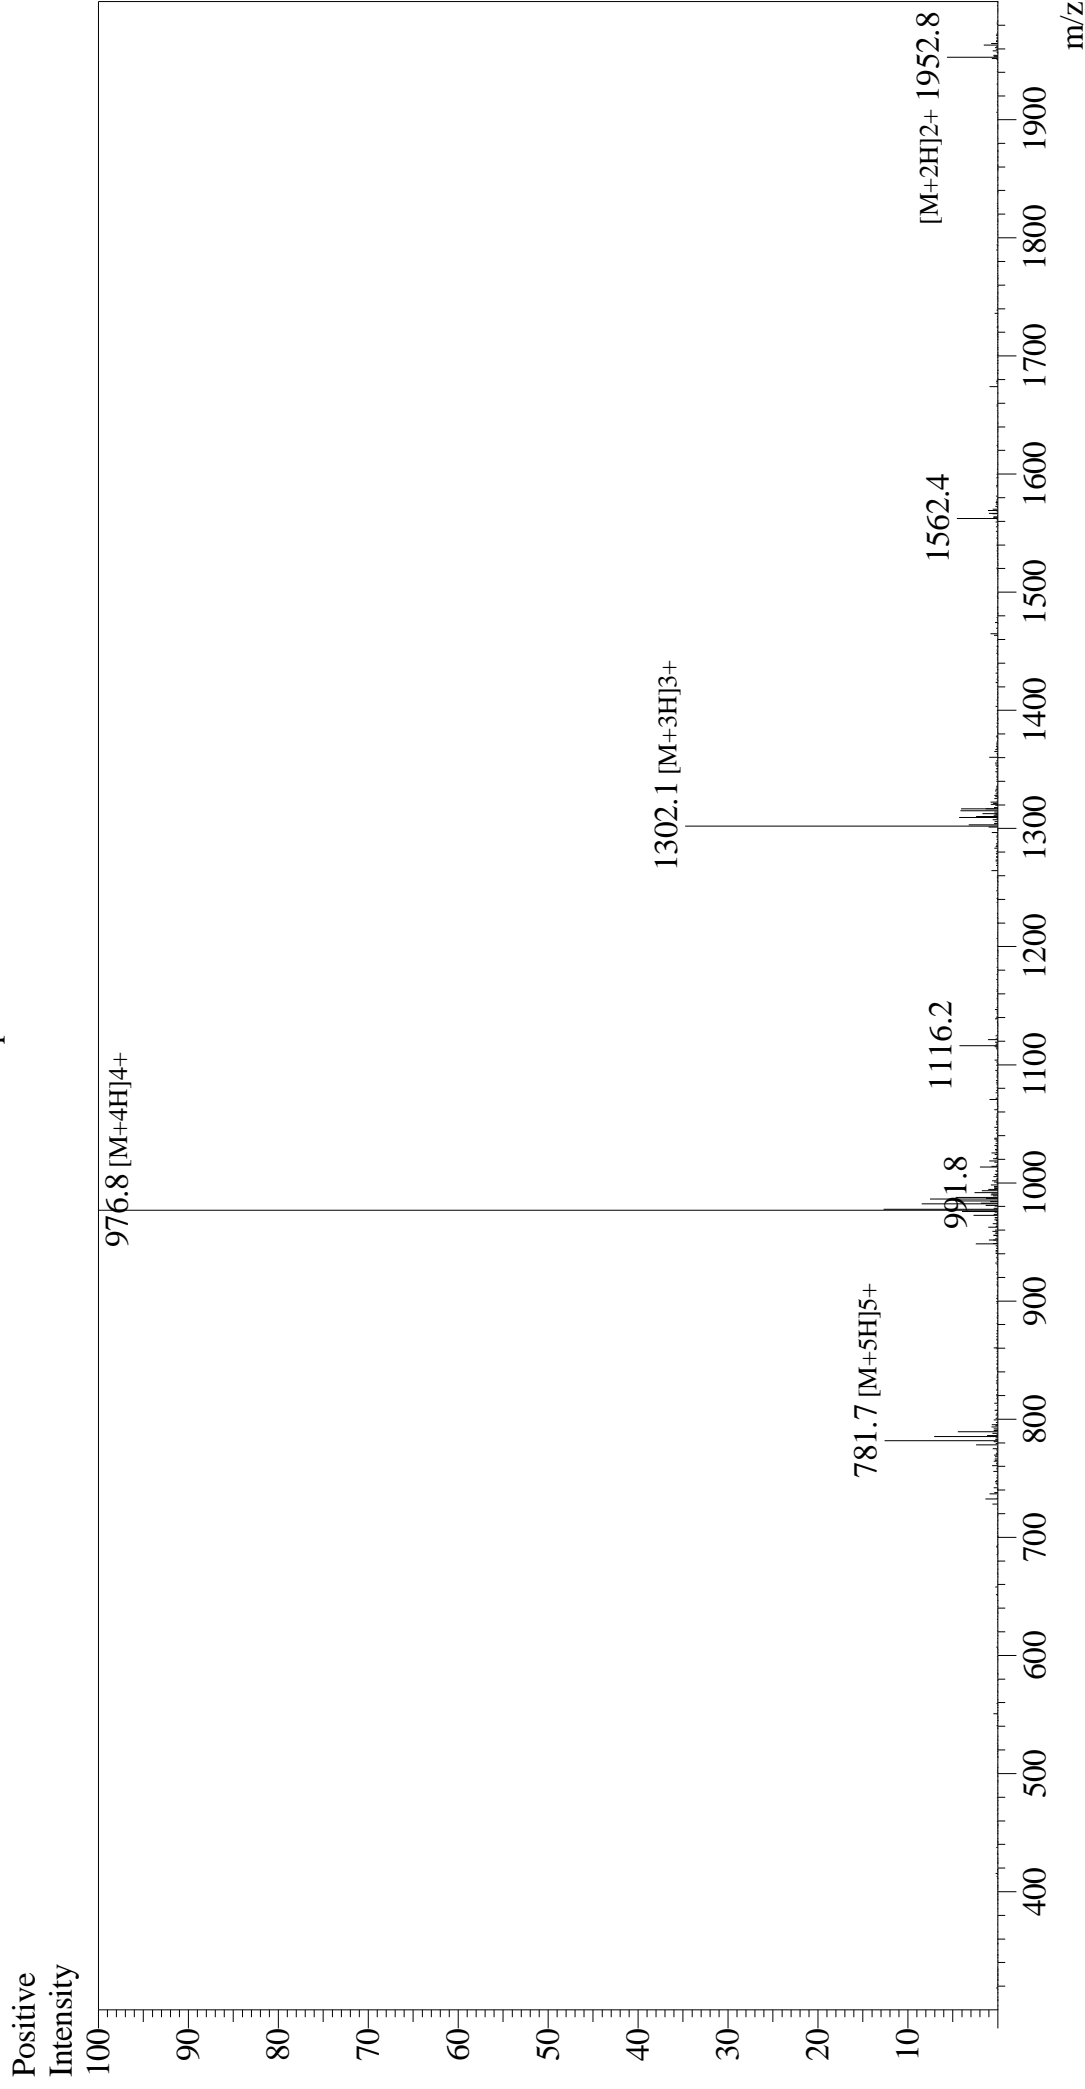

Sample Information

Month-Day Processed : 02/01/25
 Time Processed : 7:39:28
 Injection Volume : 0.4
 Sample Name : Amylin, human, amide
 Cat No. : RP11278
 Lot No. : E1488325A
 Theoretical MW : 3903.28
 Observed MW : 3903.2

Interface :ESI

Nebulizing Gas Flow :1.5L/min
 CDL Temp :250
 Block Temp :200

Equipment : ZJ21010035

Interface Bias : +4.5 kV
 Drying Gas Flow :5 L/min
 T.Flow :0.2 ml/min
 B.conc :50%H₂O/50%MeOH