


Mass Spectrum

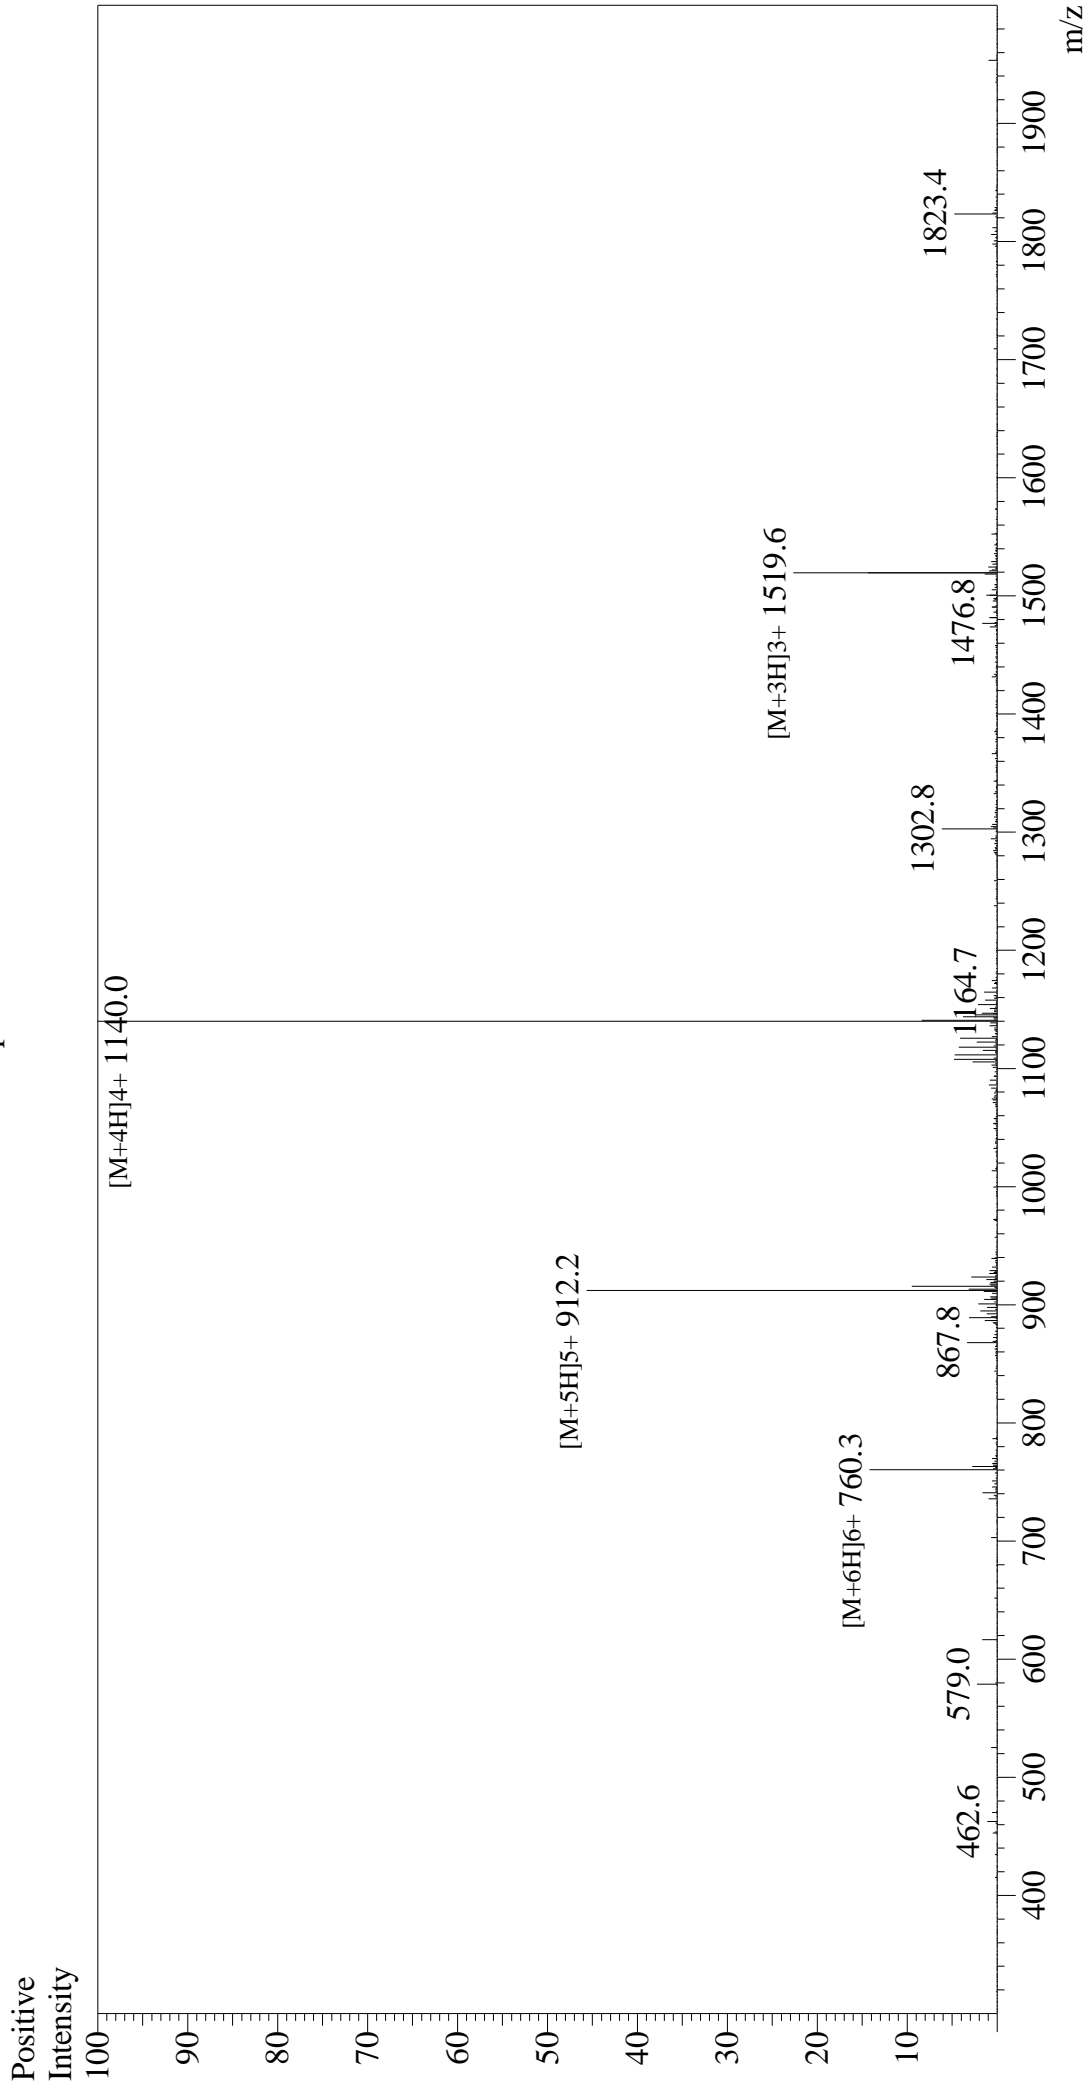

Sample Information

Month-Day Processed : 04/17/26
Time Processed : 22:22:05
Injection Volume : 0.8
Sample Name : Biotin- β -Amyloid (1-40)
Cat No. : RP30249
Lot No. : E3571526C

Theoretical MW: 4556.12

Observed MW : 4556.0

Interface

Nebulizing Gas Flow : 1.5L/min
CDL Temp : 250
Block Temp : 200

Equipment

Interface Bias
Drying Gas Flow
T.Flow
B.conc

:ZJ22010150

: +4.5 kV

: 5 L/min

: 0.2 ml/min

: 50% H₂O / 50% MeOH