


Mass Spectrum

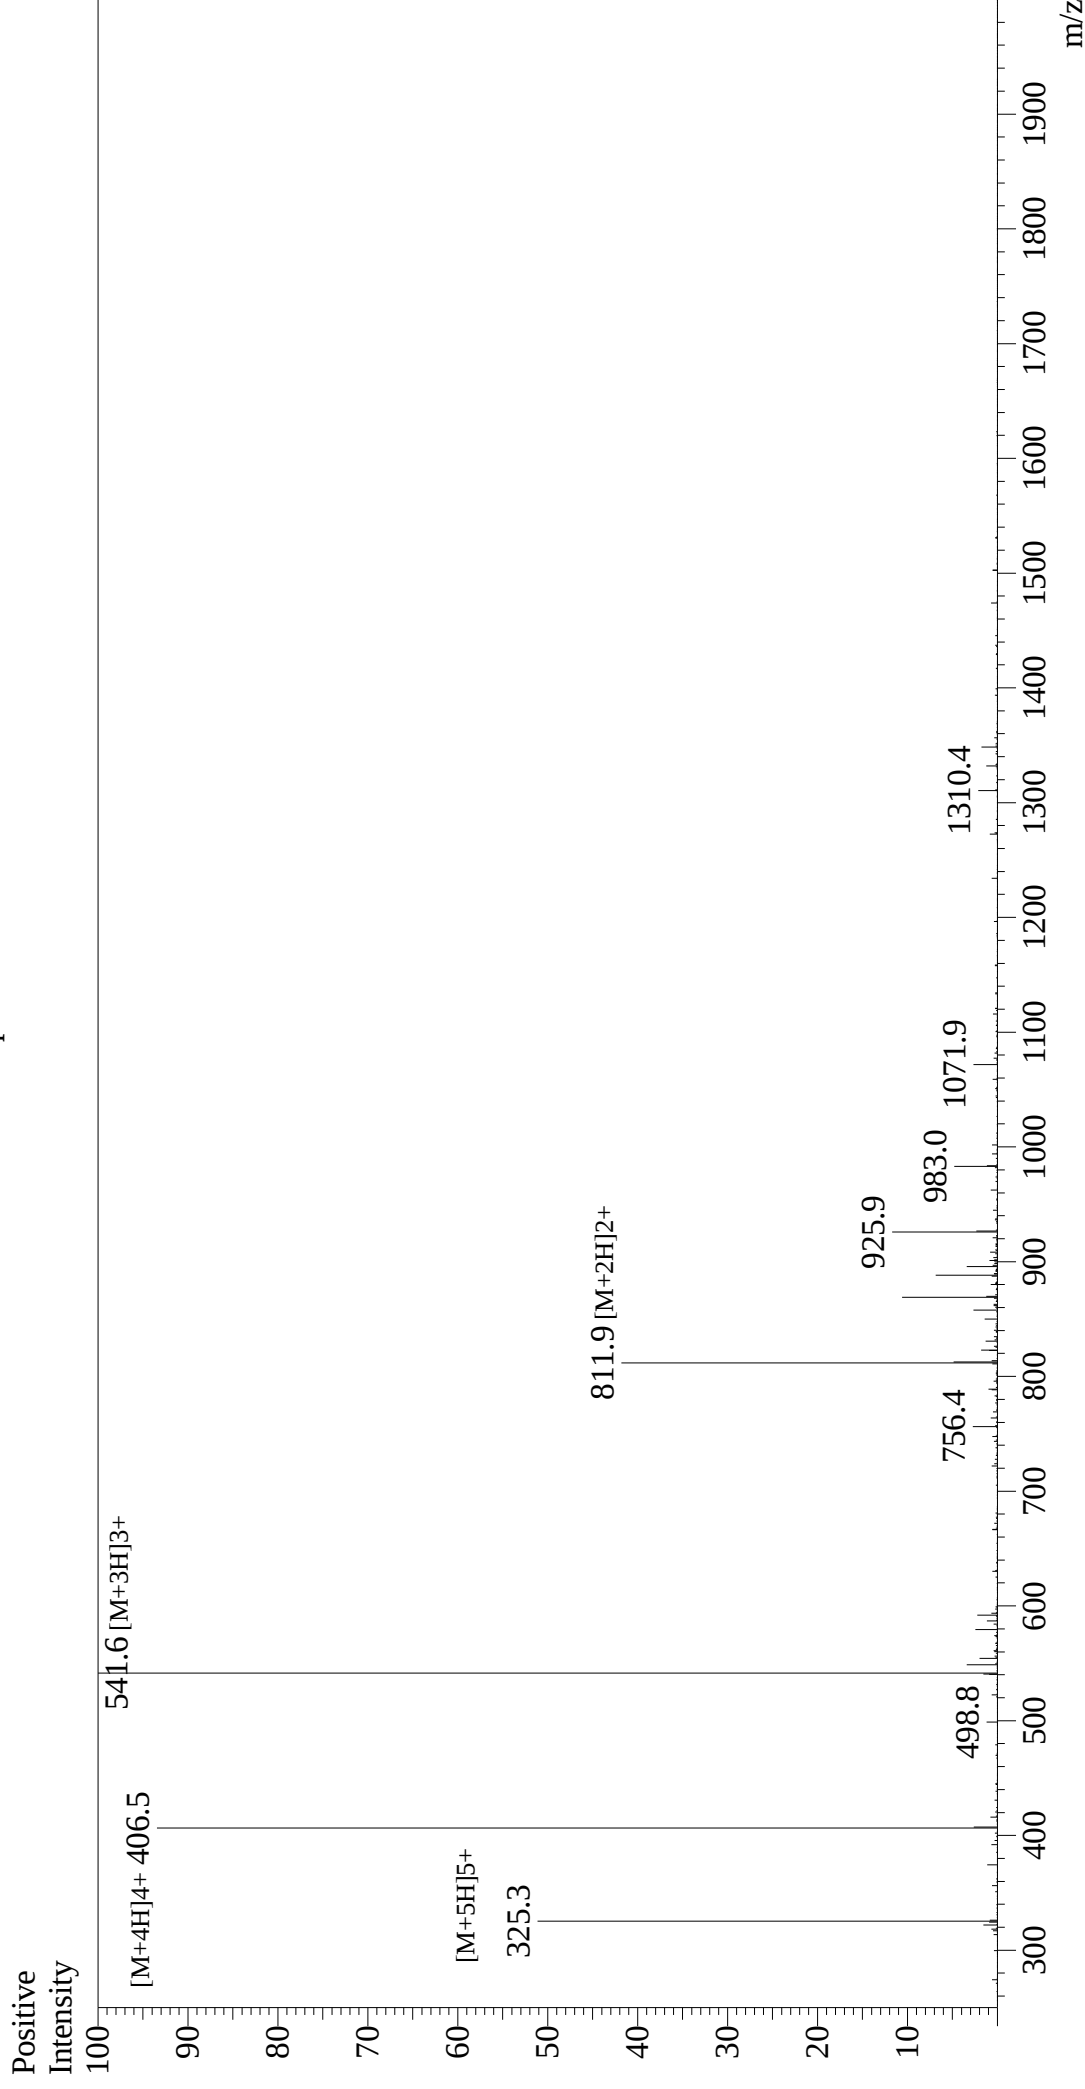

Sample Information

Month-Day Processed : 05/07/25
 Time Processed : 22:26:58
 Injection Volume : 0.2
 Sample Name : TAT peptide

Cat No. : RP20256
 Lot No. : E4076725E
 Theoretical MW: 1621.91
 Observed MW : 1621.8

Interface : ESI
 Nebulizing Gas Flow : 1.5L/min
 CDL Temp : 250
 Block Temp : 200

Equipment : ZJ21010035
 Interface Bias : +4.5 kV
 Drying Gas Flow : 5 L/min
 T.Flow : 0.2 ml/min
 B.conc : 50%H₂O/50%MeOH