


Mass Spectrum

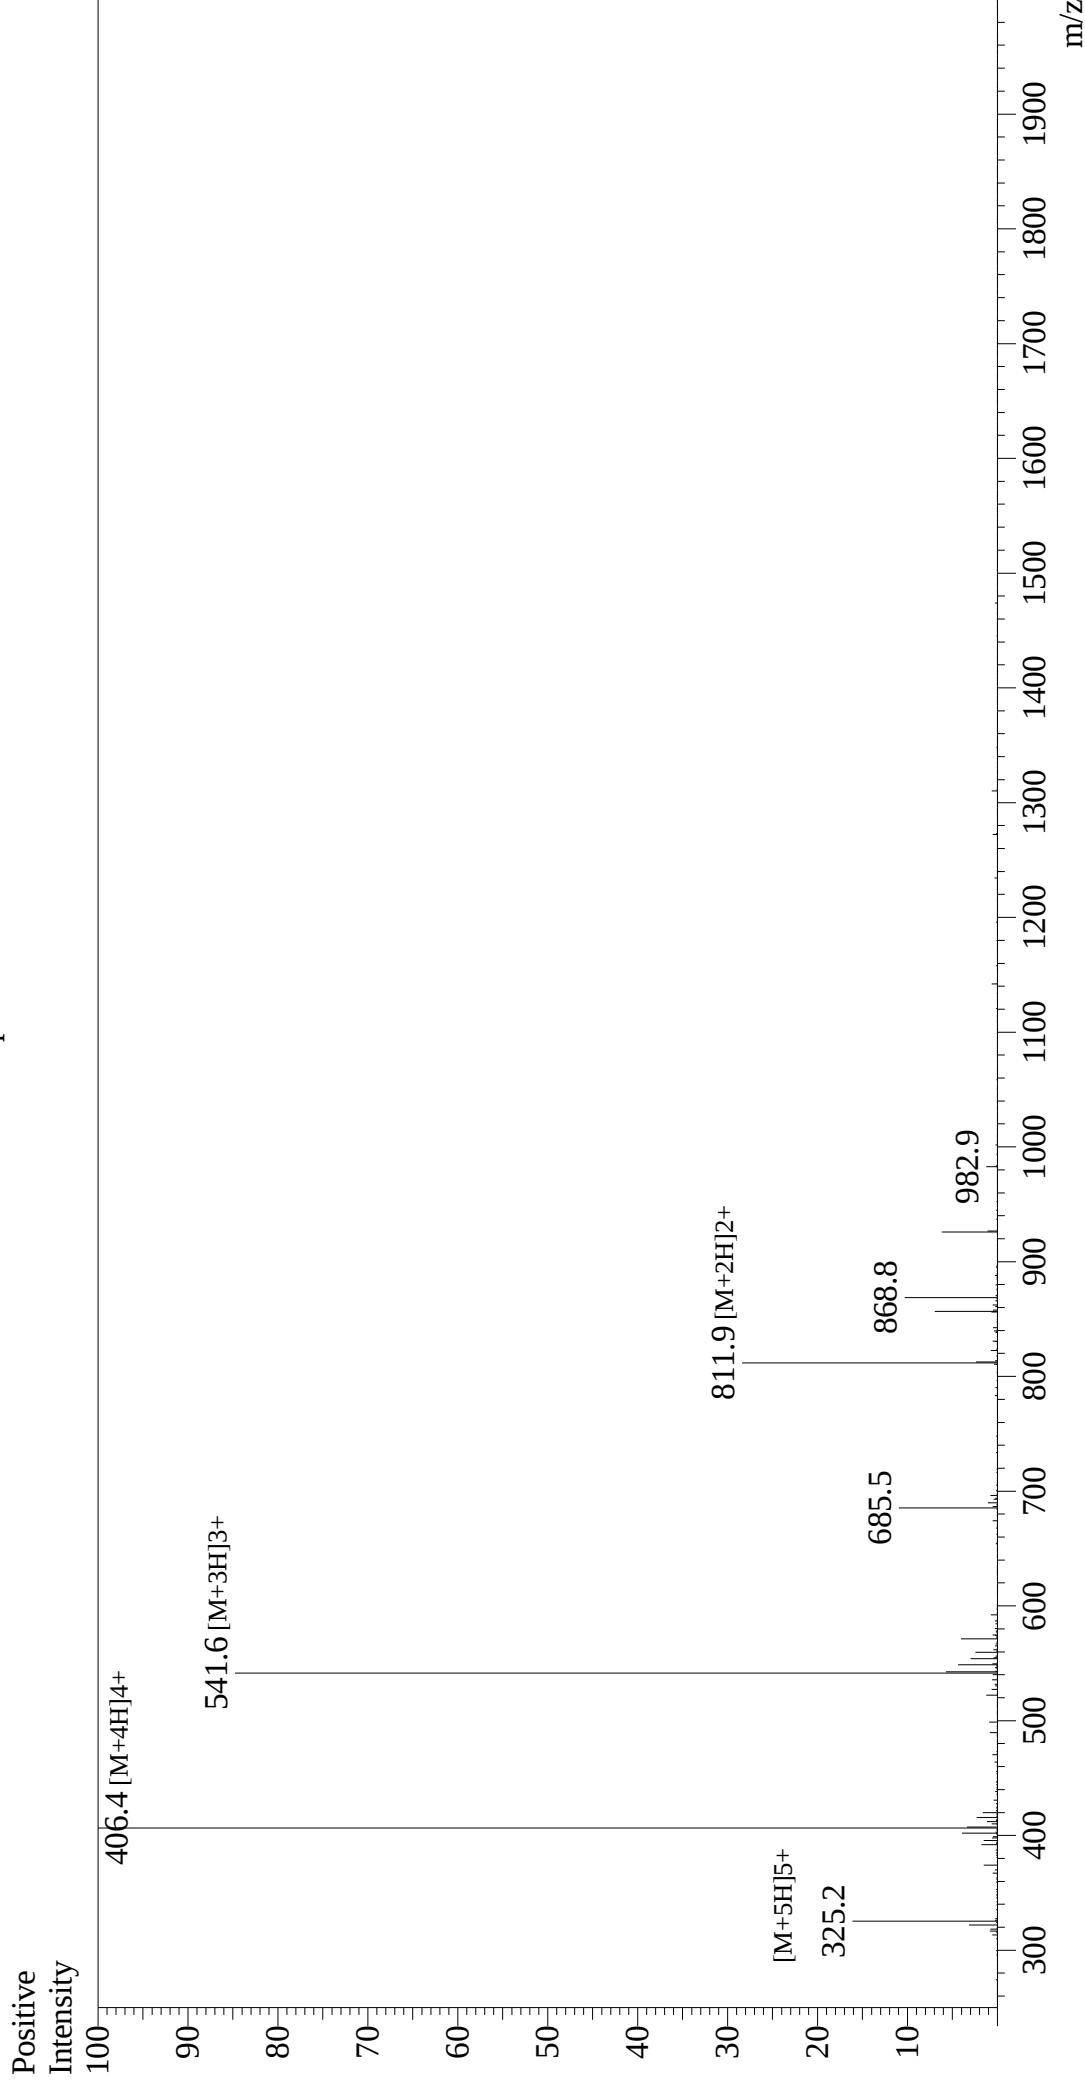

Sample Information

Month-Day Processed : 12/12/25
 Time Processed : 17:17:06
 Injection Volume : 0.3
 Sample Name : TAT peptide
 Cat No. : RP20256
 Lot No. : E4359025L
 Theoretical MW : 1621.91
 Observed MW : 1621.6

Interface

Interface : ESI
 Nebulizing Gas Flow : 1.5L/min
 CDL Temp : 250
 Block Temp : 200

Equipment

Equipment : ZJ21010035
 Interface Bias : +4.5 kV
 Drying Gas Flow : 5 L/min
 T.Flow : 0.2 ml/min
 B.conc : 50%H₂O/50%MeOH