


Mass Spectrum

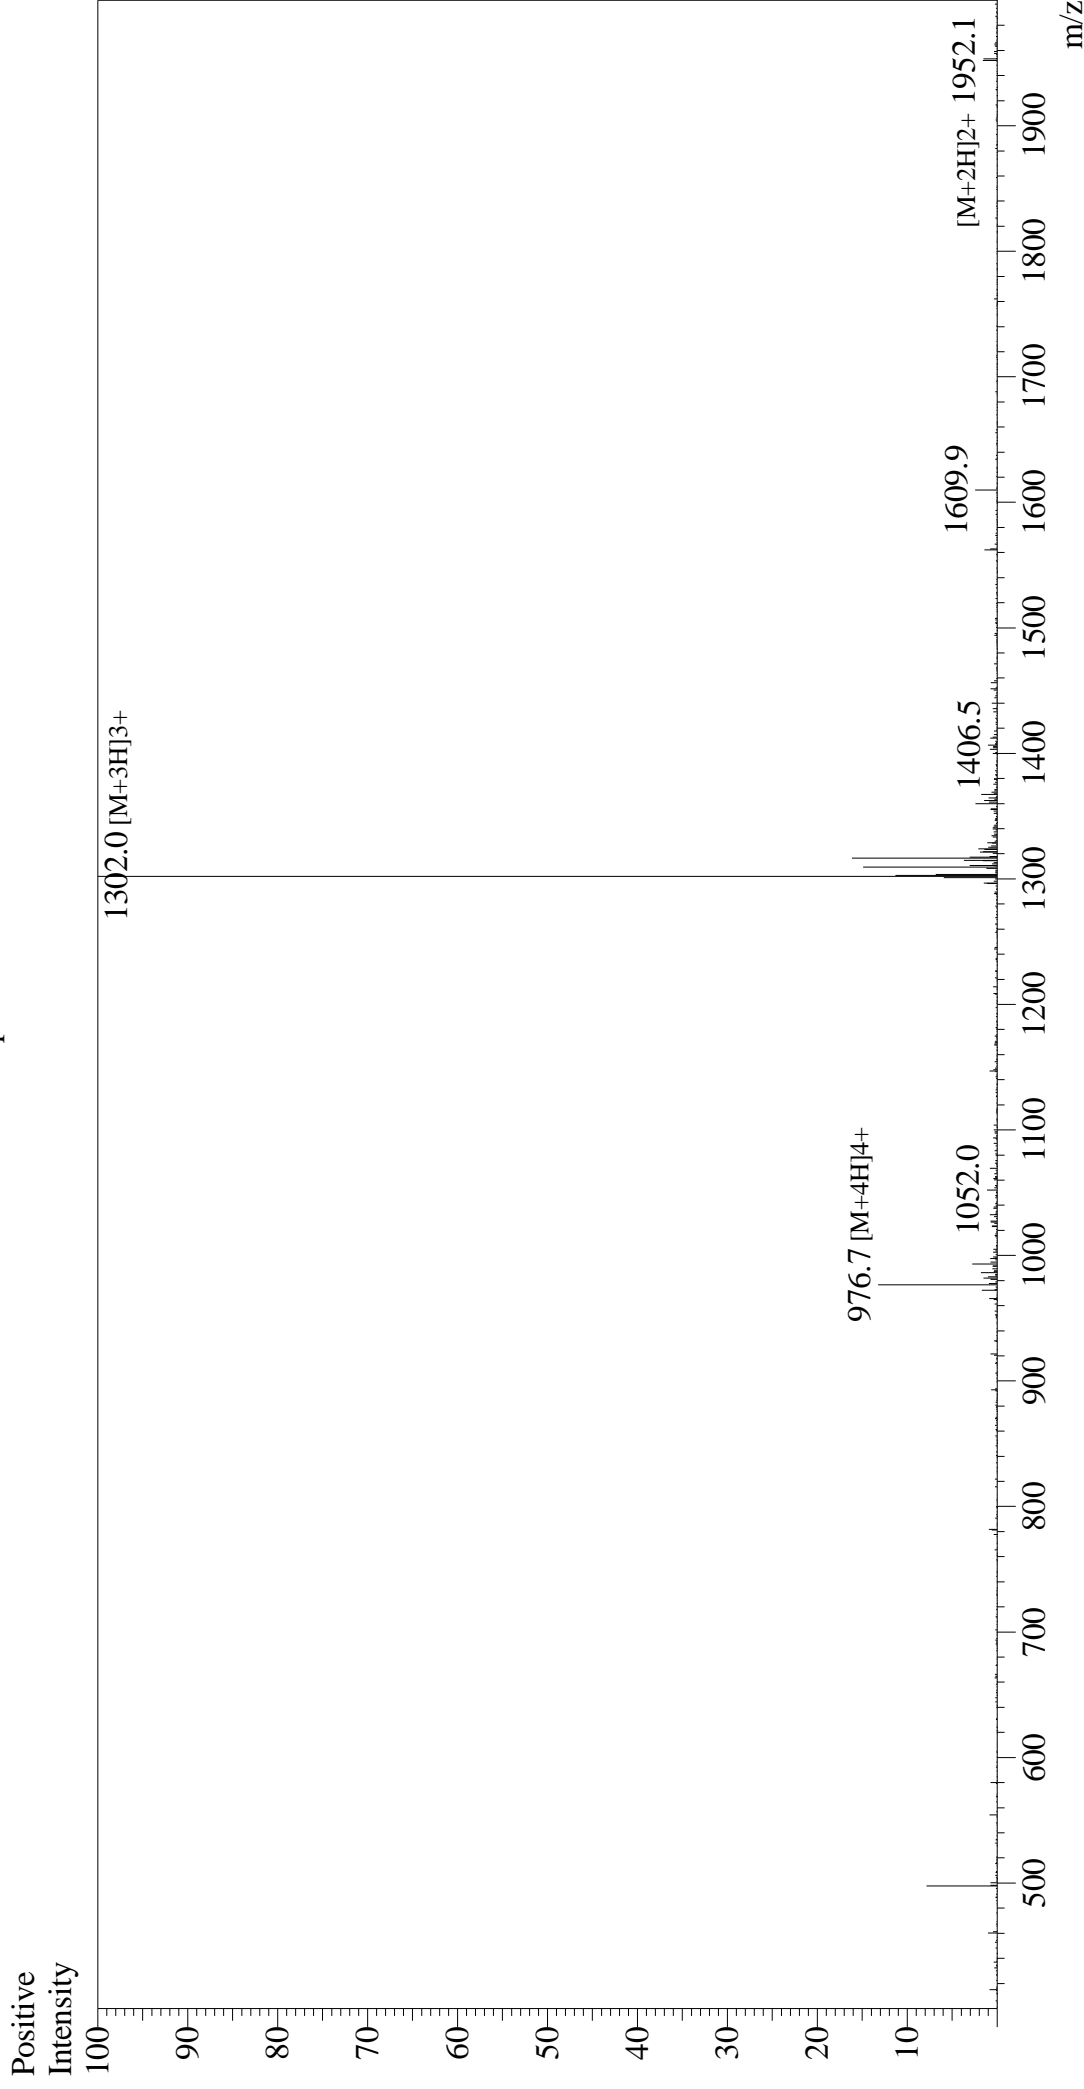

Sample Information

Month-Day Processed : 07/19/23
 Time Processed : 2:15:05 PM
 Injection Volume : 0.3
 Sample Name : Amylin, human, amide
 Cat No. : RP11278
 Lot No. : E4596623E
 Theoretical MW: 3903.28
 Observed MW : 3903.0

Interface : ESI
 Nebulizing Gas Flow : 1.5 L/min
 CDL Temp : 250
 Block Temp : 200

Equipment : ZJ22010150
 Interface Bias : +4.5 kV
 Drying Gas Flow : 5 L/min
 T.Flow : 0.2 ml/min
 B.conc : 50% H₂O / 50% MeOH