


Mass Spectrum

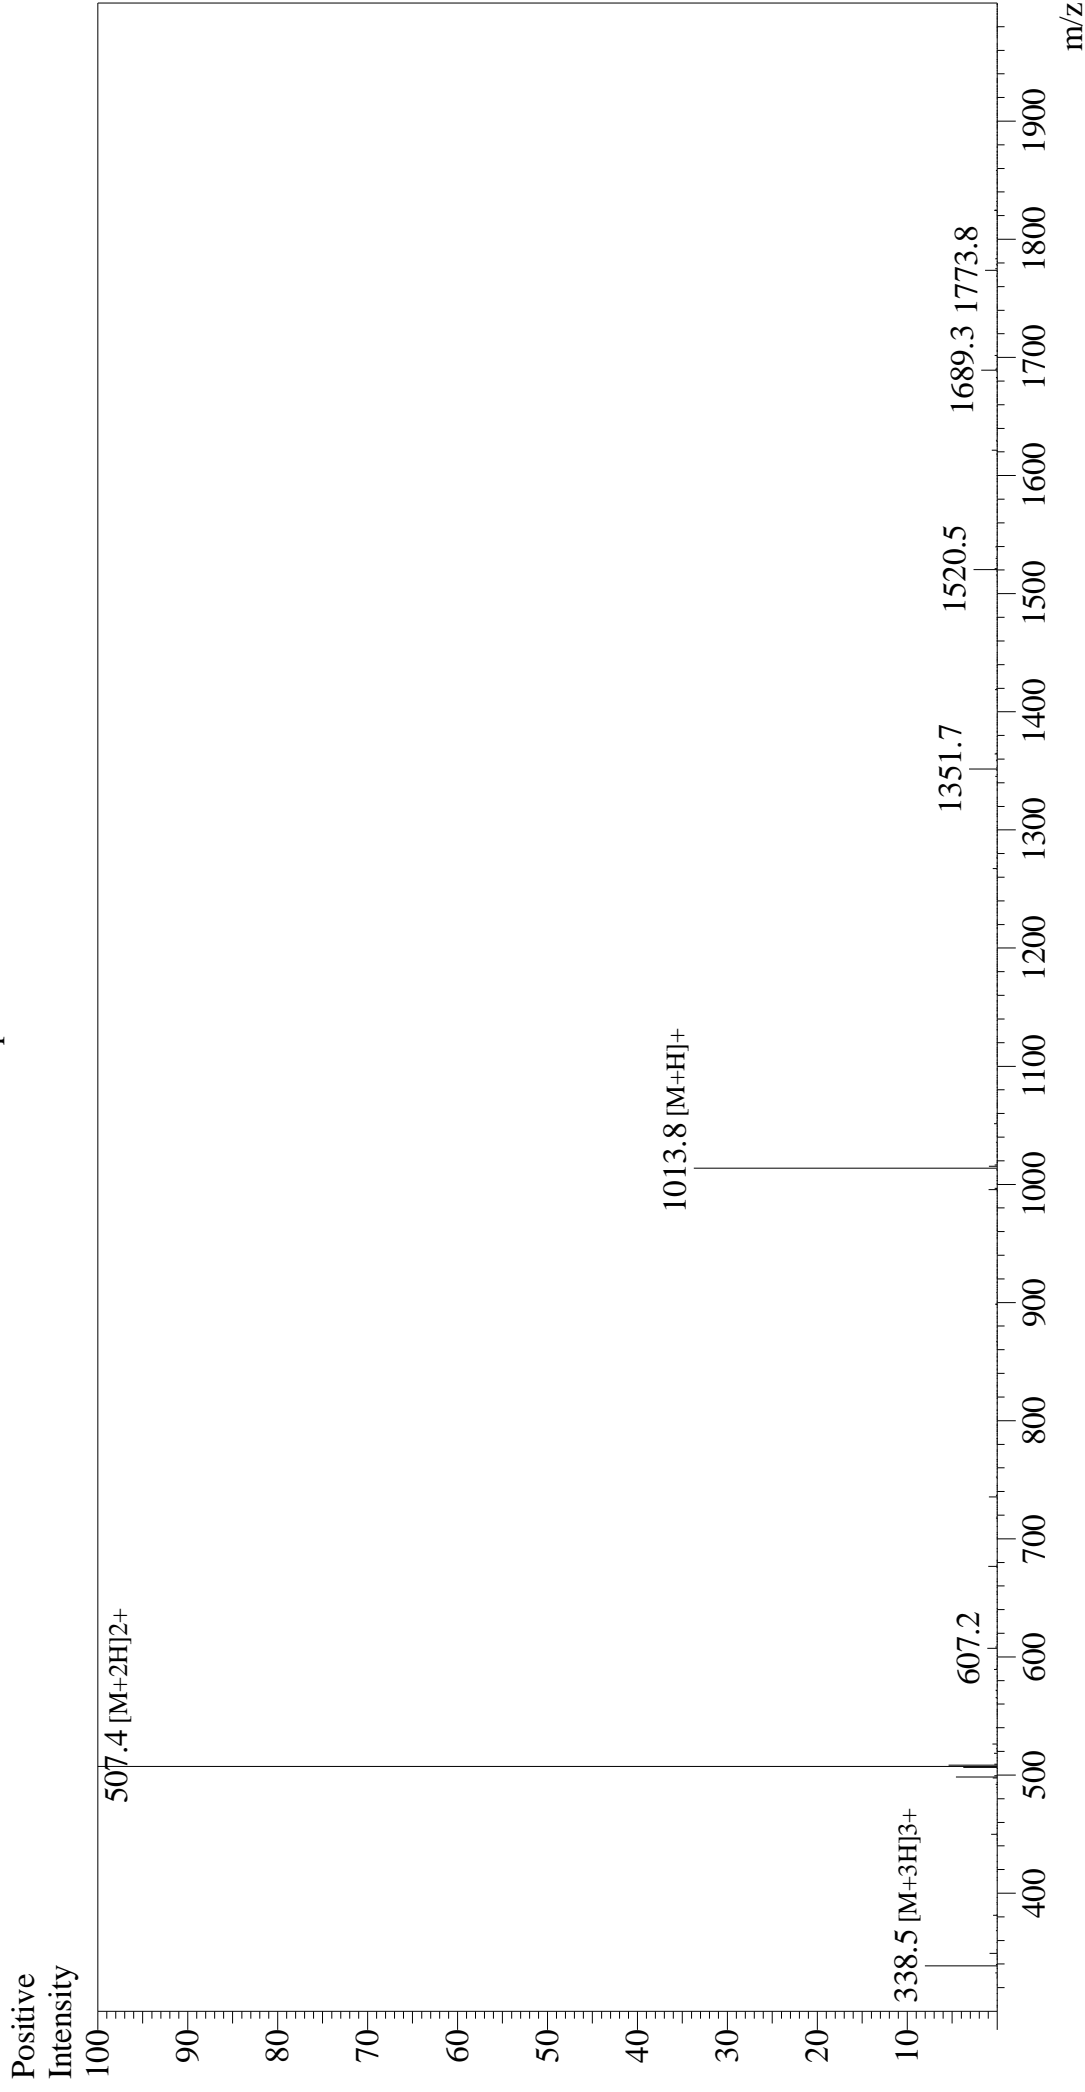

Sample Information

Month-Day Processed : 07/25/24
Time Processed : 15:49:06
Injection Volume : 0.3
Sample Name : DYKDDDDDK Peptide
Cat No. : RP10586
Lot No. : E6417324G
Theoretical MW: 1012.97
Observed MW : 1012.8

Interface
Nebulizing Gas Flow :1.5L/min
CDL Temp :250
Block Temp :200

Equipment
Interface Bias
Drying Gas Flow
T.Flow
B.conc

:ZJ22010150
:+4.5 kV
:5 L/min
:0.2 ml/min
:50%H₂O/50%MeOH