


Mass Spectrum

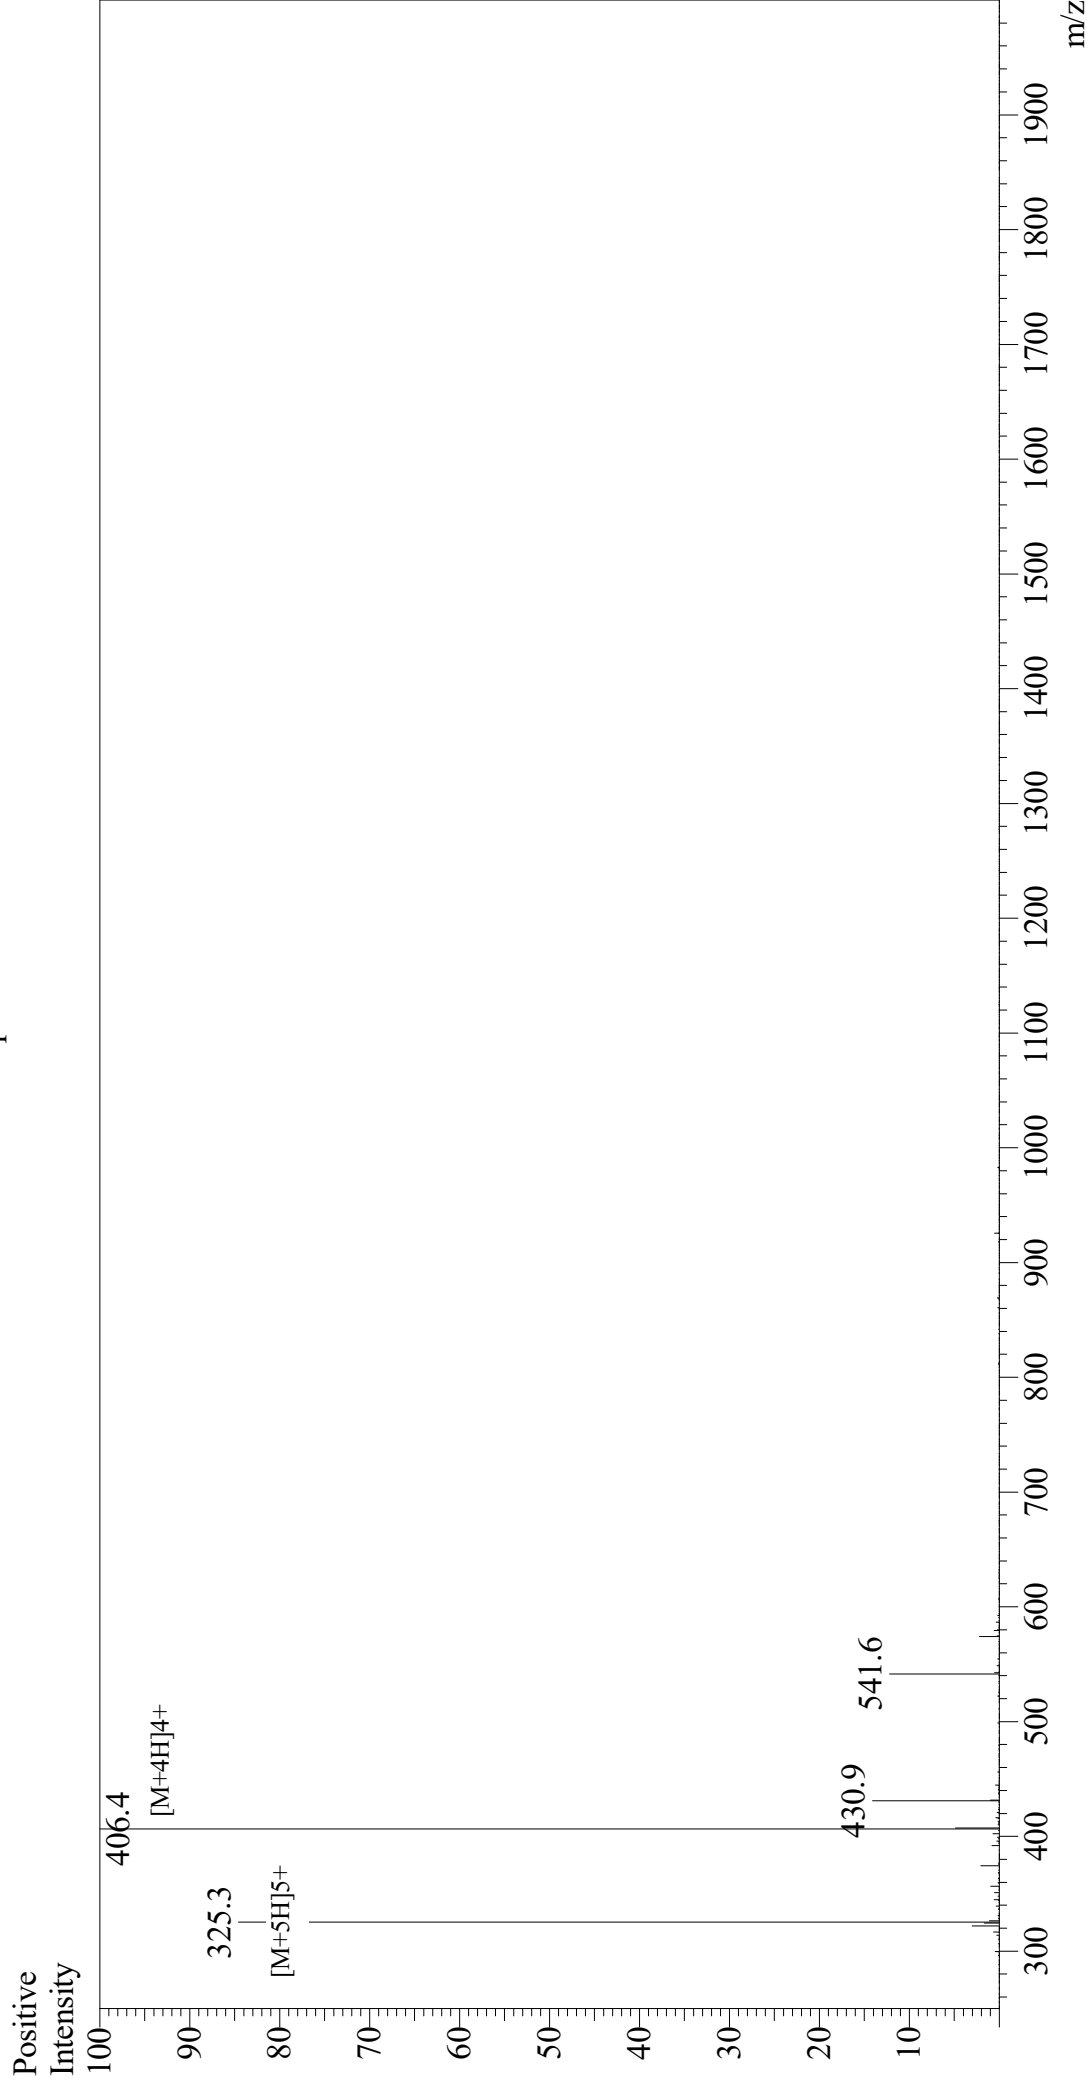

Sample Information

Month-Day Processed : 09/08/22
Time Processed : 19:44:18
Injection Volume : 0.2
Sample Name : TAT peptide
Cat No. : RP20256
Lot No. : E6428322I
Theoretical MW : 1621.91
Observed MW : 1621.6

Interface : ESI
Nebulizing Gas Flow : 1.5L/min
CDL Temp : 250
Block Temp : 200

Equipment : ZJ21010035
Interface Bias : +4.5 kV
Drying Gas Flow : 5 L/min
T.Flow : 0.2 ml/min
B.conc : 50%H₂O/50%MeOH