


Mass Spectrum

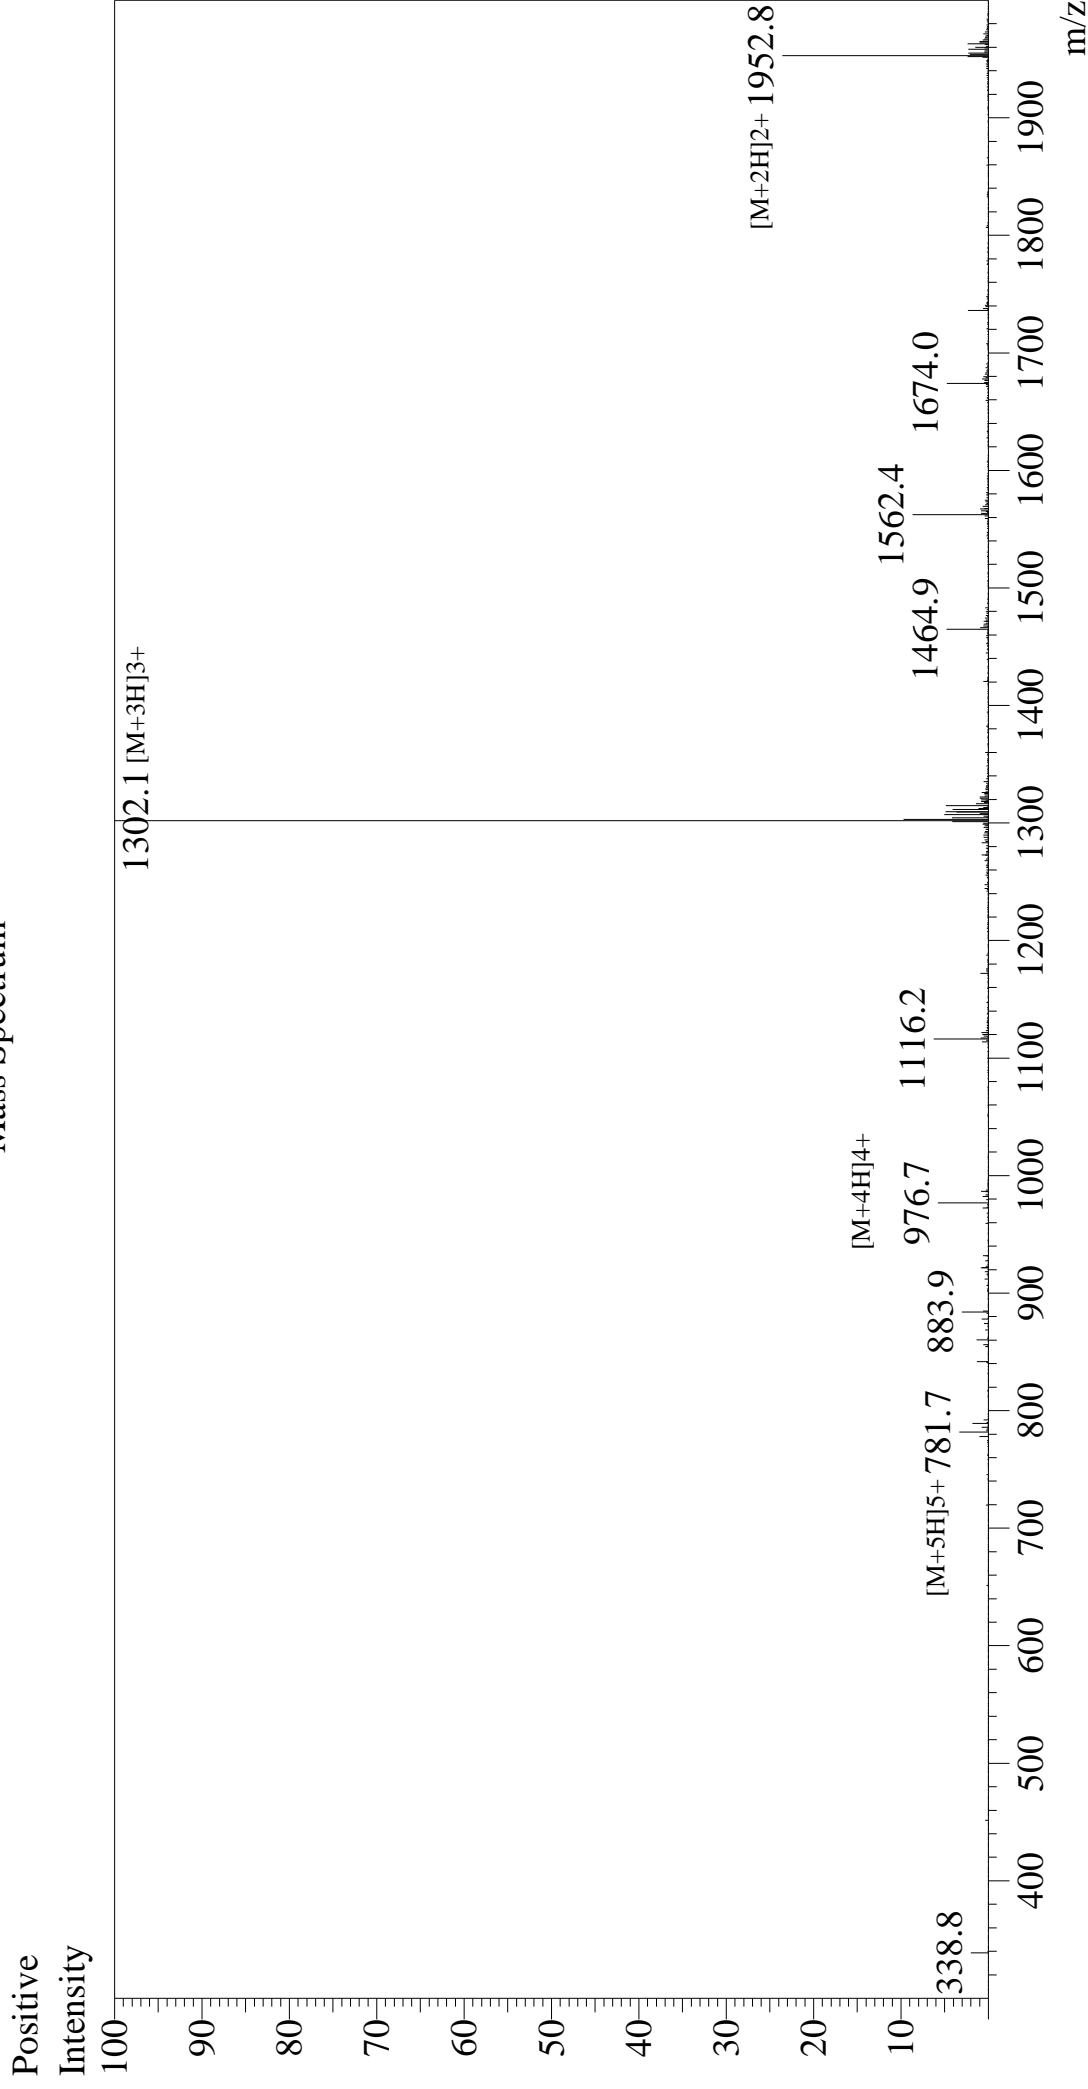

Sample Information

Month-Day Processed : 12/05/24
Time Processed : 3:31:02 PM
Injection Volume : 0.3
Sample Name : Amylin, human, amide
Cat No. : RP11278
Lot No. : E8905024L
Theoretical MW: 3903.28
Observed MW : 3903.3

Interface : ESI
Nebulizing Gas Flow : 1.5L/min
CDL Temp : 250
Block Temp : 200

Equipment : ZJ22010150
Interface Bias : +4.5 kV
Drying Gas Flow : 5 L/min
T.Flow : 0.2 ml/min
B.conc : 50% H2O/50% M