


Mass Spectrum

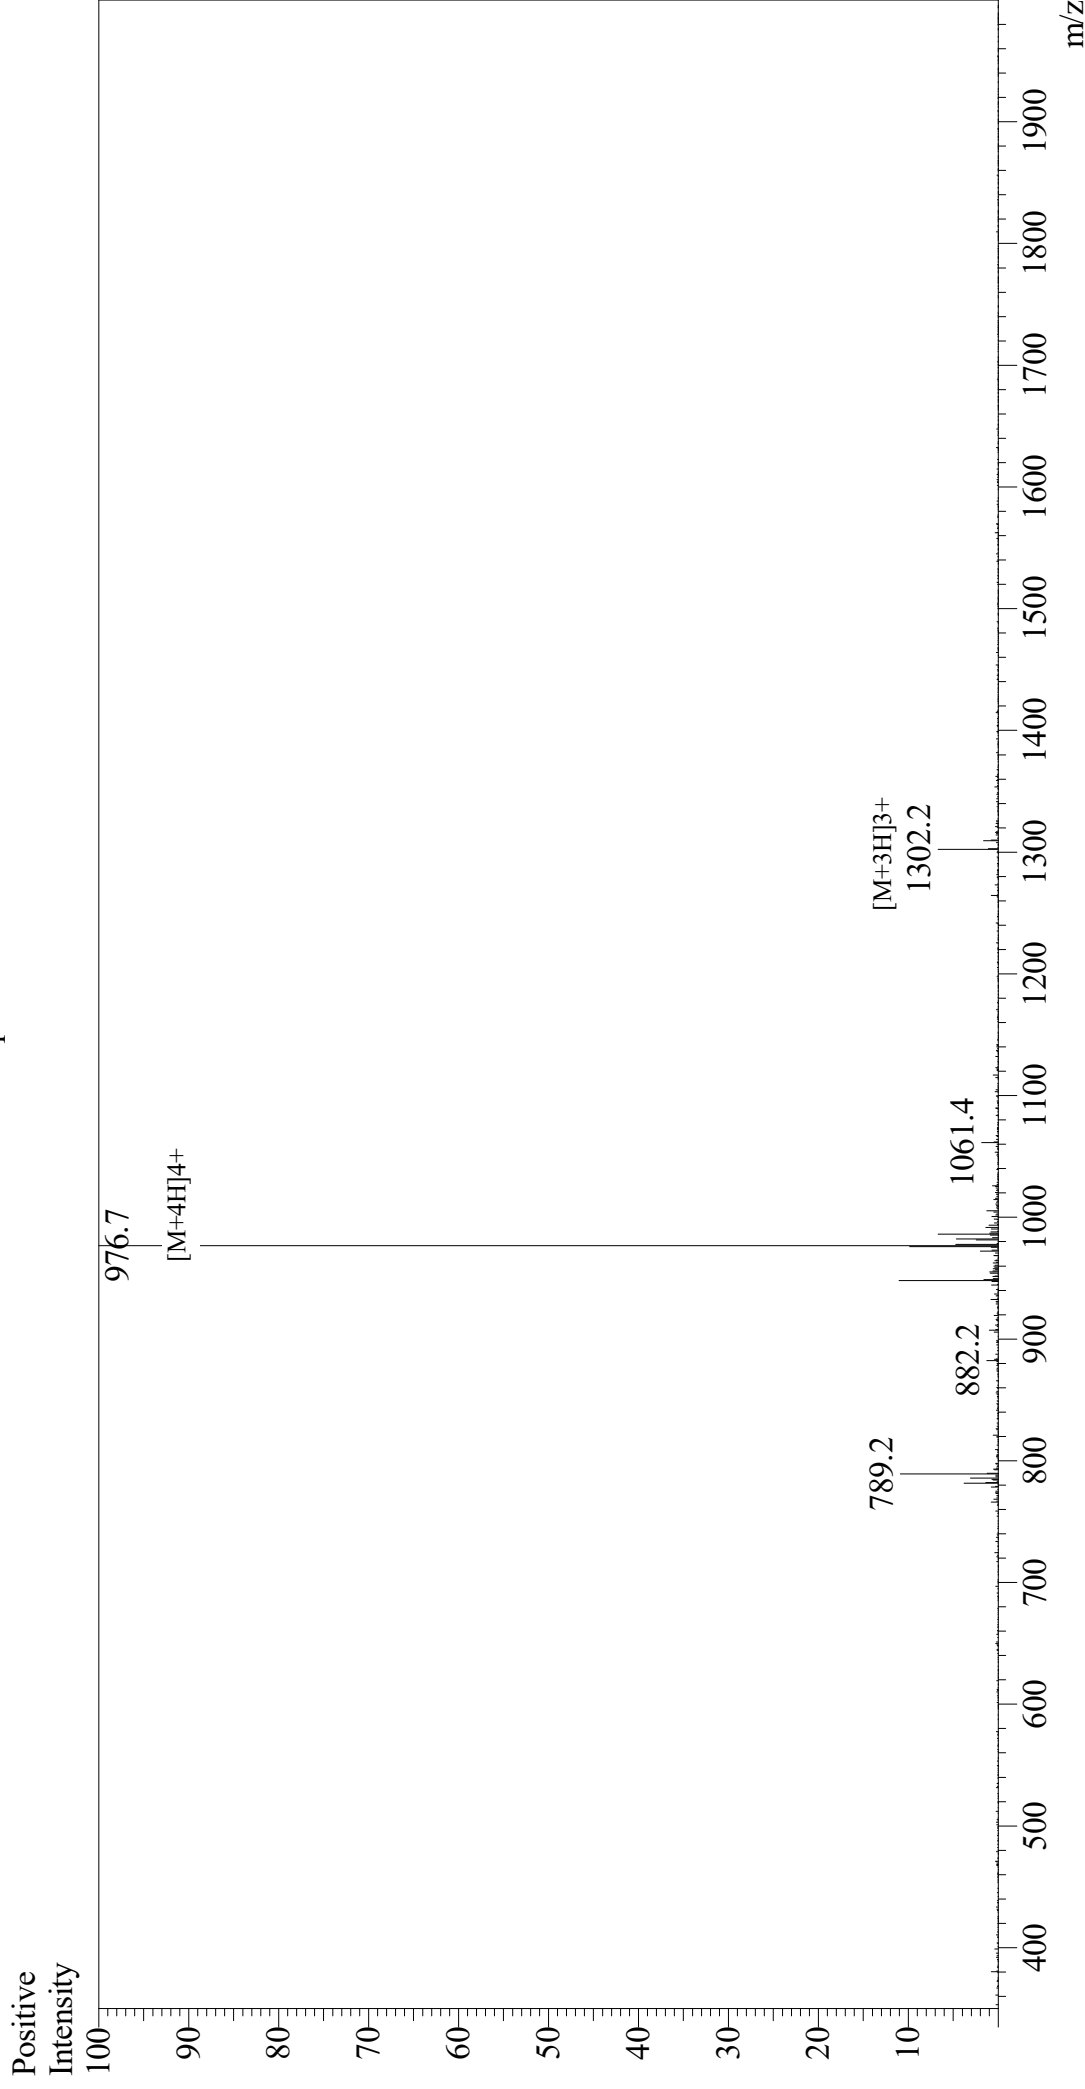

Sample Information
Month-Day Processed : 03/03/22
Time Processed : 20:36:03
Injection Volume : 0.1
Sample Name : Amylin, human, amide
Cat No. : RP11278
Lot No. : E9220022B
Theoretical MW : 3903.28
Observed MW : 3902.8

Interface : ESI
Nebulizing Gas Flow : 1.5 L/min
CDL Temp : 250
Block Temp : 200
Equipment : ZJ21010035
Interface Bias : +4.5 kV
Drying Gas Flow : 5 L/min
T.Flow : 0.2 ml/min
B.conc : 50% H₂O/50% MeOH