


Mass Spectrum

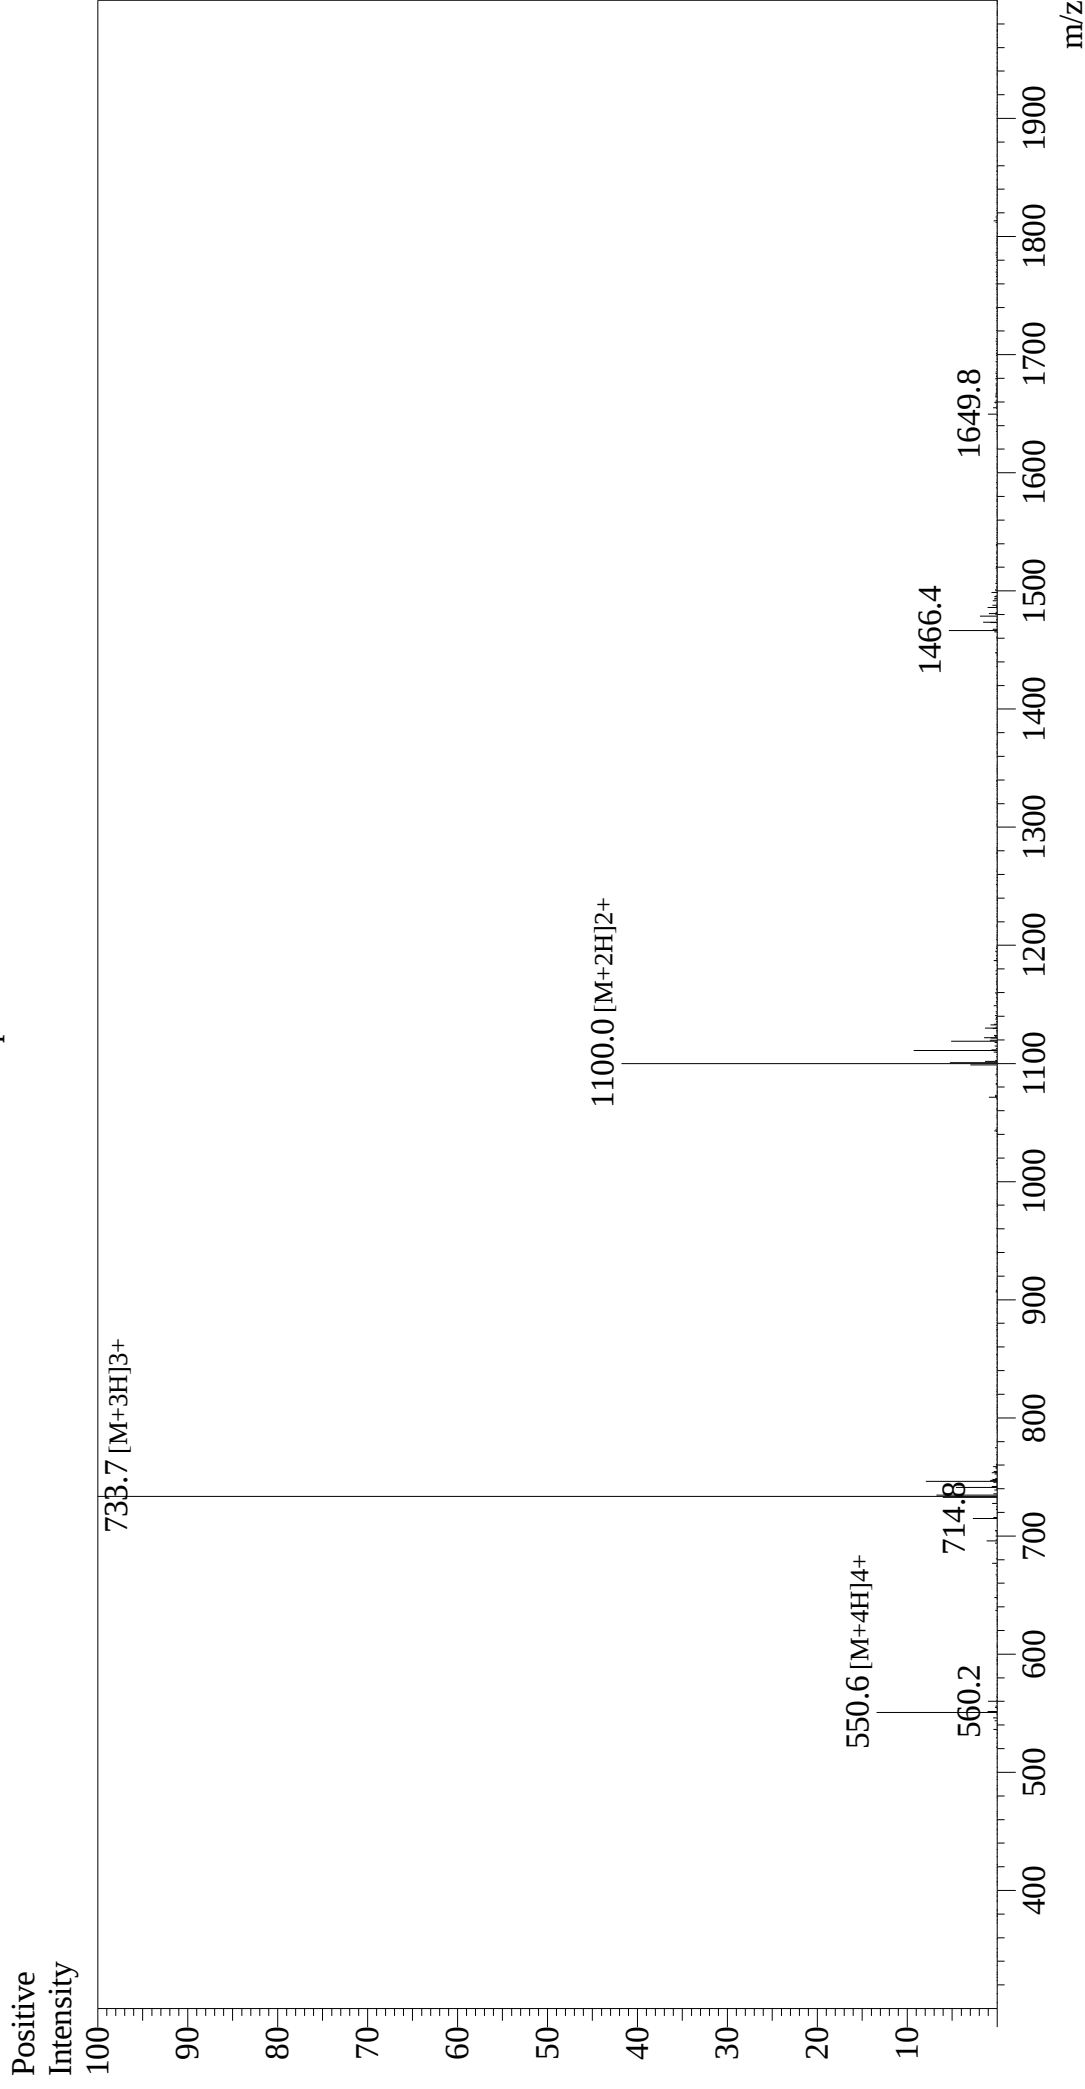

Sample Information

Month-Day Processed :	05/26/23	Equipment	:ZJ22010150
Time Processed :	19:56:45	Interface Bias	: +4.5 kV
Injection Volume :	0.1	Drying Gas Flow	:5 L/min
Sample Name :	C-Type Natriuretic Peptide (CNP) (1-22), human	T.Flow	:0.2 ml/min
Cat No. :	RP11110	B.conc	:50%H2O/50%MeOH
Lot No. :	E9301423E		
Theoretical MW : 2197.60			
Observed MW : 2198.1			