


Sample Name :C-Type Natriuretic Peptide (CNP) (1-22), human
Cat No. :RP11110
Lot No. :E9790025H
Time Processed :3:23:19
Month-Dav-Year Processed :08/28/2025
Pump A : 0.065% trifluoroacetic in 100% water (v/v)
Pump B : 0.05% trifluoroacetic in 100% acetonitrile (v/v)
Total Flow:1 ml/min
Wavelength:220 nm

<<LC Time Program>>

Time	Module	Command	Value
0.01	Pumps	B.Conc	5
25.00	Pumps	B.Conc	65
25.01	Pumps	B.Conc	95
27.00	Pumps	B.Conc	95
27.01	Pumps	B.Conc	5
35.00	Pumps	B.Conc	5
35.01	Controller	Stop	

<<Column Performance>>
<Detector A>
Column :Inertsil ODS-SP 4.6 x 250 mm
Equipment: ZJ17010504

<Chromatogram>

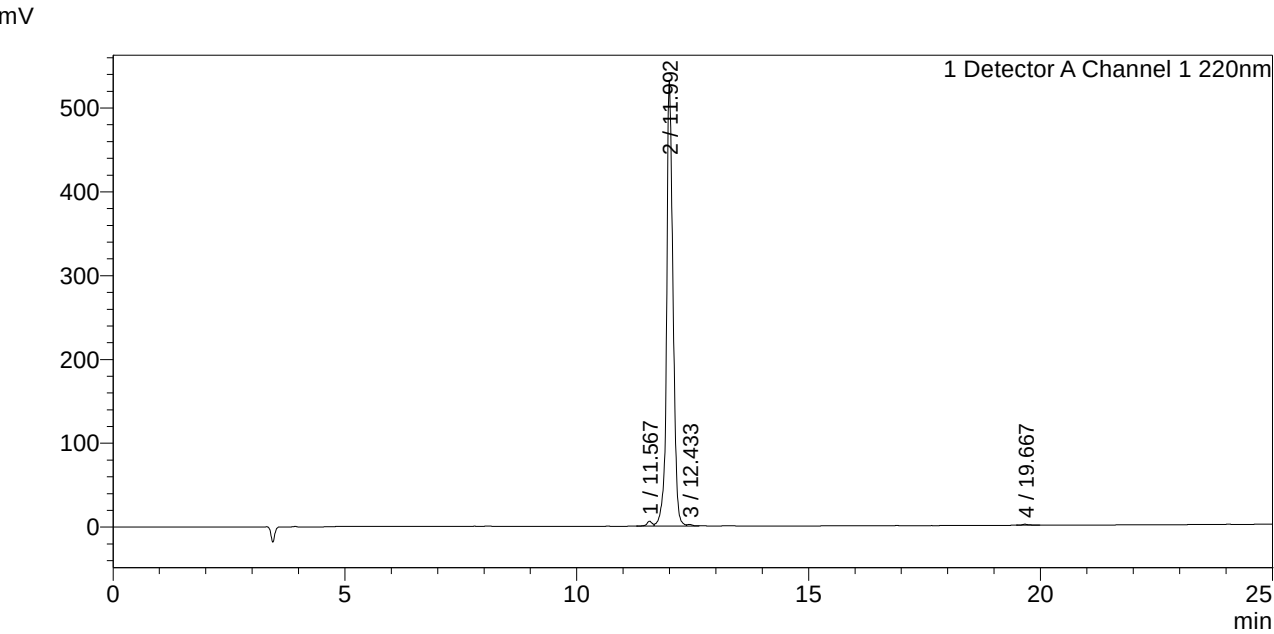

<Peak Table>

Detector A Channel 1 220nm

Peak#	Ret. Time	Area	Height	Area%
1	11.567	46866	5986	0.911
2	11.992	5072362	531082	98.560
3	12.433	17436	2099	0.339
4	19.667	9791	1111	0.190
Total		5146455	540278	100.000