


Mass Spectrum

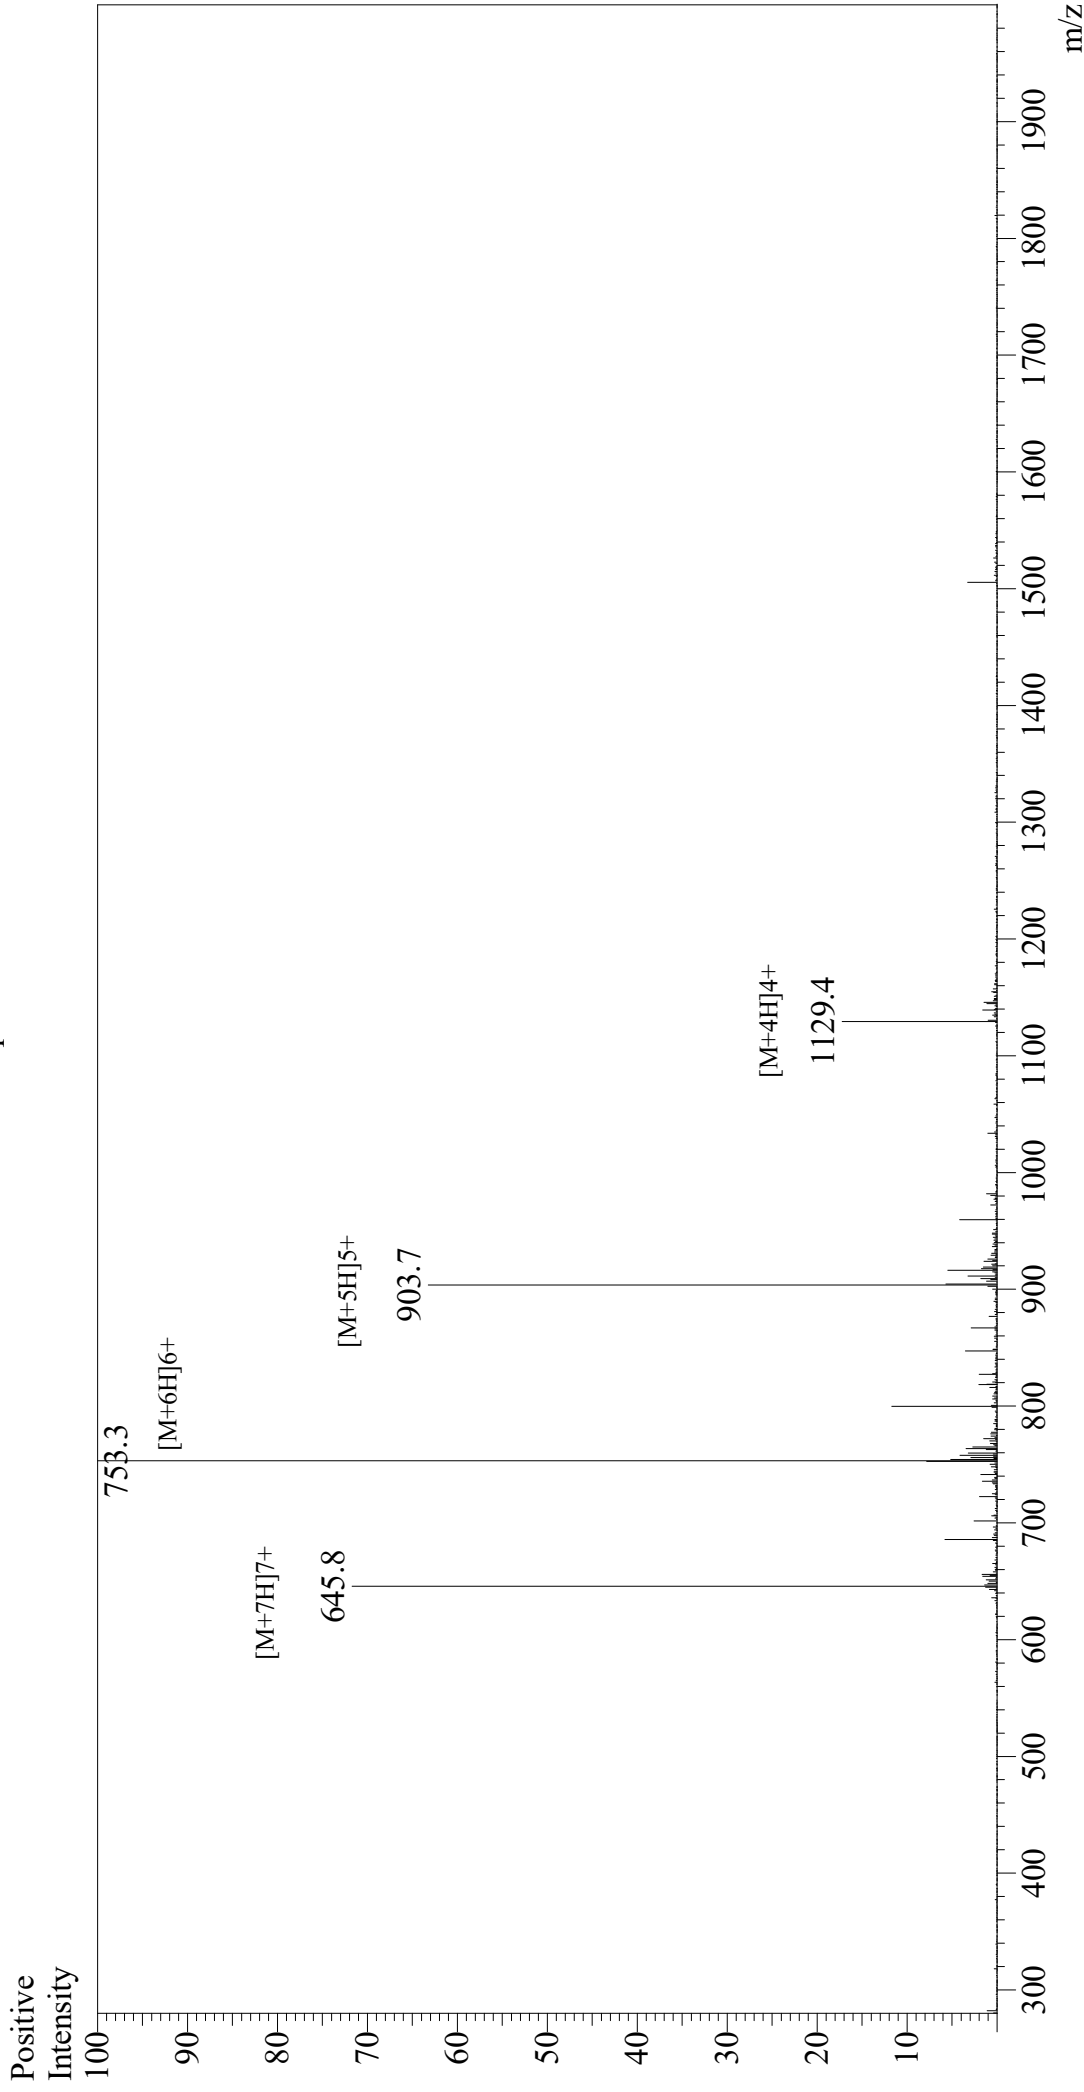

Sample Information

Acquired by : Gary
Month-Day Processed : 03/07/19
Time Processed : 9:56:56
Injection Volume : 0.4
Sample Name : β -Amyloid (42-1)
Cat No.: RPI0034
Lot No.: PE8191902
Theoretical MW : 4514.40
Observed MW : 4513.8

Interface : ESI
Nebulizing Gas Flow : 1.5L/min
CDL Temp : 250°C
Block Temp : 200°C

Equipment: SS-CM-0273
Interface Bias: +4.5 kV
Drying Gas Flow: 5 L/min
T.Flow: 0.2 ml/min
B.conc: 50%H2O/50%MeOH