

Sample Name : C-Type Natriuretic Peptide (CNP) (1-22), human
 Cat. No. : RP11110
 Lot. No. : E8654820K
 Time Processed : 2:24:28 PM
 Month-Day-Year Processed : 11/10/2020

Pump A : 0.065% trifluoroacetic in 100% water (v/v)
 Pump B : 0.05% trifluoroacetic in 100% acetonitrile (v/v)
 Total Flow: 1 ml/min
 Wavelength: 220 nm


Time	Module	Command	Value
0.01	Pumps	Pump A B.Conc	5
25.00	Pumps	Pump A B.Conc	65
25.01	Pumps	Pump A B.Conc	95
32.00	Pumps	Pump A B.Conc	95
32.01	Pumps	Pump A B.Conc	5
40.00	Pumps	Pump A B.Conc	5
40.01	Controller	Stop	

<<Column Performance>>

<Detector A>

Column : Inertsil ODS-3 4.6 x 250 mm
 Equipment: GK11010017

mV

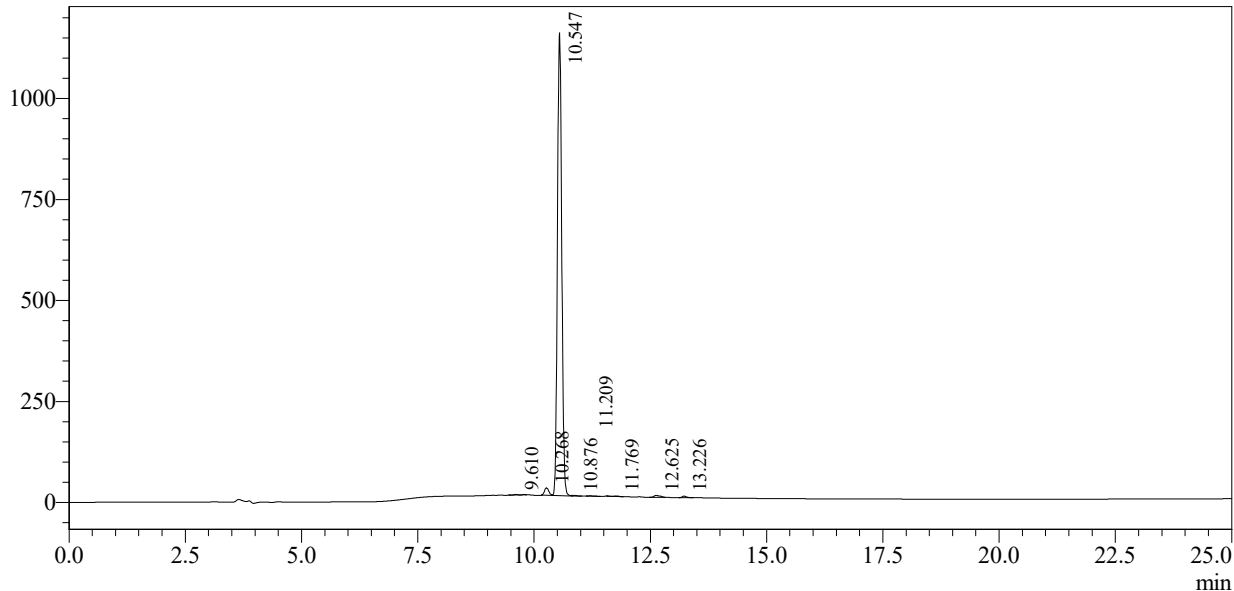

1 Detector A Channel 1 / 220nm

Peak Table

Detector A Channel 1 220nm

Peak#	Ret. Time	Area	Height	Area %
1	9.610	4380	1279	0.057
2	10.268	121593	18610	1.588
3	10.547	7445848	1145535	97.222
4	10.876	8503	1318	0.111
5	11.209	8557	947	0.112
6	11.769	5737	1360	0.075
7	12.625	41712	4907	0.545
8	13.226	22252	3734	0.291
Total		7658582	1177690	100.000