

Sample Name : Rabies Virus Glycoprotein
 Cat. No. : RP20464
 Lot. No. : PE8861901
 Time Processed : 10:23:36
 Month-Day-Year Processed : 01/21/2019

Pump A : 0.065% trifluoroacetic in 100% water (v/v)
 Pump B : 0.05% trifluoroacetic in 100% acetonitrile (v/v)
 Total Flow: 1 ml/min
 Wavelength: 220 nm

Time	Unit	Command	Value	Comment
0.01	Pumps	Pump B Conc.	5	
25.00	Pumps	Pump B Conc.	65	
25.01	Pumps	Pump B Conc.	95	
27.00	Pumps	Pump B Conc.	95	
27.01	Pumps	Pump B Conc.	5	
35.00	Pumps	Pump B Conc.	5	
35.01	Controller	Stop		


<<Column Performance>>

<Detector A>

Column : Inertsil ODS-3 4.6 x 250 mm

Equipment: G09010878

Chromatogram

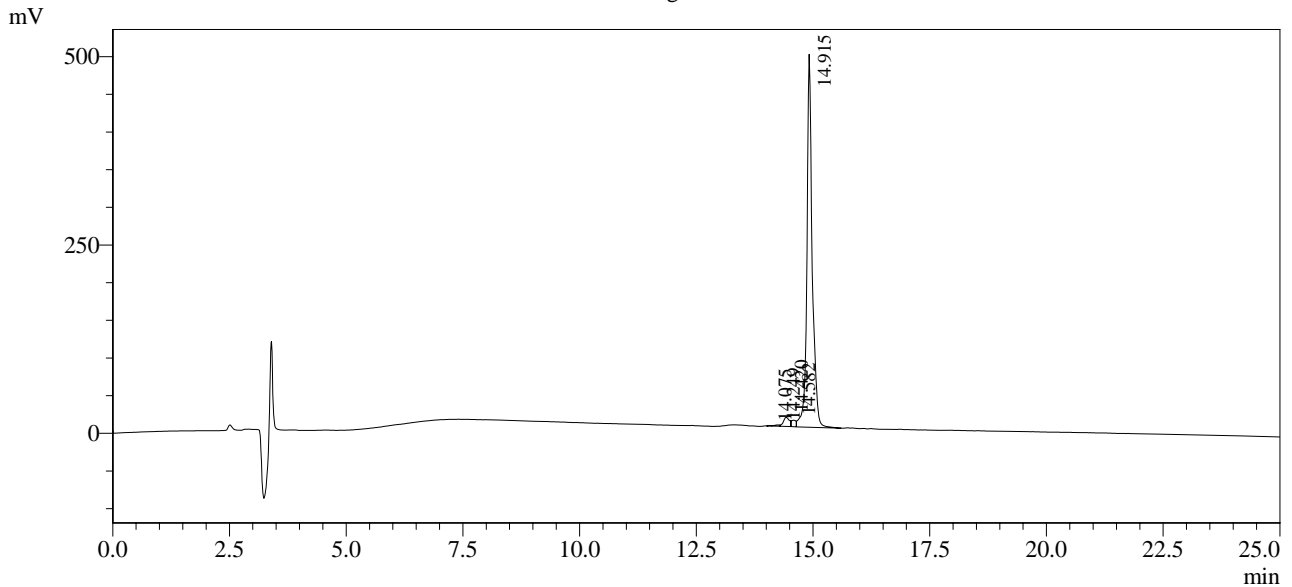

1 Det.A Ch1 / 220nm

Peak Table

Detector A Ch1 220nm

Peak#	Ret. Time	Area	Height	Area %
1	14.075	2028	500	0.049
2	14.249	14169	1772	0.344
3	14.420	109218	12410	2.653
4	14.582	57237	8665	1.391
5	14.915	3933396	495184	95.562
Total		4116048	518531	100.000