


Mass Spectrum

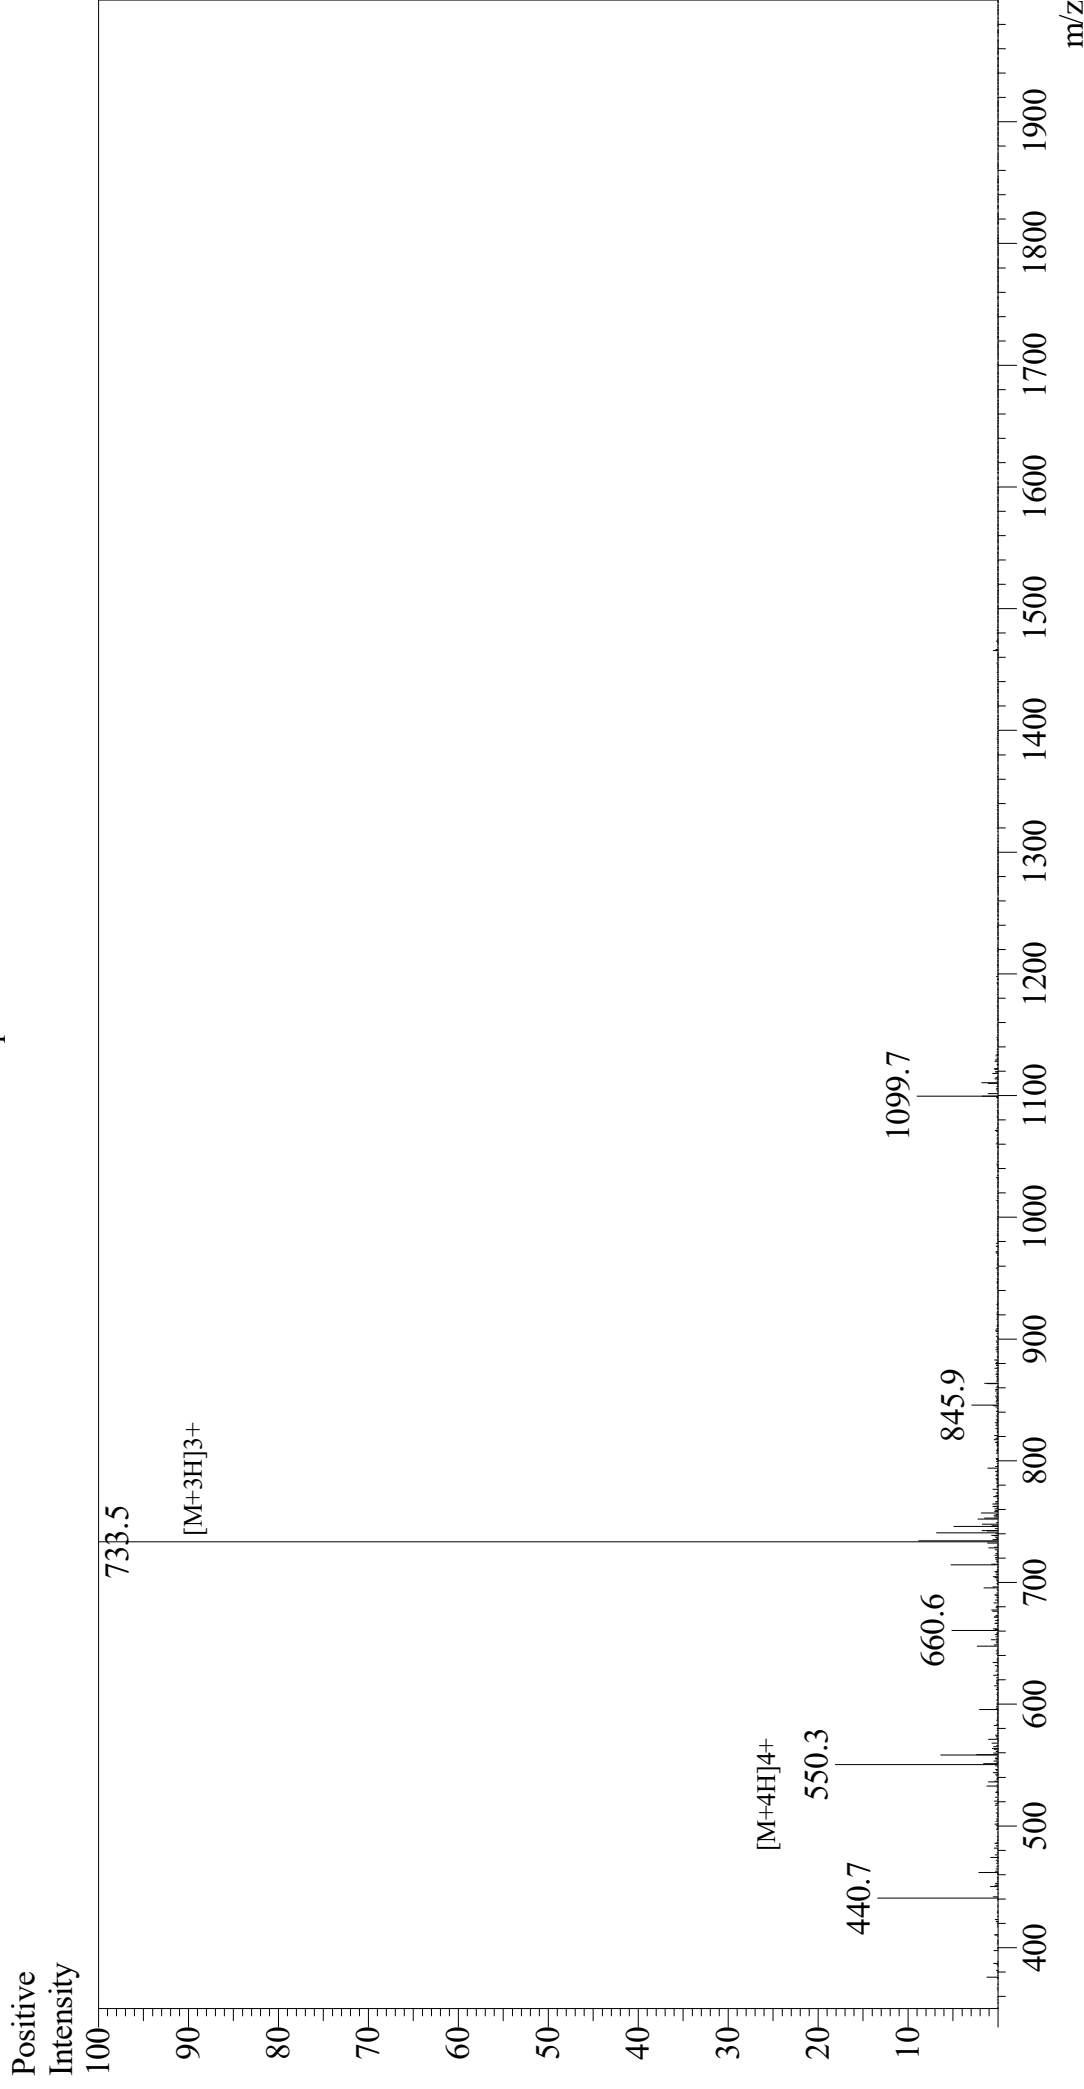

Sample Information

Month-Day Processed :	11/29/21	Equipment	: ZJ21010035
Time Processed :	7:52:06	Interface Bias	: +4.5 kV
Injection Volume :	0.2	Drying Gas Flow	: 5 L/min
Sample Name :	C-Type Natriuretic Peptide (CNP) (1-22), human	T.Flow	: 0.2 ml/min
Cat No. :	RP11110	B.conc	: 50% H2O/50% MeOH
Lot No. :	E3443821K		
Theoretical MW :	2197.60		
Observed MW :	2197.5		