


Mass Spectrum

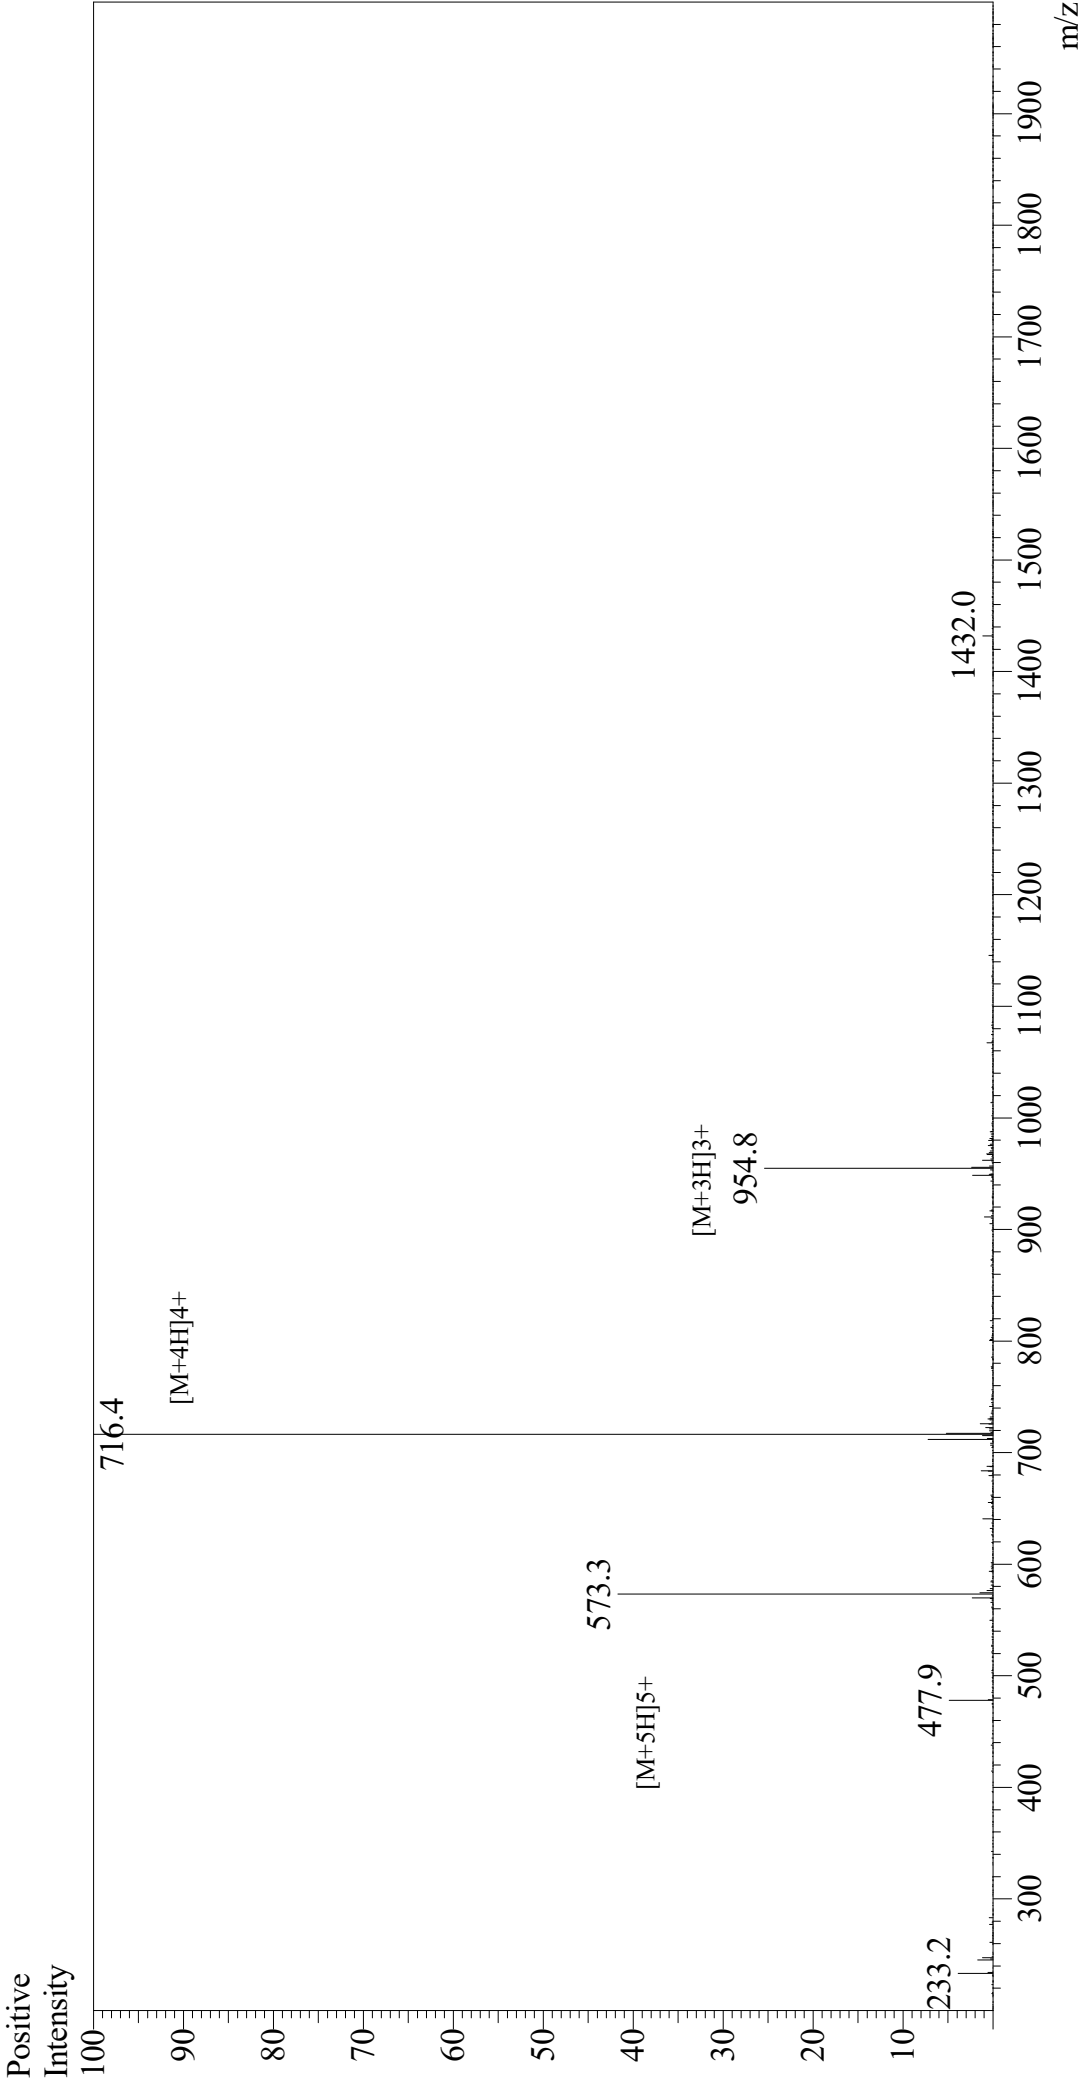

Sample Information
Month-Day Processed : 08/07/21
Time Processed : 23:00:48
Injection Volume : 0.2
Sample Name : MDYKDHGDGYKDHHDIDYKDDDDDK peptide
Cat No. : RP21087
Lot No. : E6323221G
Theoretical MW : 2861.87
Observed MW : 2861.6

Interface : ESI
Nebulizing Gas Flow : 1.5L/min
CDL Temp : 250
Block Temp : 200

Equipment : ZJ21010035
Interface Bias : +4.5 kV
Drying Gas Flow : 5 L/min
T.Flow : 0.2 ml/min
B.conc : 50%H2O/50%MeOH