

Sample Name :Gastric Inhibitory Peptide (GIP), human
 Cat No :RP10795
 Lot No :E7143721C
 Time Processed :22:17:47
 Month-Day-Year Processed :03/27/2021


Pump A : 0.065% trifluoroacetic in 100% water (v/v)
 Pump B : 0.05% trifluoroacetic in 100% acetonitrile (v/v)
 Total Flow:1 ml/min
 Wavelength:220 nm

Time	Module	Command	Value
0.01	Pumps	Pump A B.Conc	5
25.00	Pumps	Pump A B.Conc	65
25.01	Pumps	Pump A B.Conc	95
27.00	Pumps	Pump A B.Conc	95
27.01	Pumps	Pump A B.Conc	5
35.00	Pumps	Pump A B.Conc	5
35.01	Controller	Stop	

<<Column Performance>>

<Detector A>

Column : Inertsil ODS-3 4.6 x 250 mm

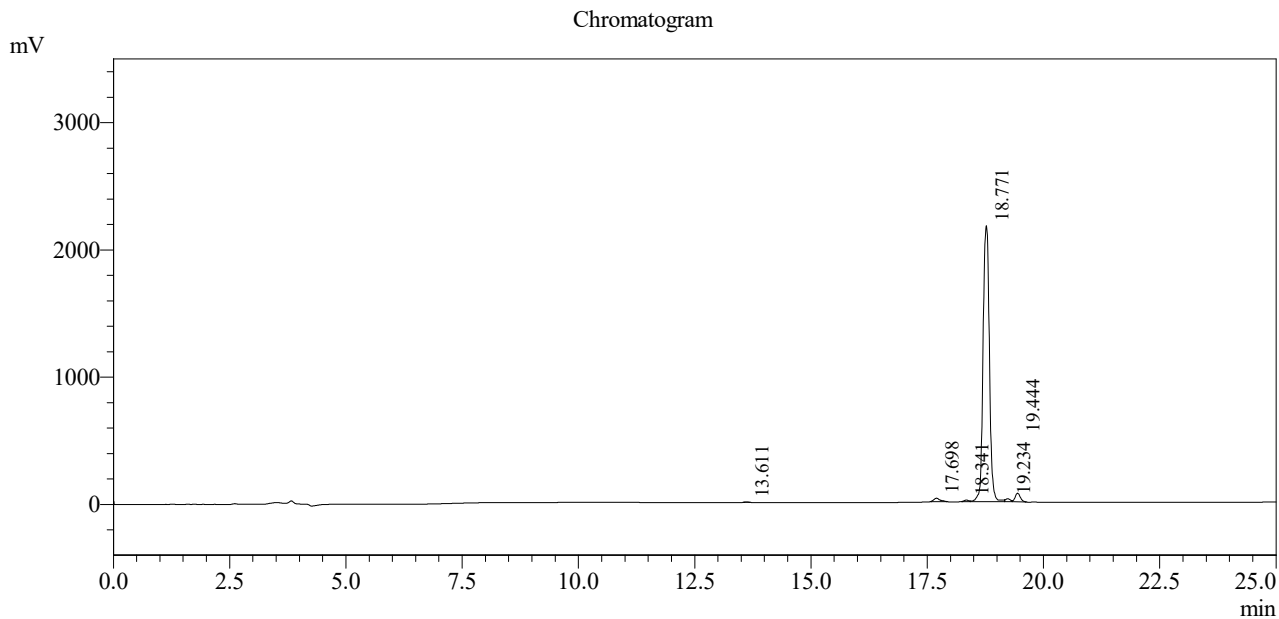

1 Detector A Channel 1 / 220nm

Peak Table

Detector A Channel 1 220nm

Peak#	Ret. Time	Area	Height	Area %
1	13.611	14034	3096	0.065
2	17.698	246693	26543	1.144
3	18.341	77007	11562	0.357
4	18.771	20524888	2169150	95.217
5	19.234	169408	23687	0.786
6	19.444	523796	68315	2.430
Total		21555827	2302353	100.000