

Sample Name:Atrial Natriuretic Peptide (ANP) (1-28), human, porcine

Cat. No. : RP11927

Lot. No. : E0222619I

Time Processed :13:52:42

Month-Day-Year Processed :10/13/2019

Pump A : 0.065% trifluoroacetic in 100% water (v/v)

Pump B : 0.05% trifluoroacetic in 100% acetonitrile (v/v)

Total Flow:1 ml/min

Wavelength:220 nm

Time	Unit	Command	Value	Comment
0.01	Pumps	Pump A B.Conc	5	
25.00	Pumps	Pump A B.Conc	65	
31.00	Pumps	Pump A B.Conc	95	
32.00	Pumps	Pump A B.Conc	95	
32.01	Pumps	Pump A B.Conc	5	
40.00	Pumps	Pump A B.Conc	5	
40.02	Controller	Stop		


<<Column Performance>>

<Detector A>

Column : Inertsil ODS-3 4.6 x 250 mm

Equipment: GK1101009

Chromatogram

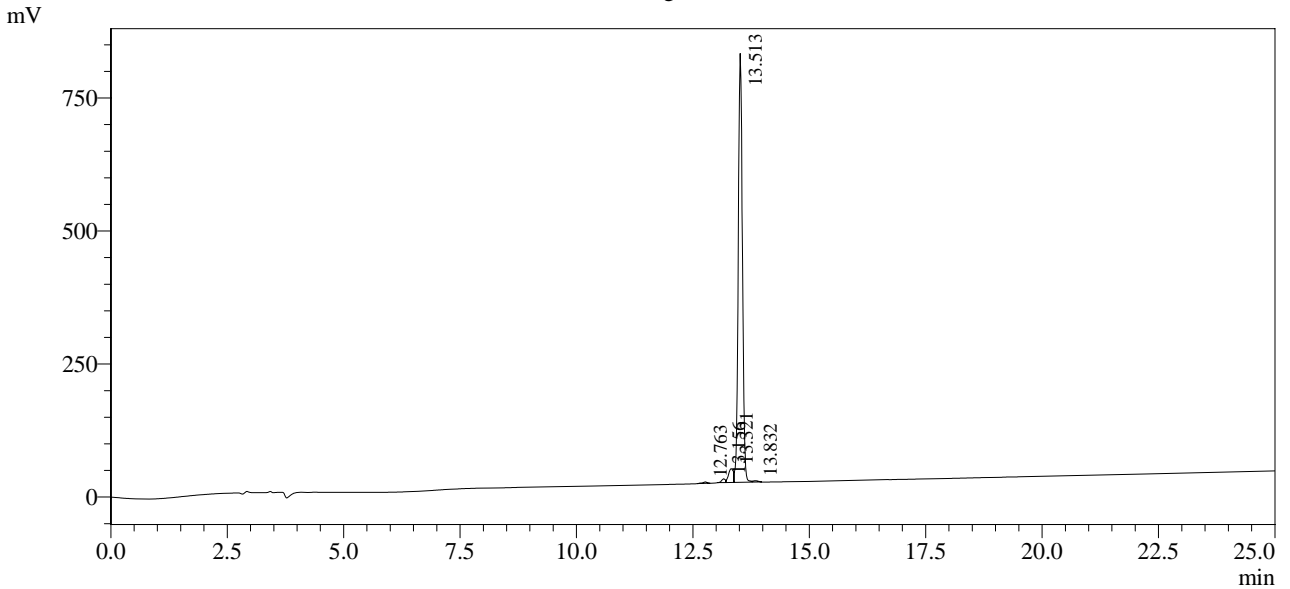

1 Det.A Ch1 / 220nm

Peak Table

Detector A Ch1 220nm

Peak#	Ret. Time	Area	Height	Area %
1	12.763	17165	2609	0.323
2	13.156	38182	7050	0.719
3	13.321	190097	25815	3.581
4	13.513	5044512	805749	95.039
5	13.832	17864	2358	0.337
Total		5307820	843581	100.000