


Mass Spectrum

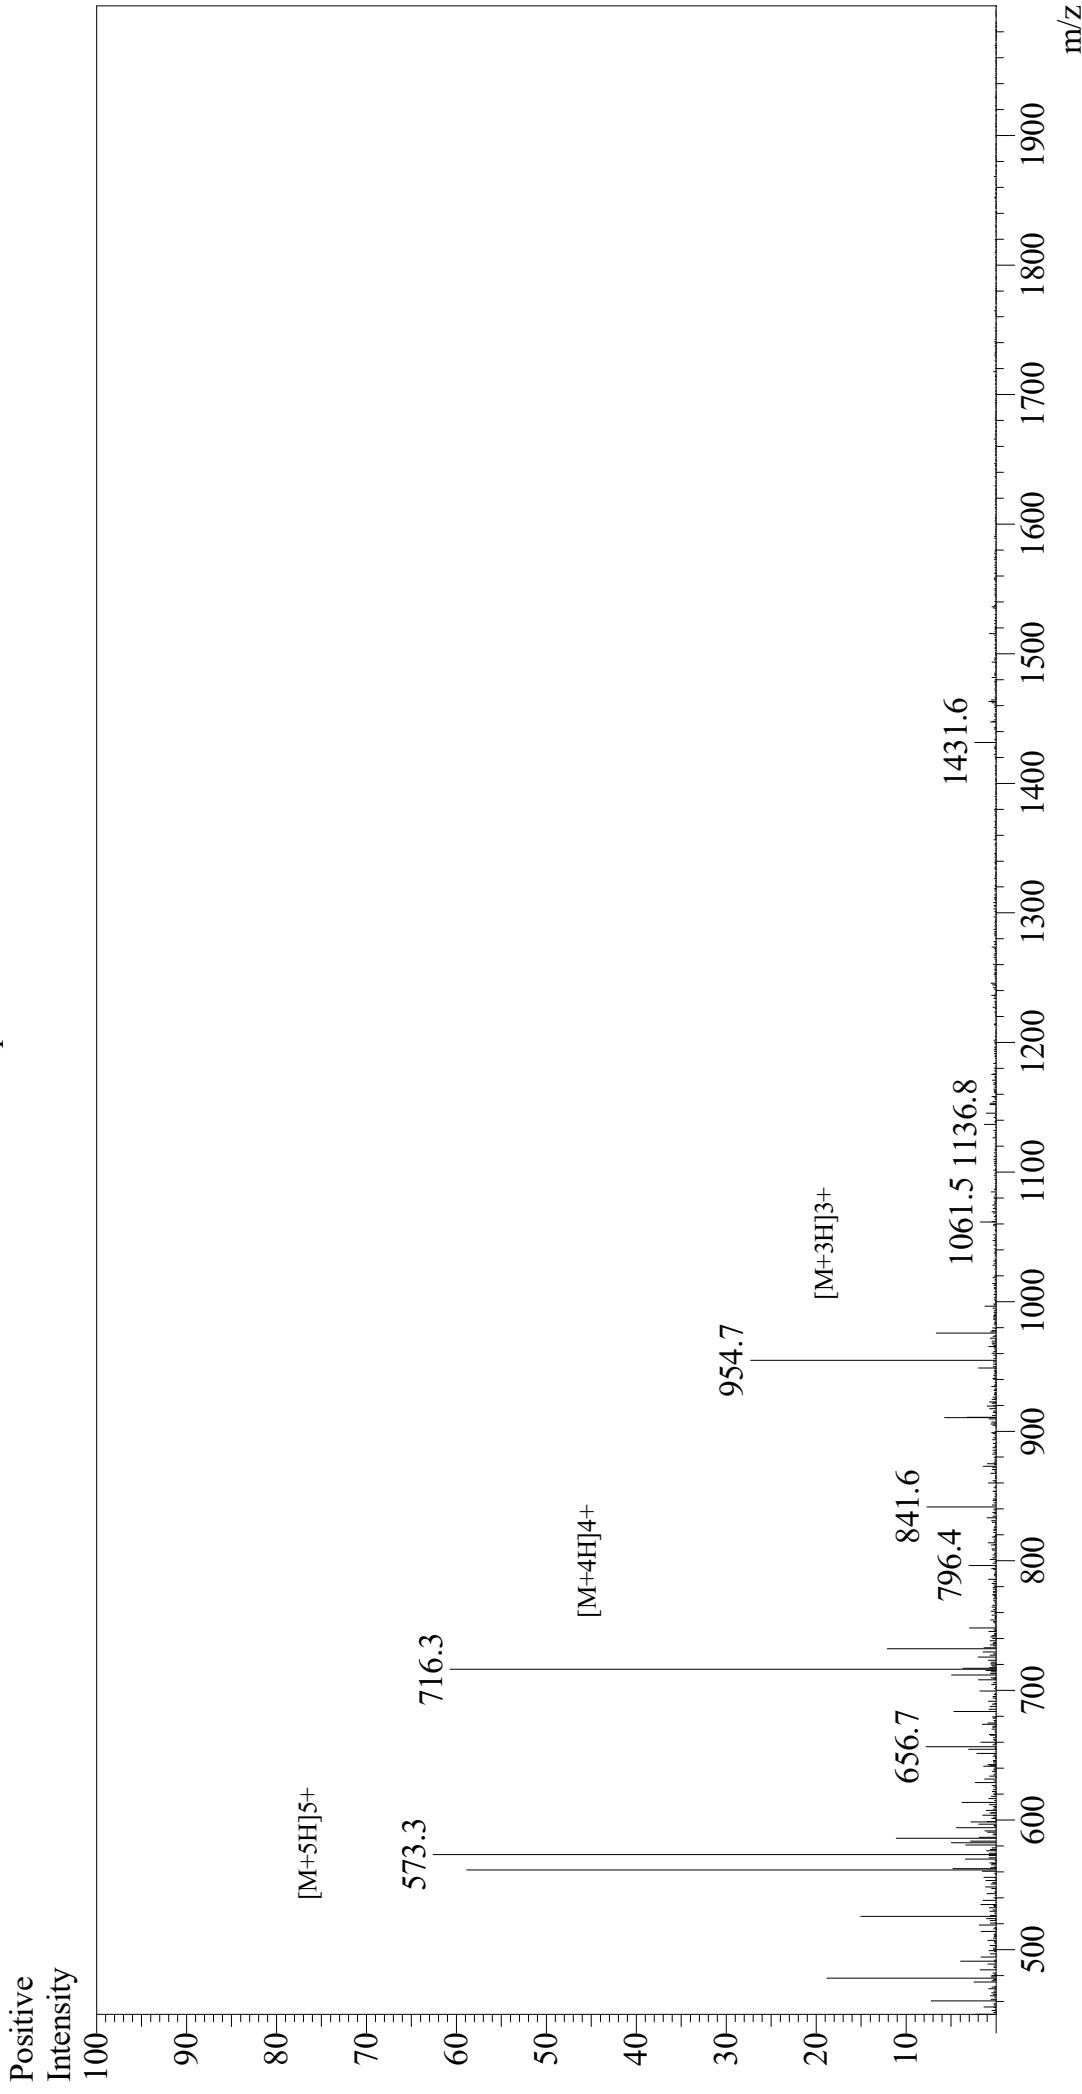

Sample Information
Month-Day Processed : 09/21/20
Time Processed : 09:07:02 PM
Injection Volume : 0.6
Sample Name : MDYKDHGDYKDHIDYKDDDDK peptide
Cat No. : RP21087
Lot No. : E22350201
Theoretical MW : 2861.87
Observed MW : 2861.5

Interface : ESI
Nebulizing Gas Flow : 1.5L/min
CDL Temp : 250
Block Temp : 200

Equipment : GK11010007
Interface Bias : +4.5 kV
Drying Gas Flow : 5 L/min
T.Flow : 0.2 ml/min
B.conc : 50%H2O/50%MeOH