


Mass Spectrum

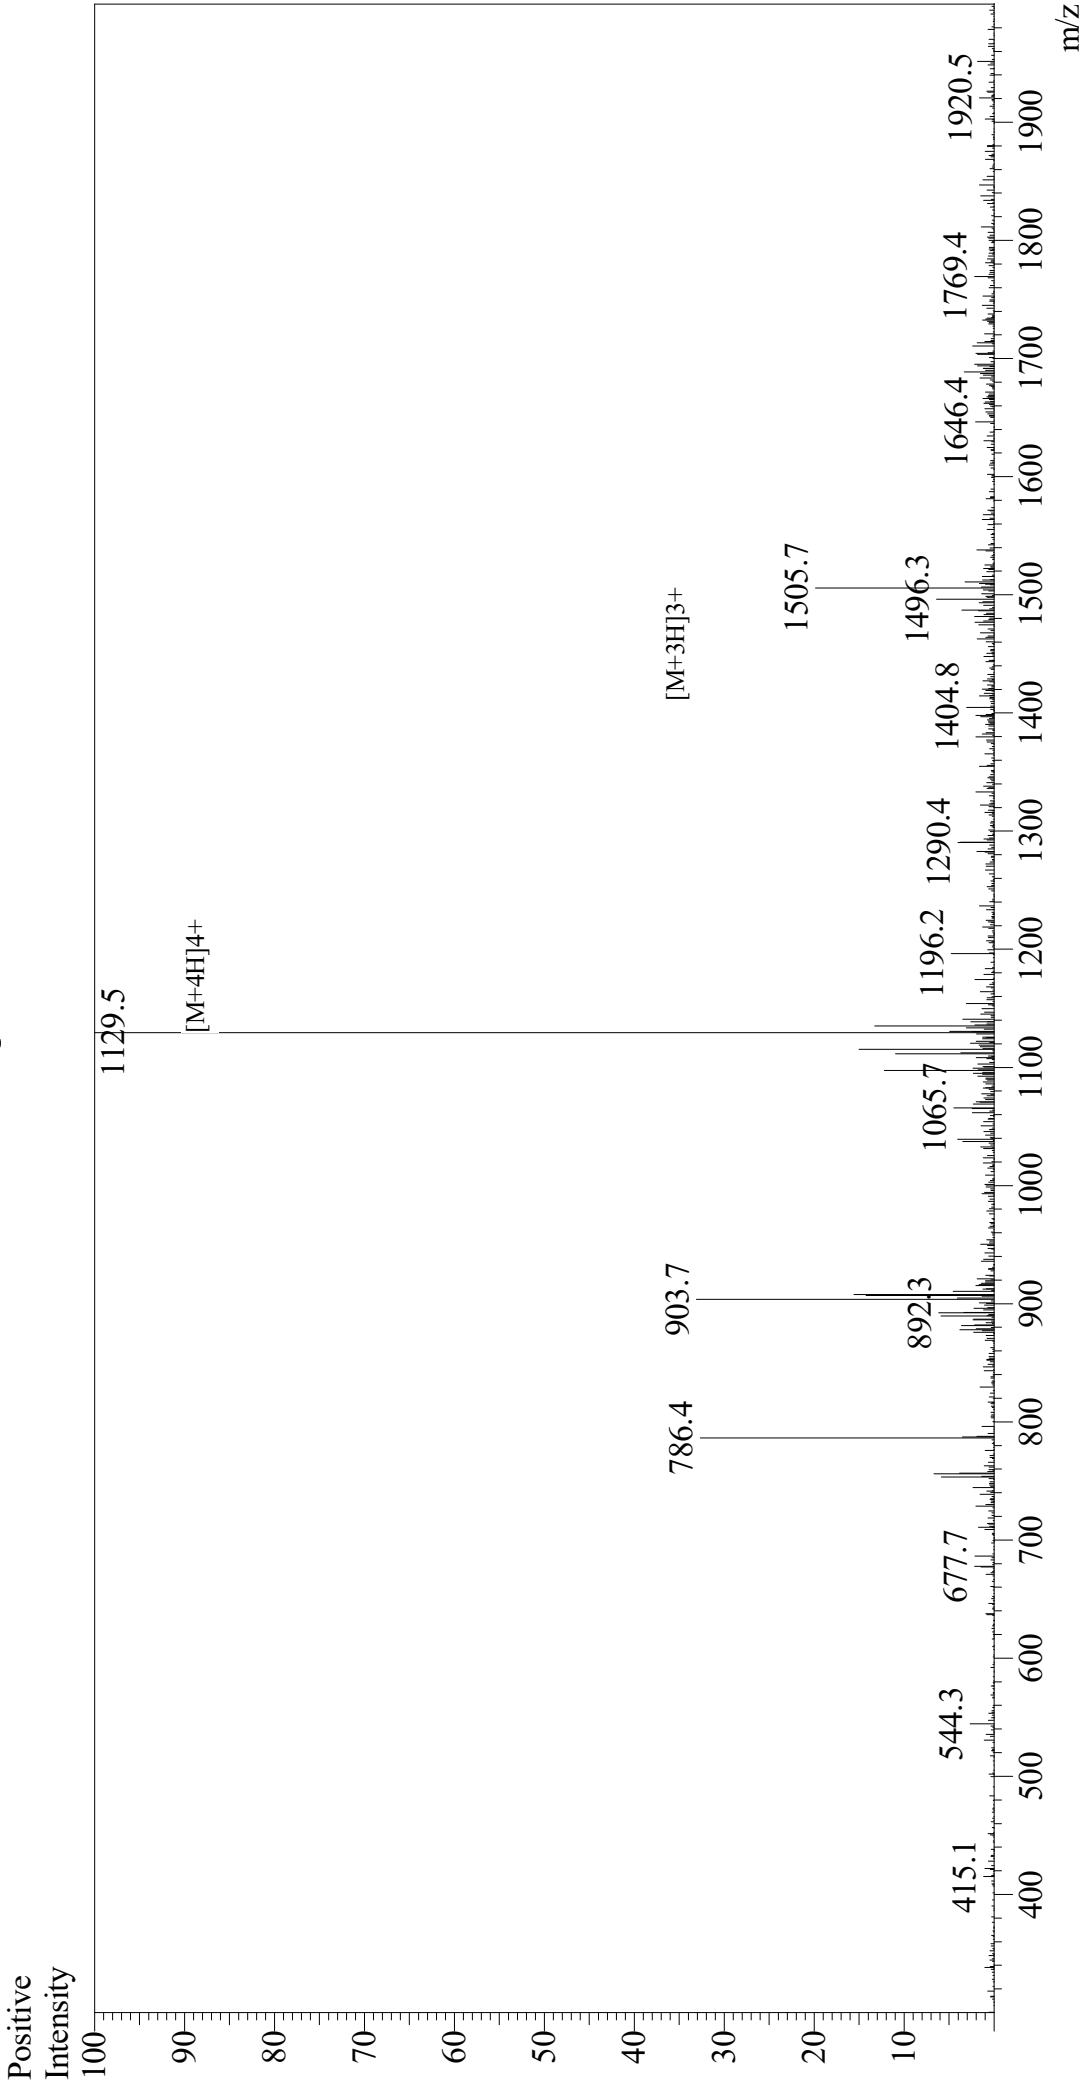

Sample Information

Acquired by: Gary
 Month-Day Processed: 12/11/19
 Time Processed: 09:51:10 AM
 Injection Volume: 0.3
 Sample Name: β -Amyloid (1-42), human
 Cat No.: RP20527
 Lot No.: E7074019K
 Theoretical MW: 4514.10
 Observed MW: 4514.0

Interface

Interface: ESI
 Nebulizing Gas Flow: 1.5L/min
 CDL Temp: 250
 Block Temp: 200

Equipment

Equipment: GK11010007
 Interface Bias: +4.5 kV
 Drying Gas Flow: 5 L/min
 T.Flow: 0.2 ml/min
 B.conc: 50% H₂O/50% MeOH