


Mass Spectrum

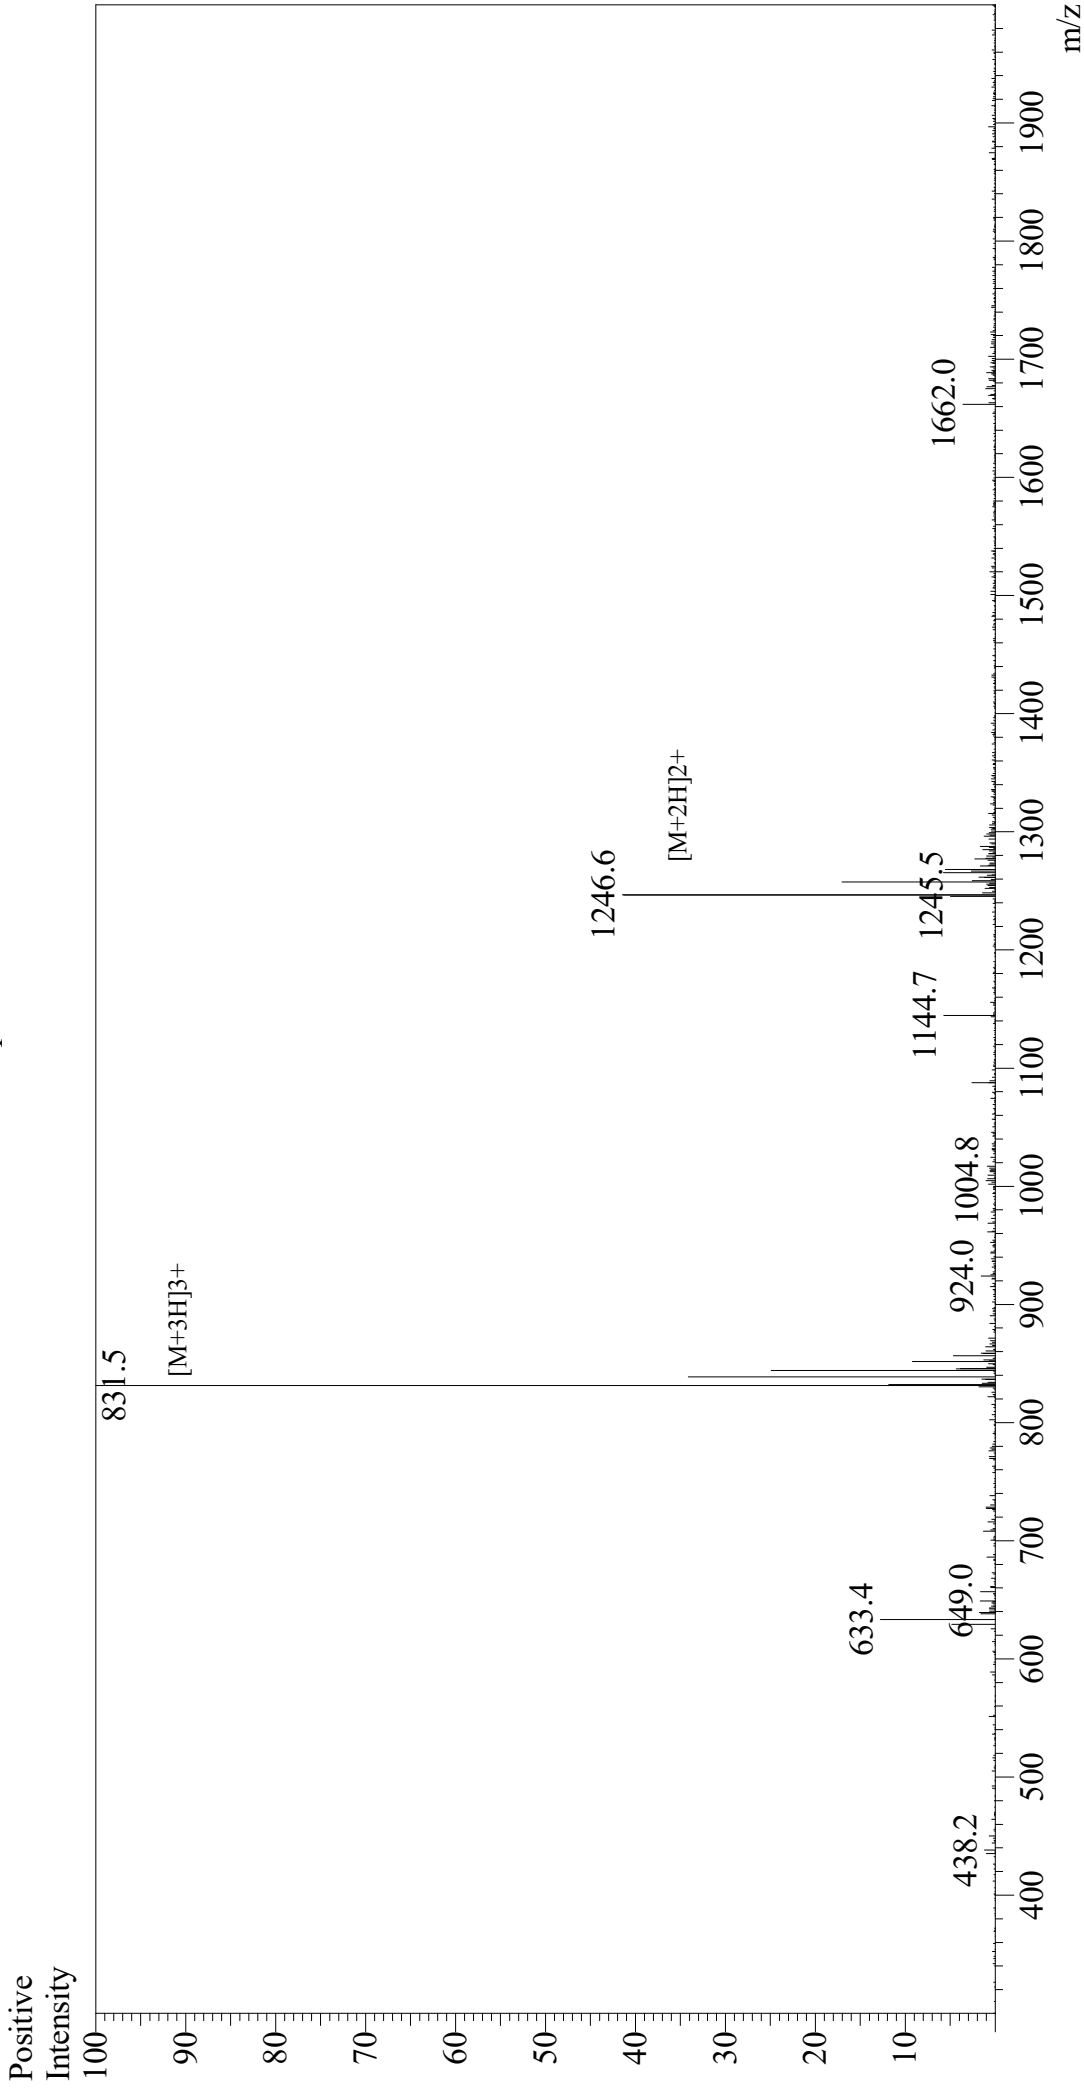

Sample Information
Month-Day Processed : 12/03/20
Time Processed : 10:00:37 PM
Injection Volume : 0.4
Sample Name : Endothelin 1, human, porcine
Cat No.: RP12758
Lot No.: E3901120K
Theoretical MW : 2491.90
Observed MW : 2491.5

Interface : ESI
Nebulizing Gas Flow : 1.5L/min
CDL Temp : 250
Block Temp : 200

Equipment : GK11010007
Interface Bias : +4.5 kV
Drying Gas Flow : 5 L/min
T.Flow : 0.2 ml/min
B.conc : 50% H2O/50% MeOH