

Sample Name : Atrial Natriuretic Peptide (ANP) (1-28), human, porcine
 Cat. No. : RP11927
 Lot. No. : E4666019J
 Time Processed : 16:13:30
 Month-Day-Year Processed : 10/06/2019

Pump A : 0.065% trifluoroacetic in 100% water (v/v)
 Pump B : 0.05% trifluoroacetic in 100% acetonitrile (v/v)
 Total Flow: 1 ml/min
 Wavelength: 220 nm

Time	Unit	Command	Value	Comment
0.01	Pumps	Pump A B.Conc	15	
25.00	Pumps	Pump A B.Conc	75	
31.00	Pumps	Pump A B.Conc	95	
32.00	Pumps	Pump A B.Conc	95	
32.01	Pumps	Pump A B.Conc	15	
40.00	Pumps	Pump A B.Conc	15	
40.00	Controller	Stop		


<<Column Performance>>

<Detector A>

Column : Inertsil ODS-3 4.6 x 250 mm

Equipment: GK11010009

Chromatogram

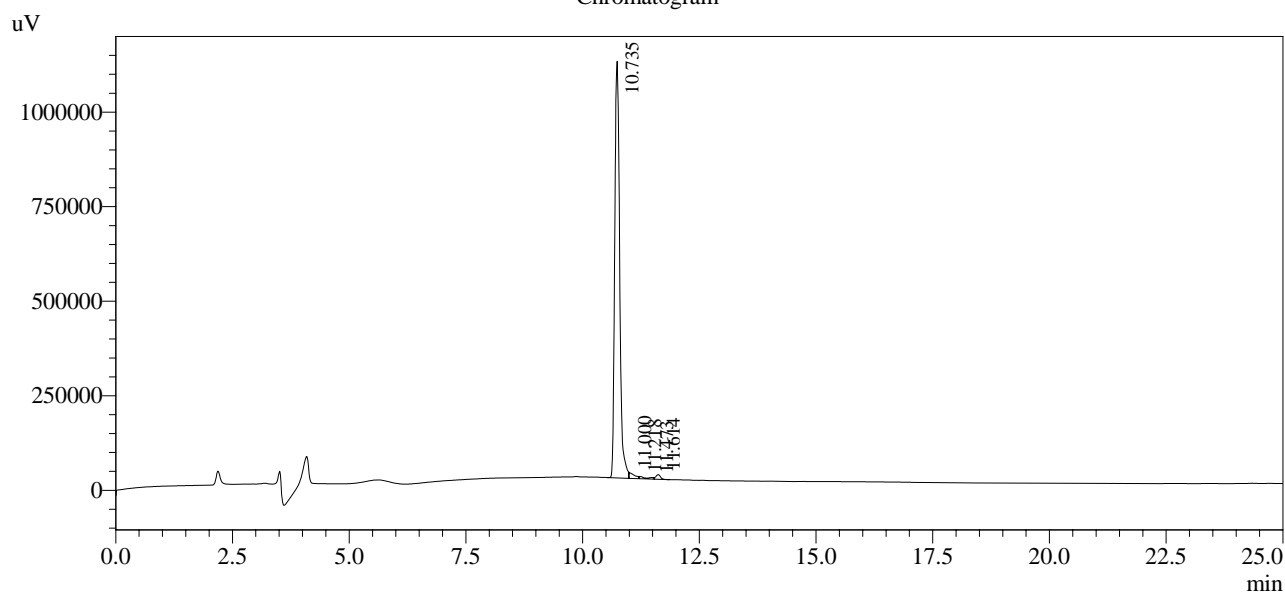

1 Det.A Ch1 / 220nm

Peak Table

Detector A Ch1 220nm

Peak#	Ret. Time	Area	Height	Area %
1	10.735	8099963	1101746	96.690
2	11.000	121271	15126	1.448
3	11.218	35663	5983	0.426
4	11.473	35752	4007	0.427
5	11.614	84642	12481	1.010
Total		8377291	1139343	100.000