

Sample Name :Osteogenic Growth Peptide, OGP  
 Cat No. :RP20311  
 Lot No. :E8999720G  
 Time Processed :7:39:10  
 Month-Day-Year Processed :07/15/2020

Pump A : 0.065% trifluoroacetic in 100% water (v/v)  
 Pump B : 0.05% trifluoroacetic in 100% acetonitrile (v/v)  
 Total Flow:1 ml/min  
 Wavelength:220 nm

Time	Unit	Command	Value	Comment
0.01	Pumps	Pump A B.Conc	5	
25.00	Pumps	Pump A B.Conc	65	
25.01	Pumps	Pump A B.Conc	95	
27.00	Pumps	Pump A B.Conc	95	
27.01	Pumps	Pump A B.Conc	5	
35.00	Pumps	Pump A B.Conc	5	
35.01	Controller	Stop		


<<Column Performance>>

<Detector A>

Column : Inertsil ODS-3 4.6 x 250 mm

Equipment: GR11010440

Chromatogram

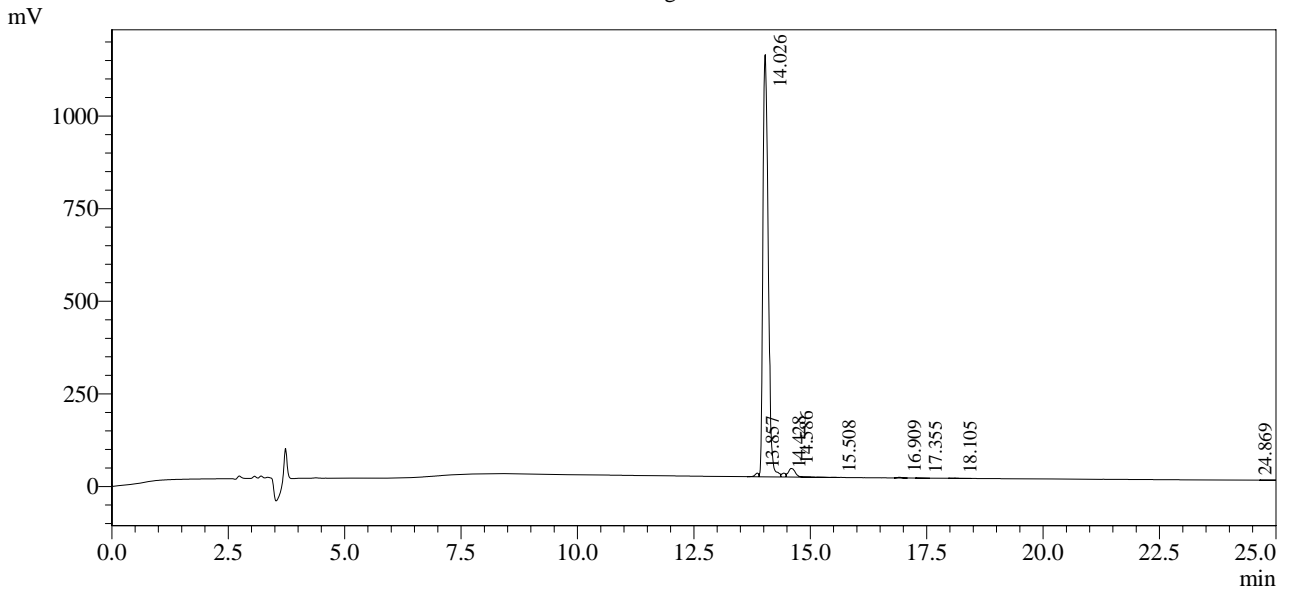

1 Det.A Ch1 / 220nm

Peak Table

Detector A Ch1 220nm

Peak#	Ret. Time	Area	Height	Area %
1	13.857	55449	9691	0.586
2	14.026	9069991	1139507	95.838
3	14.428	63152	10316	0.667
4	14.586	249129	23147	2.632
5	15.508	2184	427	0.023
6	16.909	11226	1972	0.119
7	17.355	3267	504	0.035
8	18.105	4506	538	0.048
9	24.869	4985	569	0.053
Total		9463890	1186672	100.000