


Mass Spectrum

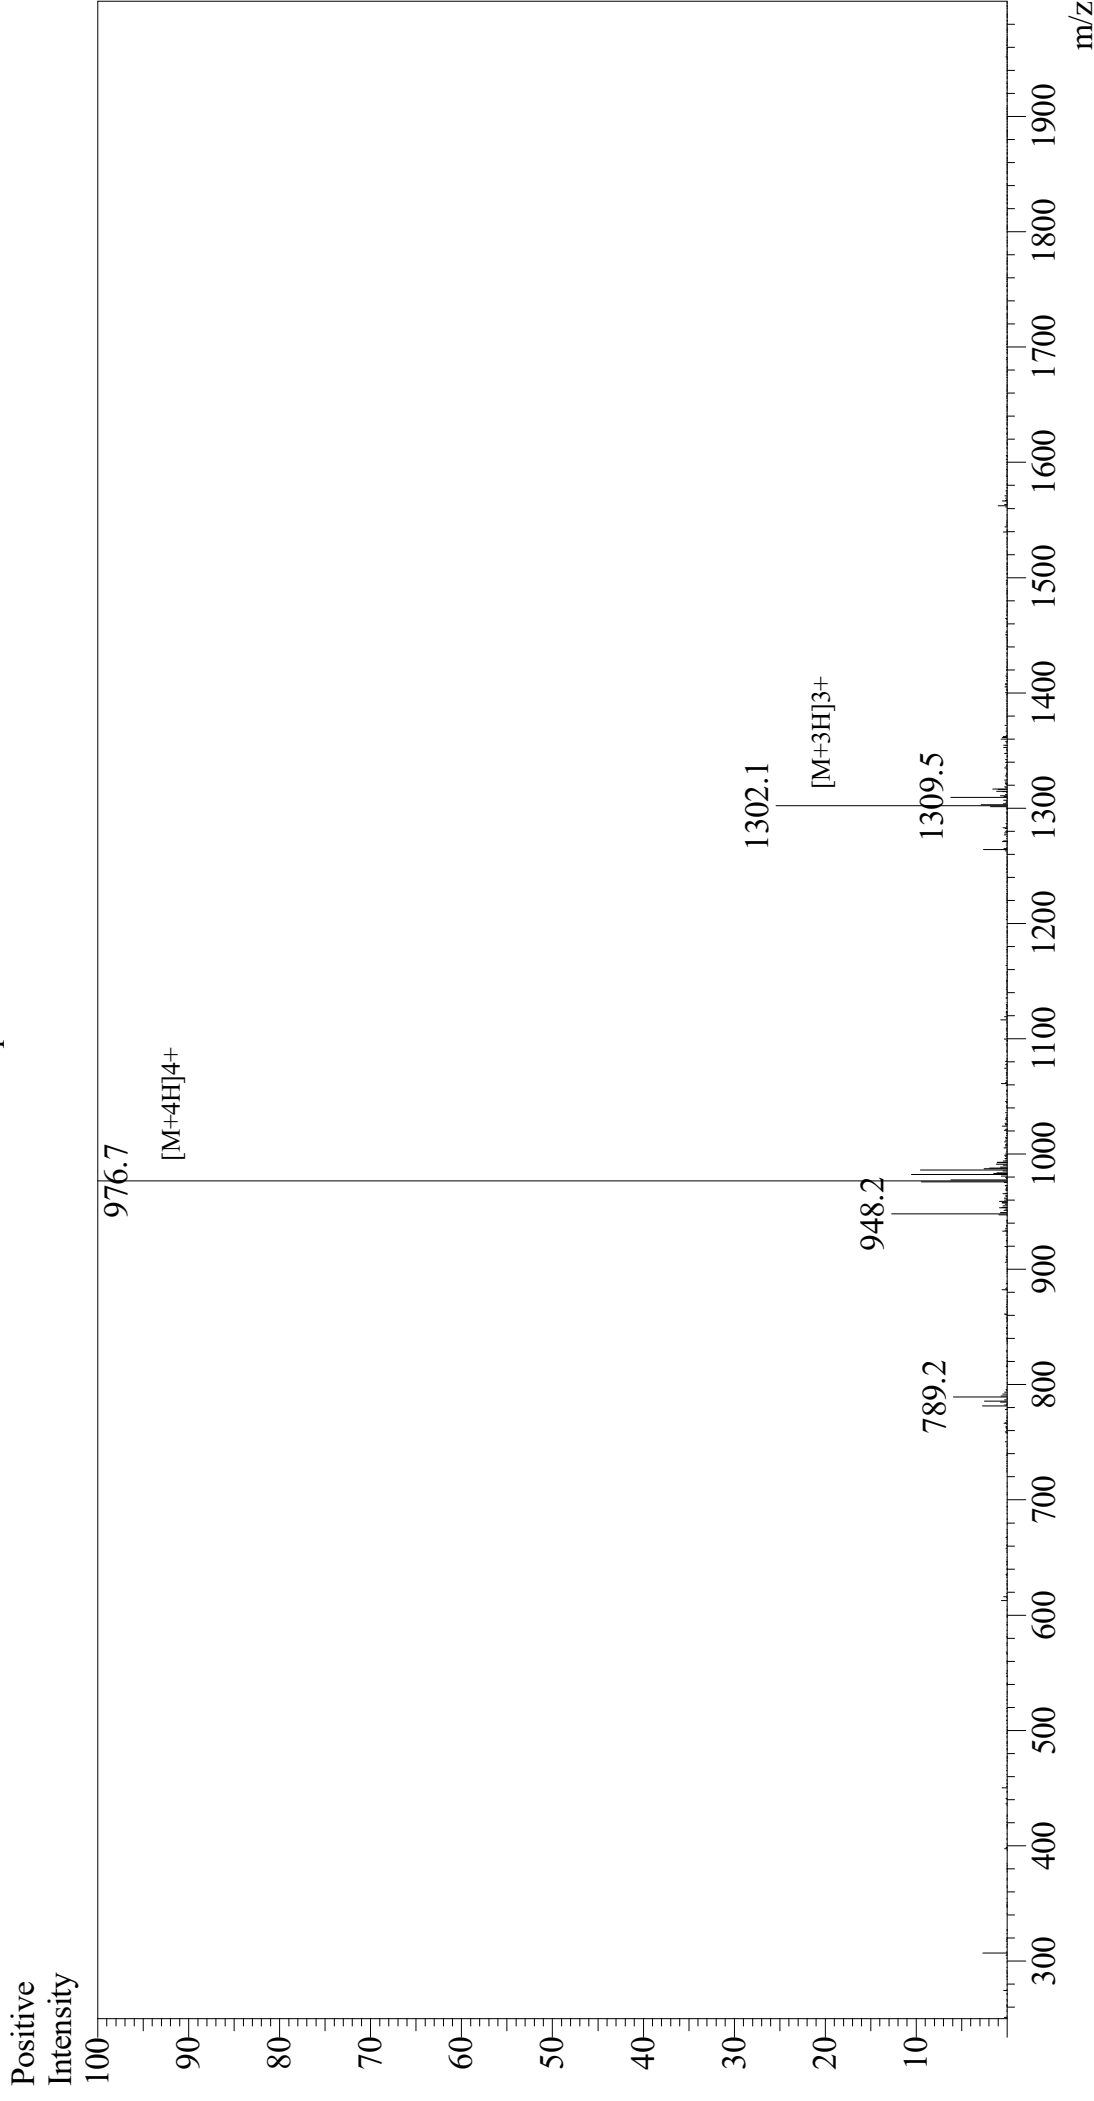

Sample Information

Month-Day Processed : 12/26/21
 Time Processed : 19:17:30
 Injection Volume : 0.2
 Sample Name : Amylin, human, amide
 Cat No. : RP11278
 Lot No. : E1882921L
 Theoretical MW : 3903.28
 Observed MW : 3902.8

Interface : ESI
 Nebulizing Gas Flow : 1.5L/min
 CDL Temp : 250
 Block Temp : 200

Equipment : GK11010007
 Interface Bias : +3.5 kV
 Drying Gas Flow : 5 L/min
 T.Flow : 0.2 ml/min
 B.conc : 50%H₂O/50%MeOH