

Sample Name : c-Myc Peptide
 Cat. No. : RP11731
 Lot. No. : E4744019I
 Time Processed : 14:45:37
 Month-Day-Year Processed : 09/20/2019

Pump A : 0.065% trifluoroacetic in 100% water (v/v)
 Pump B : 0.05% trifluoroacetic in 100% acetonitrile (v/v)
 Total Flow: 1 ml/min
 Wavelength: 220 nm

Time	Unit	Command	Value	Comment
0.01	Pumps	Pump B Conc.	5	
25.00	Pumps	Pump B Conc.	65	
25.01	Pumps	Pump B Conc.	95	
31.00	Pumps	Pump B Conc.	95	
31.01	Pumps	Pump B Conc.	5	
40.00	Pumps	Pump B Conc.	5	
40.01	Controller	Stop		


<<Column Performance>>

<Detector A>

Column : Inertsil ODS-3 4.6 x 250 mm

Equipment: GK11010009

Chromatogram

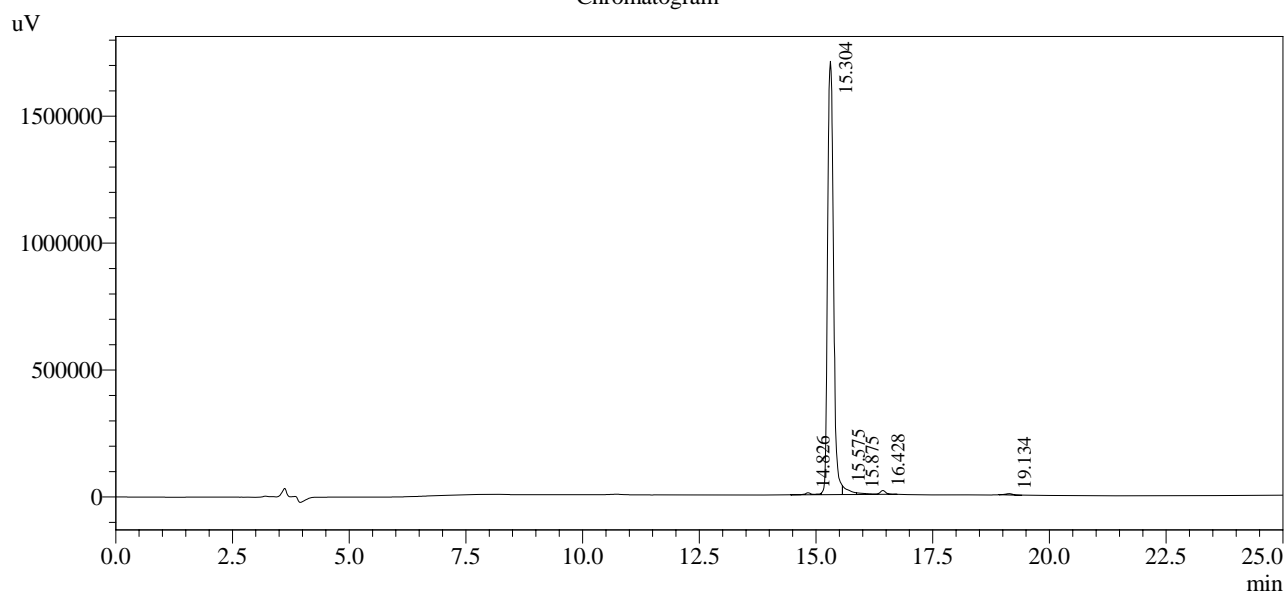

1 Det.A Ch1 / 220nm

Peak Table

Detector A Ch1 220nm

Peak#	Ret. Time	Area	Height	Area %
1	14.826	86604	7882	0.554
2	15.304	14986422	1707286	95.899
3	15.575	288362	32464	1.845
4	15.875	75505	6386	0.483
5	16.428	132404	15257	0.847
6	19.134	58040	5279	0.371
Total		15627336	1774553	100.000