

Sample Name : LSKL, Inhibitor of Thrombospondin (TSP-1)
 Cat. No. : RP19990
 Lot. No. : PE0351702


Pump A : 0.065% trifluoroacetic in 100% water (v/v)
 Pump B : 0.05% trifluoroacetic in 100% acetonitrile (v/v)
 Total Flow: 1 ml/min
 Wavelength: 220 nm

Time	Unit	Command	Value	Comment
0.01	Pumps	Pump A B.Conc	5	
25.00	Pumps	Pump A B.Conc	65	
25.01	Pumps	Pump A B.Conc	95	
31.00	Pumps	Pump A B.Conc	95	
31.01	Pumps	Pump A B.Conc	5	
40.00	Pumps	Pump A B.Conc	5	
40.01	Controller	Stop		

<<Column Performance>>

<Detector A>

Column : Inertsil ODS-3 4.6 x 250 mm

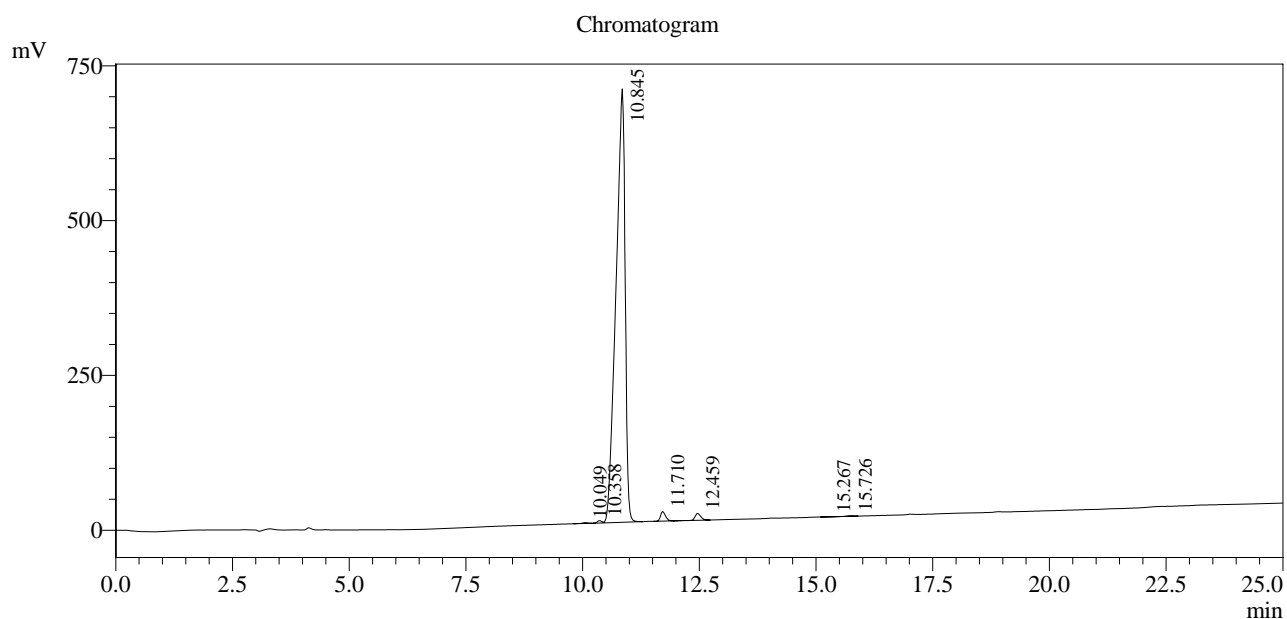

1 Det.A Ch1 / 220nm

Peak Table

Detector A Ch1 220nm

Peak#	Ret. Time	Area	Height	Area %
1	10.049	9230	1206	0.095
2	10.358	25539	3846	0.262
3	10.845	9511188	699782	97.396
4	11.710	115972	15397	1.188
5	12.459	94624	10991	0.969
6	15.267	2437	303	0.025
7	15.726	6464	772	0.066
Total		9765453	732298	100.000