

Sample Name :c-Myc Peptide
 Cat. No. : RP11731
 Lot. No. : E9697019G
 Time Processed : 11:33:02
 Month-Day-Year Processed : 07/25/2019

Pump A : 0.065% trifluoroacetic in 100% water (v/v)
 Pump B : 0.05% trifluoroacetic in 100% acetonitrile (v/v)
 Total Flow: 1 ml/min
 Wavelength: 220 nm

Time	Unit	Command	Value	Comment
0.01	Pumps	Pump A B.Conc	15	
25.00	Pumps	Pump A B.Conc	75	
25.01	Pumps	Pump A B.Conc	95	
31.00	Pumps	Pump A B.Conc	95	
31.01	Pumps	Pump A B.Conc	15	
40.00	Pumps	Pump A B.Conc	15	
40.01	Controller	Stop		


<<Column Performance>>

<Detector A>

Column : Inertsil ODS-3 4.6 x 250 mm

Equipment: G09010878

Chromatogram

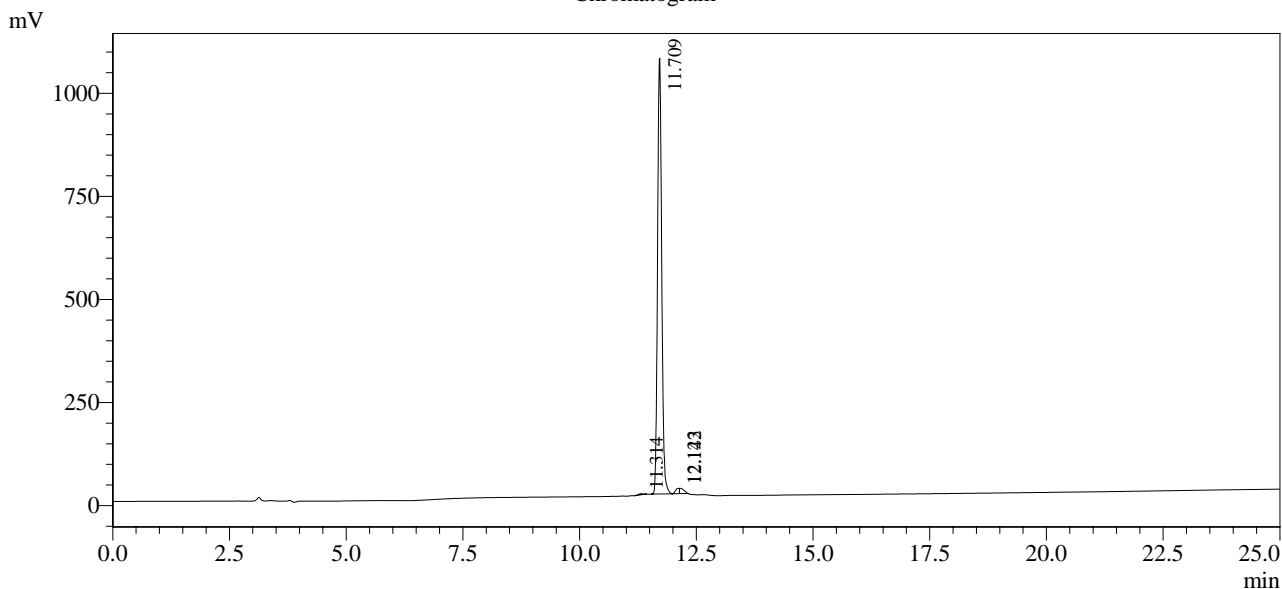

1 Det.A Ch1 / 220nm

Peak Table

Detector A Ch1 220nm

Peak#	Ret. Time	Area	Height	Area %
1	11.314	18954	2753	0.281
2	11.709	6575967	1055787	97.376
3	12.123	77513	12952	1.148
4	12.142	80758	12909	1.196
Total		6753191	1084400	100.000