


Mass Spectrum

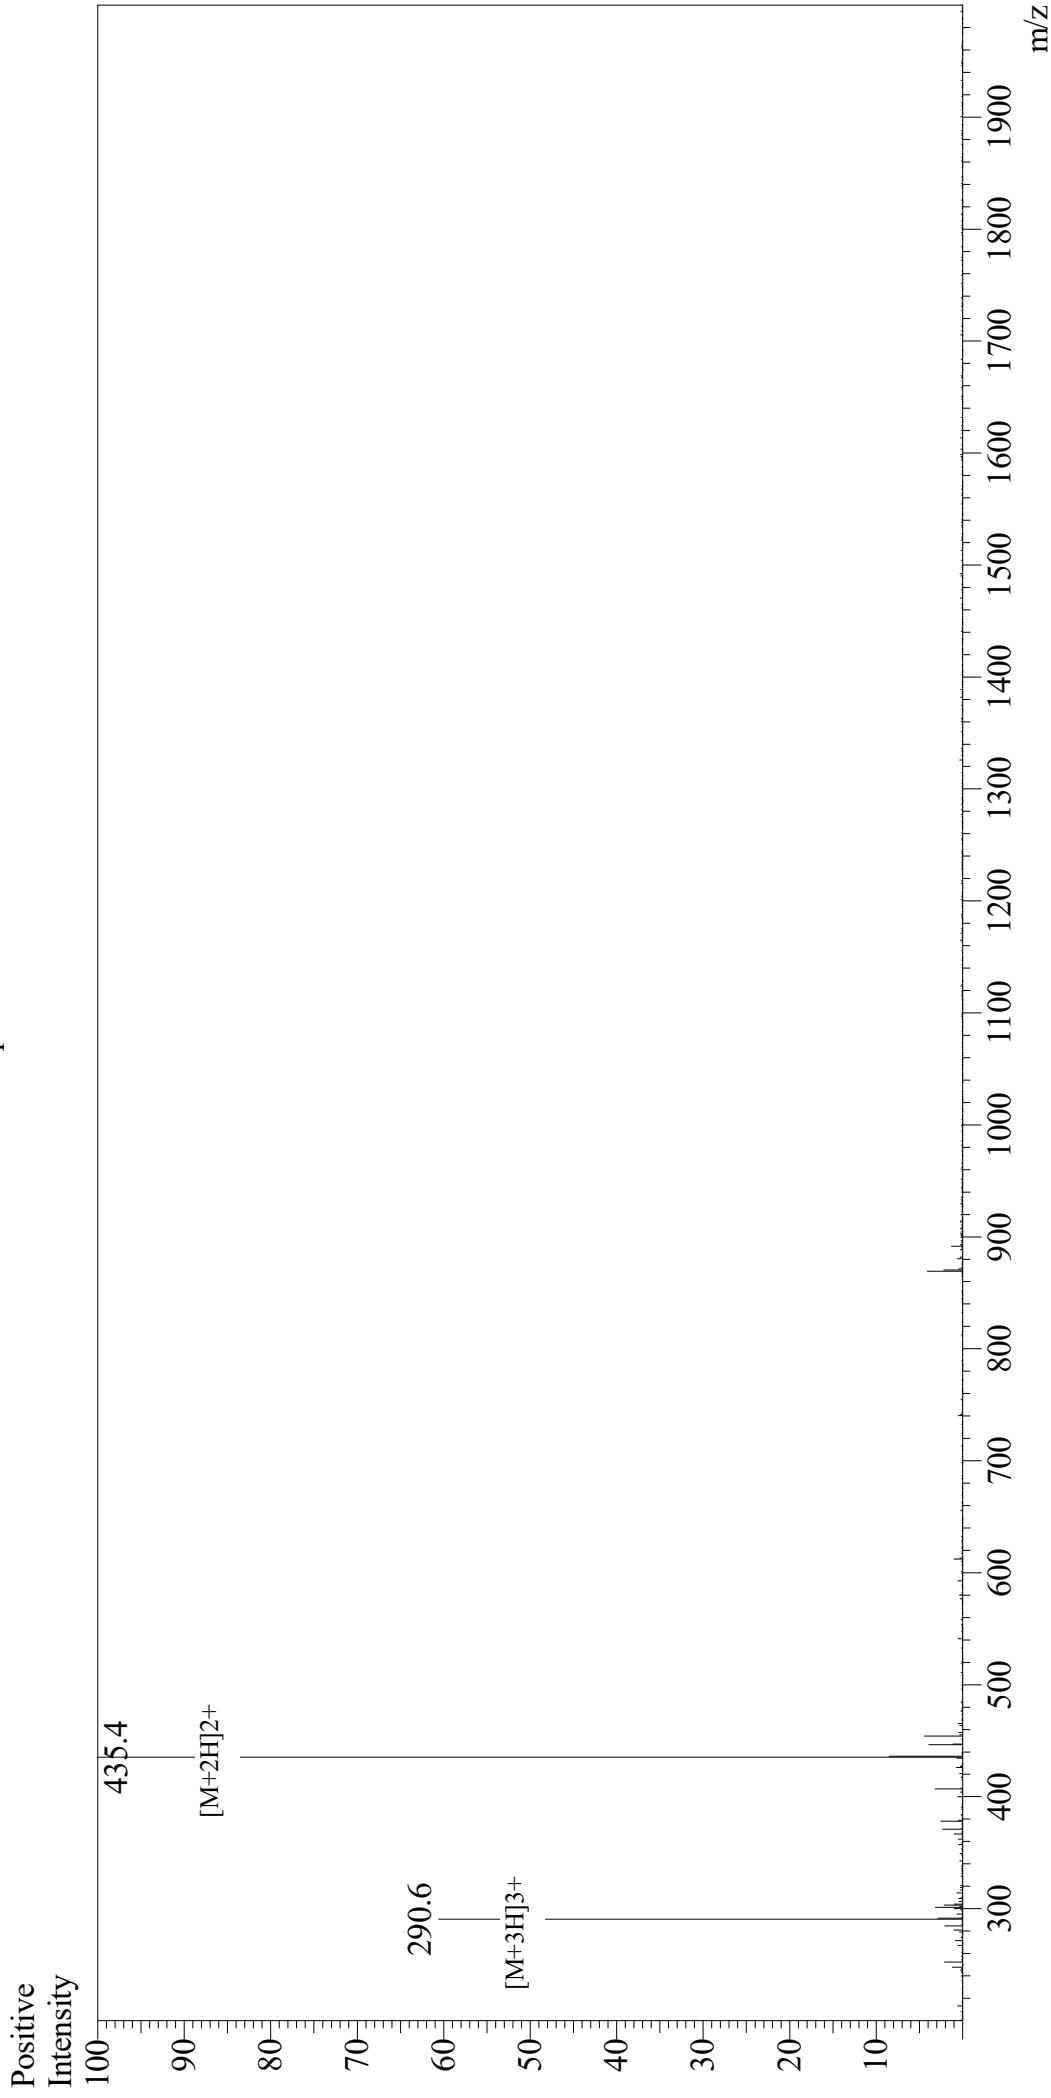

Sample Information

User : Gary
Month-Day Processed : 12/29/18
Time Processed : 09:49:32 PM
Injection Volume : 0.2
Sample Name : C-telopeptide
Cat No. : RP10566
Lot No. : PE0221812
Theoretical MW : 868.90
Observed MW : 868.8

Interface : ESI
Nebulizing Gas Flow : 1.5L/min
CDL Temp : 250
Block Temp : 200

Equipment : GK11010007
Interface Bias : +4.5kV
Drying Gas Flow : 5 L/min
T.Flow : 0.2ml/min
B.conc : 50%H2O/50%MeOH