

Sample Name: Gastric Inhibitory Peptide (GIP), human
 Cat. No. : RP10795
 Lot. No. : E0629819H
 Time Processed : 20:32:33
 Month-Day-Year Processed : 08/19/2019
 Pump A : 0.065% trifluoroacetic in 100% water (v/v)
 Pump B : 0.05% trifluoroacetic in 100% acetonitrile (v/v)
 Total Flow: 1 ml/min
 Wavelength: 220 nm


Time	Unit	Command	Value	Comment
0.01	Pumps	Pump A B.Conc	15	
25.00	Pumps	Pump A B.Conc	75	
25.01	Pumps	Pump A B.Conc	95	
31.00	Pumps	Pump A B.Conc	95	
31.01	Pumps	Pump A B.Conc	15	
40.00	Pumps	Pump A B.Conc	15	
40.01	Controller	Stop		

<<Column Performance>>

<Detector A>

Column : Inertsil ODS-3 4.6 x 250 mm

Equipment: G09010878

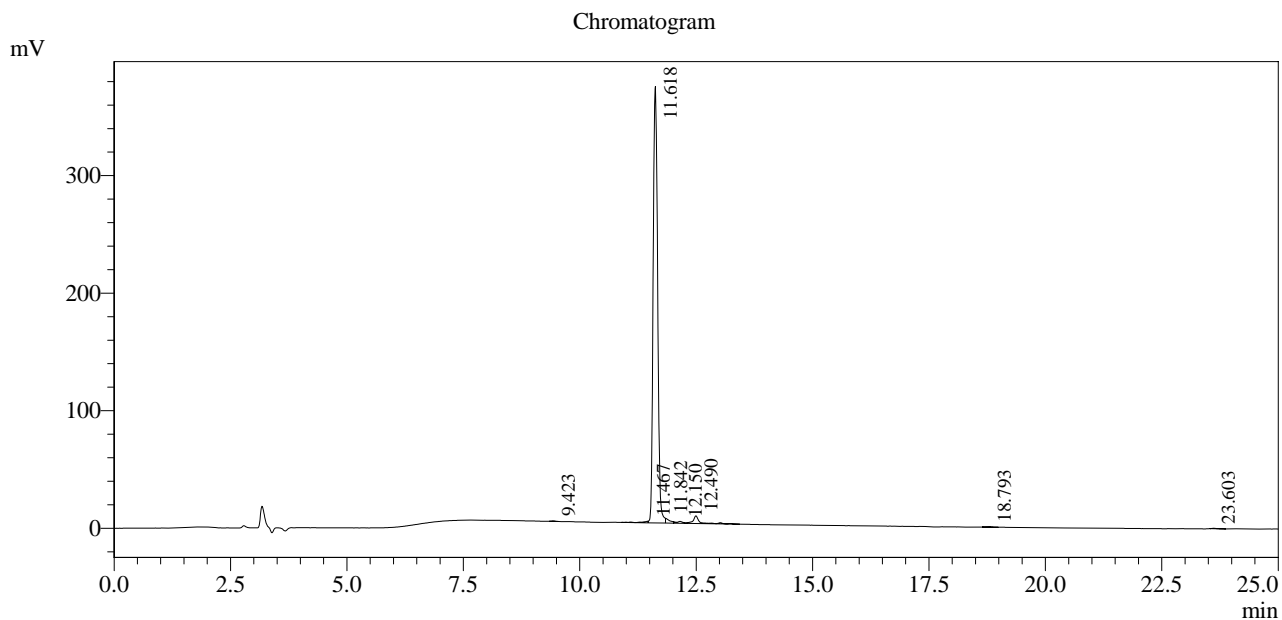

1 Det.A Ch1 / 220nm

Peak Table

Detector A Ch1 220nm

Peak#	Ret. Time	Area	Height	Area %
1	9.423	1743	387	0.067
2	11.467	13851	1414	0.531
3	11.618	2484314	371304	95.154
4	11.842	23958	4126	0.918
5	12.150	15175	1644	0.581
6	12.490	68804	6537	2.635
7	18.793	1422	196	0.054
8	23.603	1580	181	0.061
Total		2610848	385790	100.000