


Mass Spectrum

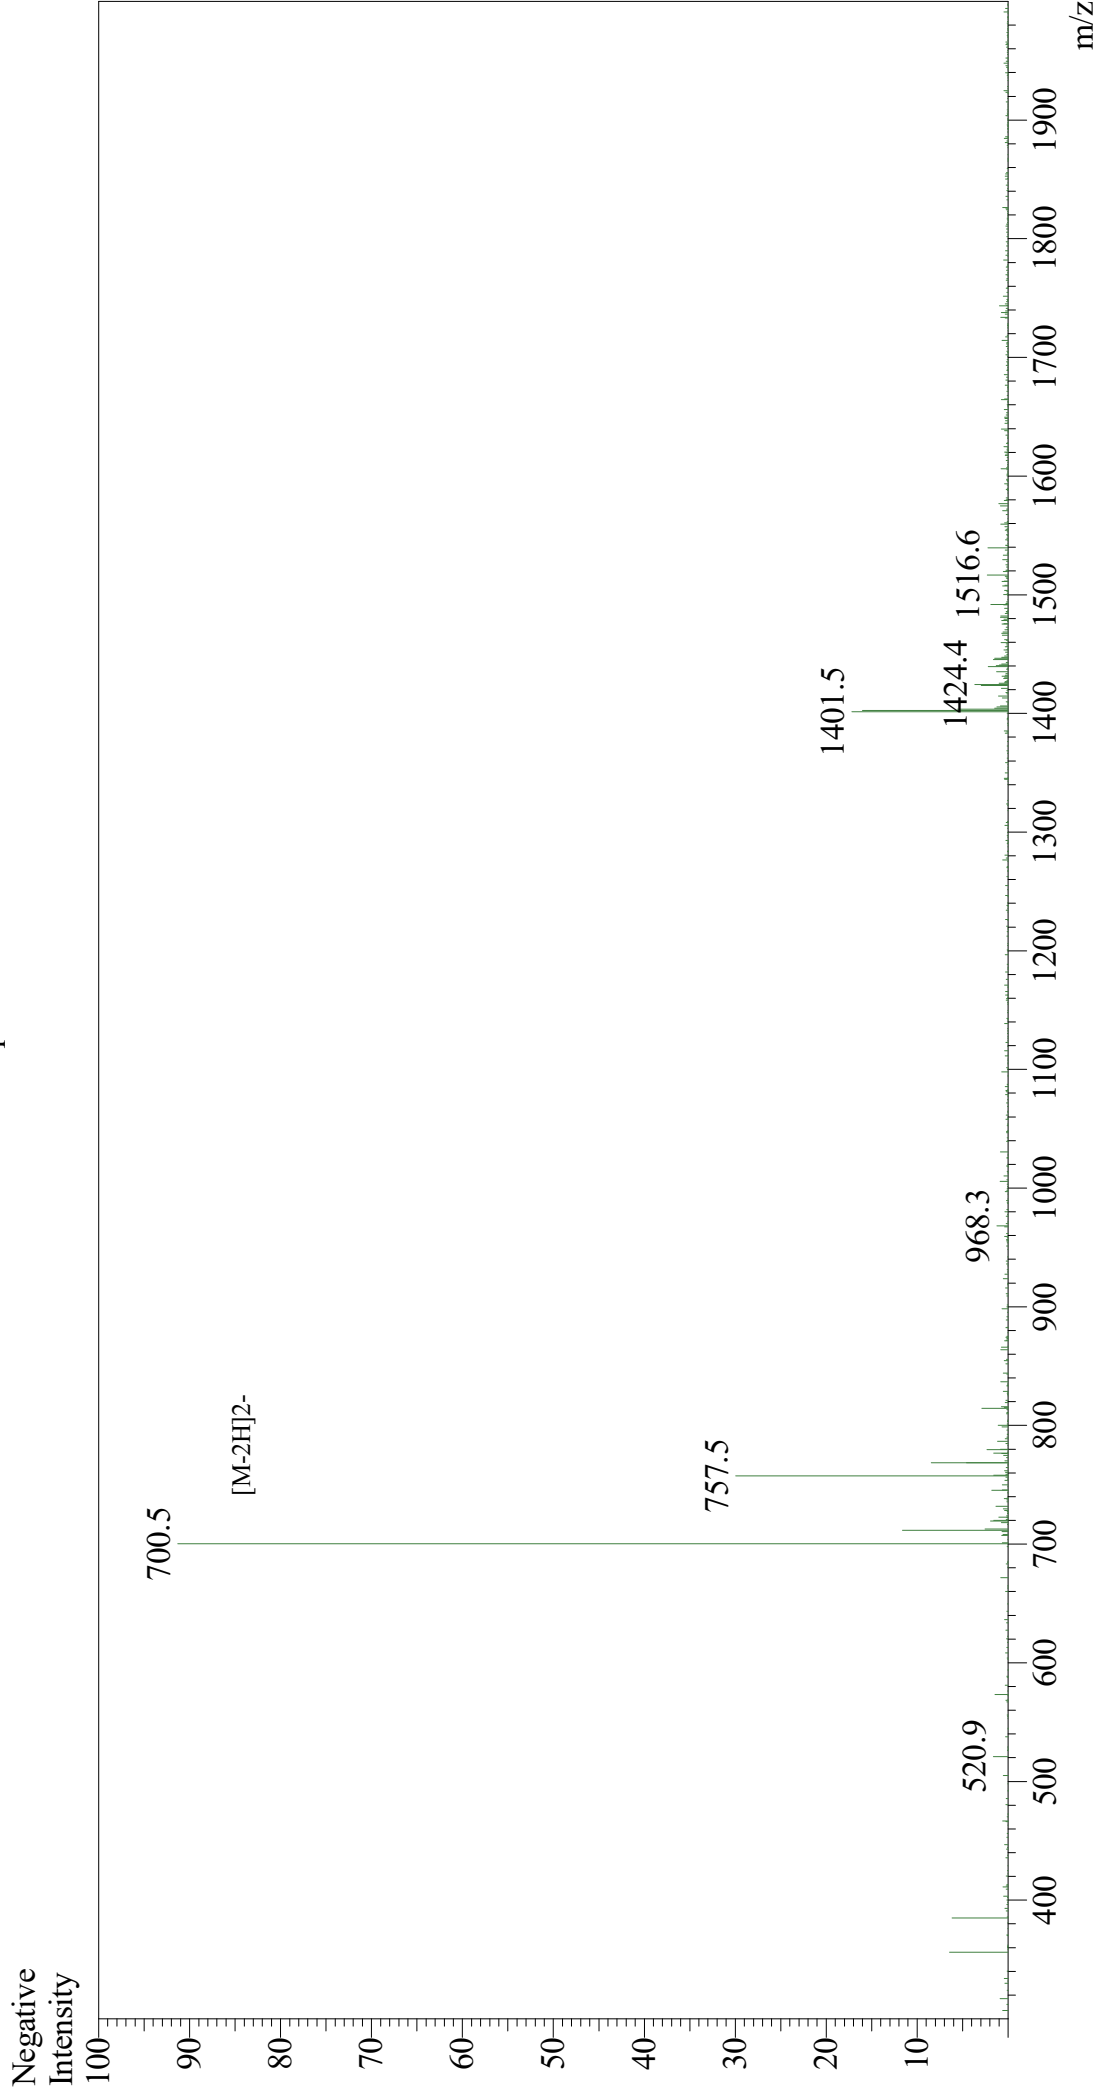

Sample Information

Month-Day Processed : 11/14/20
Time Processed : 12:34:09 PM
Injection Volume : 0.3
Sample Name : β -Amyloid (22-35)
Cat No: RP20130
Lot No : E4711120K
Theoretical MW : 1403.61
Observed MW : 1403.0

Interface : ESI
Nebulizing Gas Flow : 1.5L/min
CDL Temp : 250
Block Temp : 200

Equipment : GK11010007
Interface Bias : -3.5 kV
Drying Gas Flow : 5 L/min
T.Flow : 0.2 ml/min
B.conc : 50%H2O/50%MeOH