

Sample Name :Gastric Inhibitory Peptide (GIP), human
 Cat. No. : RP10795
 Lot. No. : PE8971812
 Time Processed : 13:23:31
 Month-Day-Year Processed : 12/31/2018

Pump A : 0.065% trifluoroacetic in 100% water (v/v)
 Pump B : 0.05% trifluoroacetic in 100% acetonitrile (v/v)
 Total Flow:1 ml/min
 Wavelength:220 nm

Time	Unit	Command	Value	Comment
0.01	Pumps	Pump A B.Conc	5	
25.00	Pumps	Pump A B.Conc	65	
25.01	Pumps	Pump A B.Conc	95	
31.00	Pumps	Pump A B.Conc	95	
31.01	Pumps	Pump A B.Conc	5	
40.00	Pumps	Pump A B.Conc	5	
40.00	Controller	Stop		


<<Column Performance>>

<Detector A>

Column : Inertsil ODS-3 4.6 x 250 mm

Equipment: G09010878

Chromatogram

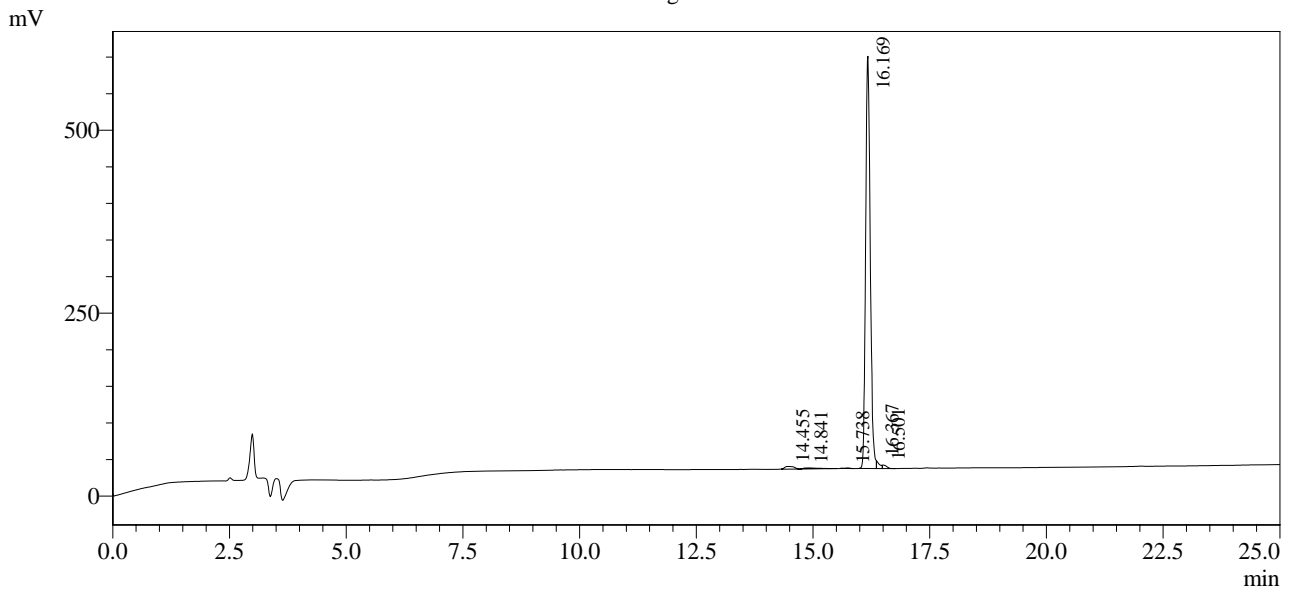

1 Det.A Ch1 / 220nm

Peak Table

Detector A Ch1 220nm

Peak#	Ret. Time	Area	Height	Area %
1	14.455	52817	3739	1.301
2	14.841	33108	1489	0.816
3	15.738	4733	665	0.117
4	16.169	3892325	563363	95.891
5	16.367	46505	9921	1.146
6	16.501	29630	4803	0.730
Total		4059117	583980	100.000