

Sample Name :Gastric Inhibitory Peptide (GIP), human  
 Cat No :RP10795  
 Lot No :E4980221F  
 Time Processed :20:07:45  
 Month-Day-Year Processed :06/08/2021


Pump A : 0.065% trifluoroacetic in 100% water (v/v)  
 Pump B : 0.05% trifluoroacetic in 100% acetonitrile (v/v)  
 Total Flow:1 ml/min  
 Wavelength:220 nm

Time	Module	Command	Value
0.01	Pumps	Pump A B.Conc	0
5.00	Pumps	Pump A B.Conc	0
20.00	Pumps	Pump A B.Conc	30
25.00	Pumps	Pump A B.Conc	65
27.01	Pumps	Pump A B.Conc	5
35.00	Pumps	Pump A B.Conc	5
35.01	Controller	Stop	

<<Column Performance>>

<Detector A>

Column : Inertsil ODS-3 4.6 x 250 mm

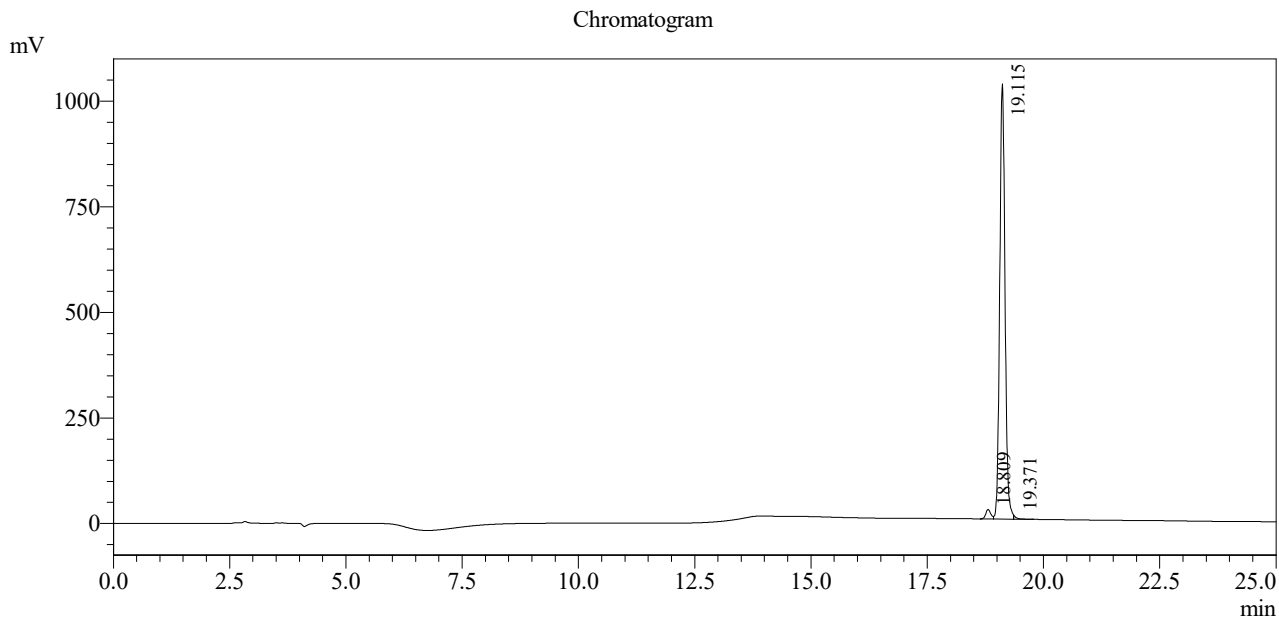

Peak Table

Detector A Channel 1 220nm

Peak#	Ret. Time	Area	Height	Area %
1	18.809	168847	22468	2.010
2	19.115	8201474	1030450	97.609
3	19.371	32050	8407	0.381
Total		8402371	1061325	100.000