

Sample Name : C-Type Natriuretic Peptide (CNP) (1-22), human  
 Cat. No. : RP11110  
 Lot. No. : E7089819J  
 Time Processed :13:02:46  
 Month-Day-Year Processed :10/06/2019

Pump A : 0.065% trifluoroacetic in 100% water (v/v)  
 Pump B : 0.05% trifluoroacetic in 100% acetonitrile (v/v)  
 Total Flow:1 ml/min  
 Wavelength:220 nm

Time	Unit	Command	Value	Comment
0.01	Pumps	Pump A B.Conc	5	
25.00	Pumps	Pump A B.Conc	65	
31.00	Pumps	Pump A B.Conc	95	
32.00	Pumps	Pump A B.Conc	95	
32.01	Pumps	Pump A B.Conc	5	
40.00	Pumps	Pump A B.Conc	5	
40.00	Controller	Stop		


<<Column Performance>>

<Detector A>

Column : Inertsil ODS-3 4.6 x 250 mm

Equipment: GK11010009

Chromatogram

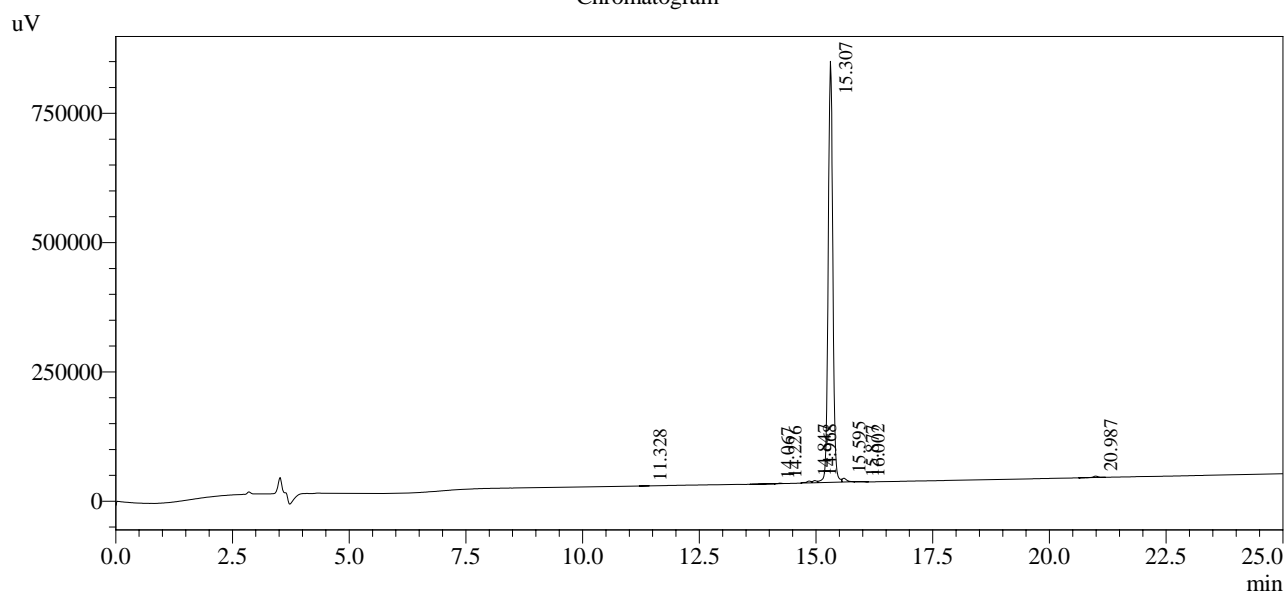

1 Det.A Ch1 / 220nm

Peak Table

Detector A Ch1 220nm

Peak#	Ret. Time	Area	Height	Area %
1	11.328	2244	399	0.039
2	14.067	3285	140	0.057
3	14.226	5827	1020	0.101
4	14.847	25274	3473	0.439
5	14.968	24504	4162	0.426
6	15.307	5622292	814264	97.631
7	15.595	48187	7327	0.837
8	15.877	2306	456	0.040
9	16.002	4230	760	0.073
10	20.987	20585	2689	0.357
Total		5758733	834691	100.000